

Report No.:

Test Time: 19.08.2020 13:30

## Luminaire Property

Luminaire Manufacturer:

Luminaire Description: FD 112 100W 5000K 90gr prozrachnoe steclo

Number of Lamps: 1

Luminous Width (mm): 275

Voltage: 221.4 V

Power: 98.27 W

Luminous Length (mm): 275

Luminous Height (mm): 90

Current: 0.447 A

Power Factor: 0.991

## Photometric Results

CIE Class: Direct

Measurement Flux: 14307.1 lm

Downward Ratio: 99%

Field Angle(C0/C180,C90/C270,C45/C225,C135/315): 120.1, 117.6, 119.7, 119.9

Beam Angle(C0/C180,C90/C270,C45/C225,C135/315): 94.9, 92.2, 93.8, 93.6

Luminaire Efficacy Rating (LER): 145.64

Max. Intensity: 7153.15 cd

S/MH(C0/C180): 1.41

Total Rated Lamp Lumens: 14307.1 lm

Efficiency: 100%


Upward Ratio: 1%

Central Intensity: 6366.01 cd


Pos of Max. Intensity: H180 V26

S/MH(C90/C270): 1.42

Termogramma

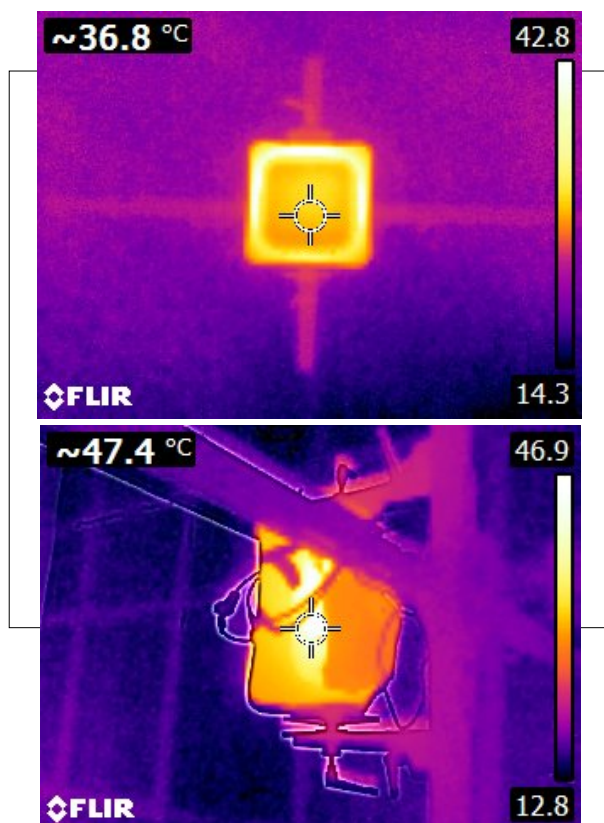

Luminous Intensity Distribution Curve

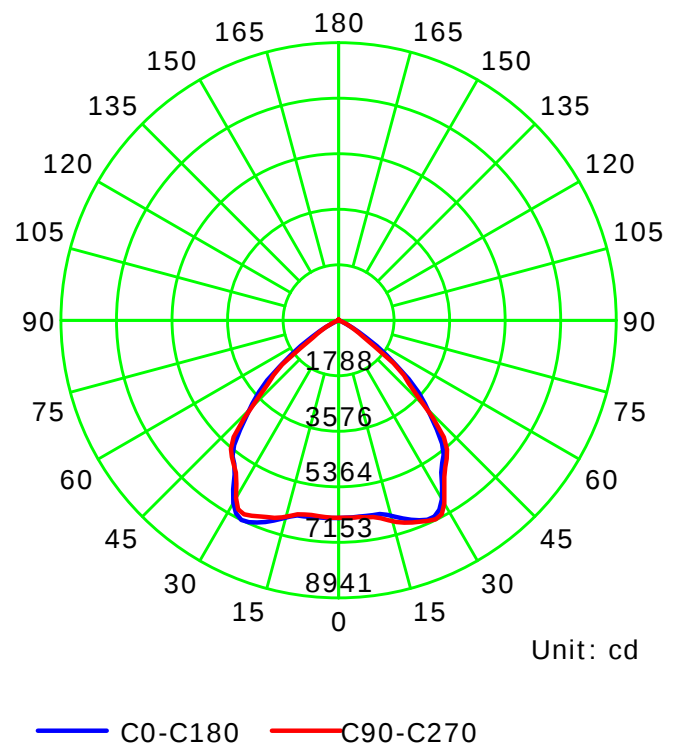

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0



Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:


## Luminous Intensity Distribution Curve

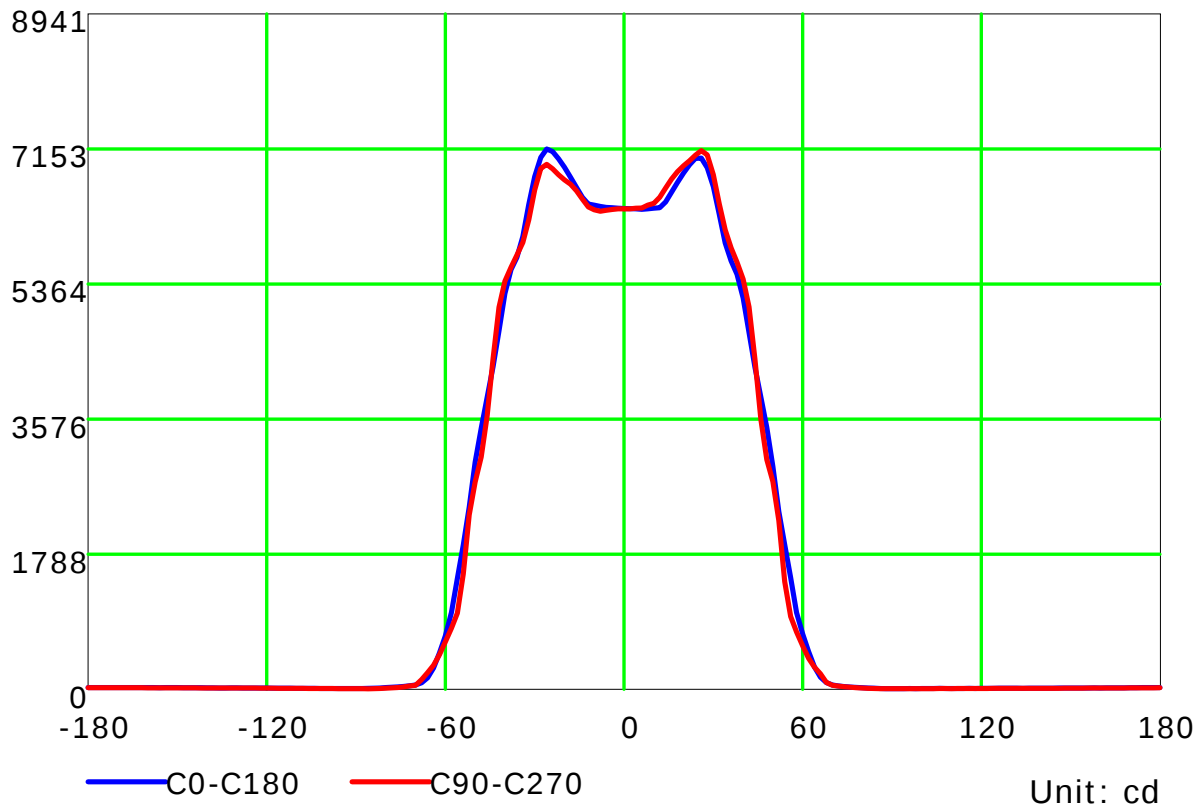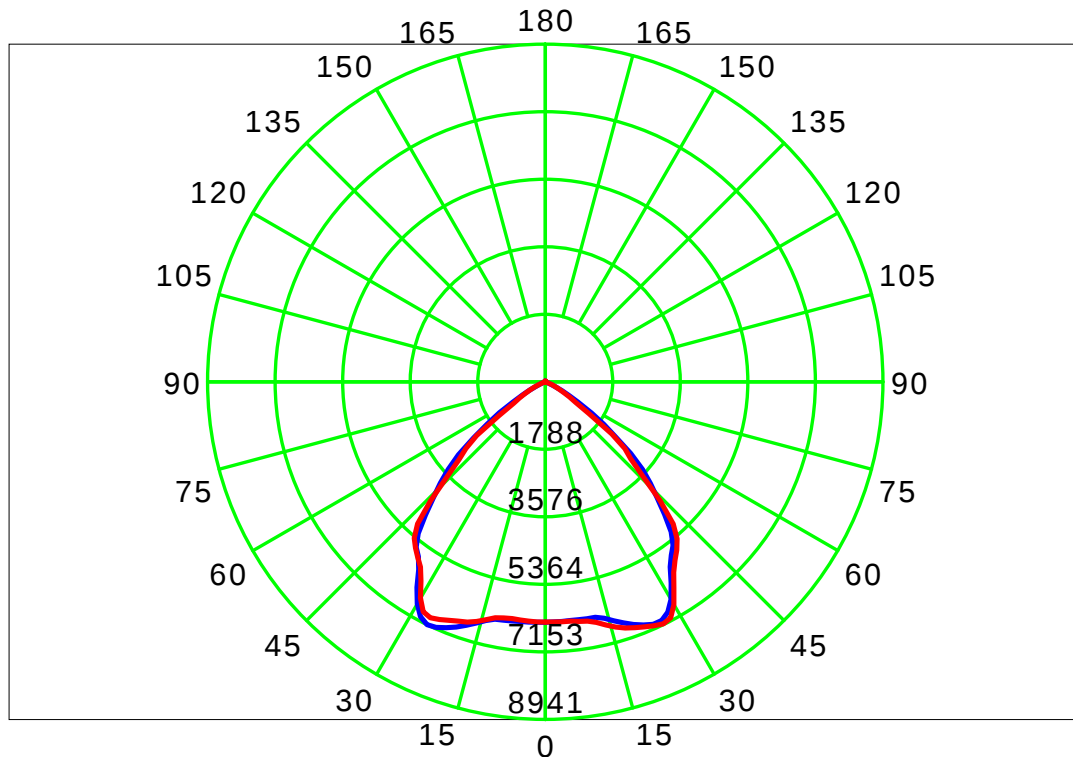

C Plane (°):0.0-360.0: 22.5  
Test Lab:  
Test Type: TYPE C  
Temperature:  
Operator:

Gamma Plane (°):0.0-180.0:2.0  
Test Device: LSG-1800B  
Distance: 12.677 m  
Humidity:  
Inspector:



## Luminous Intensity Distribution Curve(cd / klm)

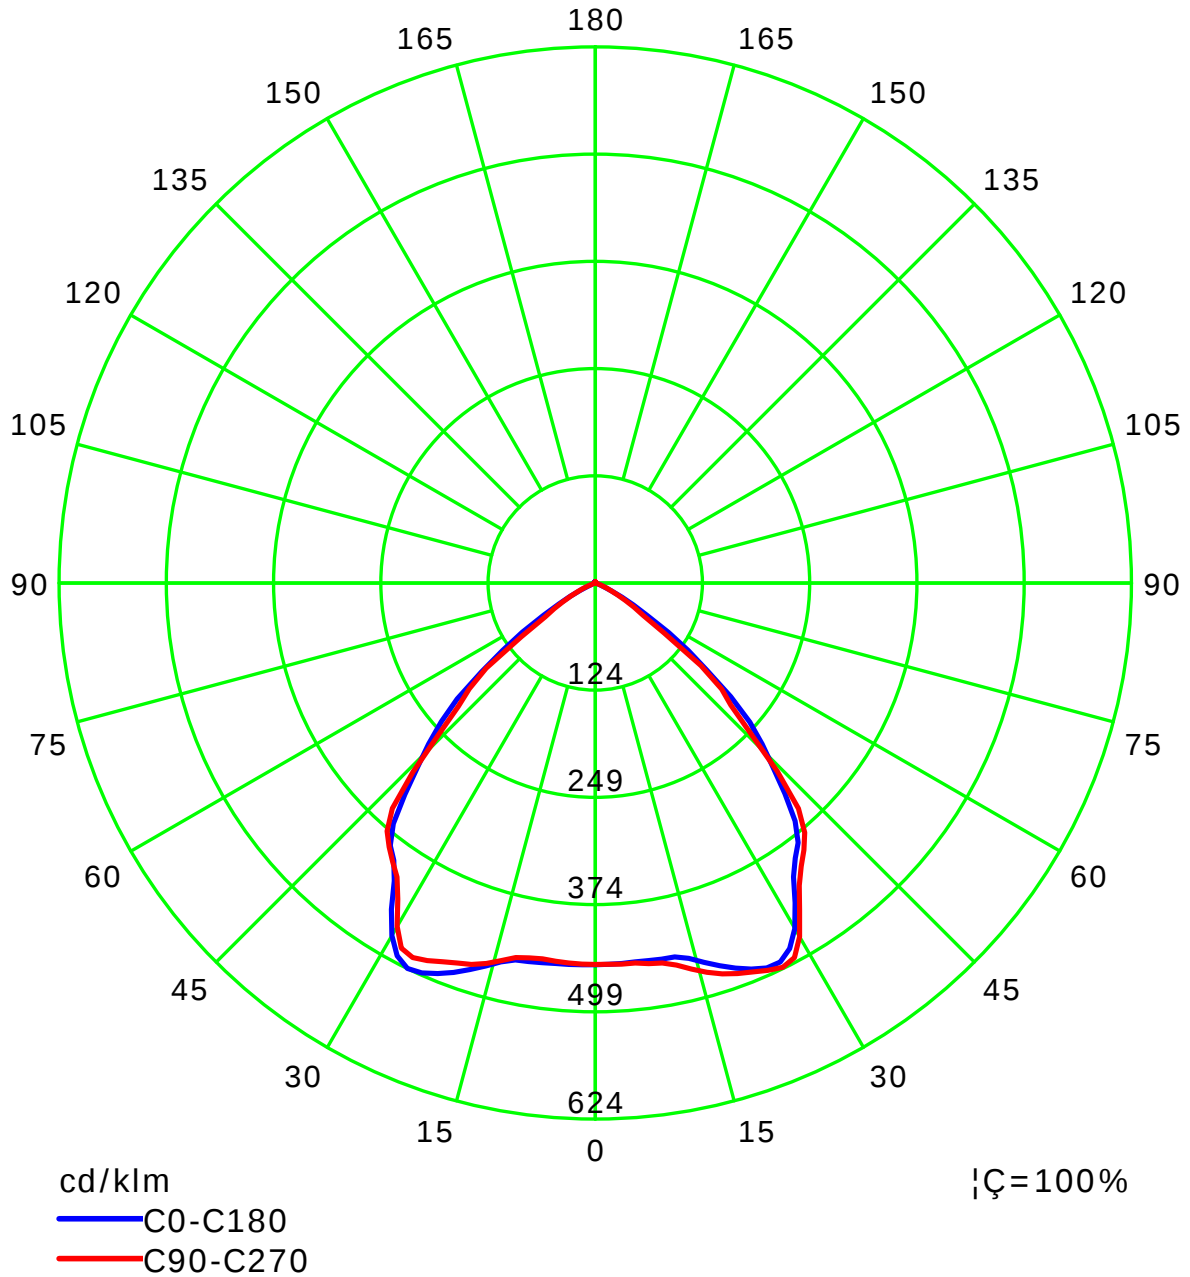

## Lum Limit Curve

| Dazzle | Quality | Illuminance (lx) |      |      |       |       |       |       |       |
|--------|---------|------------------|------|------|-------|-------|-------|-------|-------|
| 1.15   | A       | 2000             | 1000 | 500  | <=300 |       |       |       |       |
| 1.50   | B       |                  | 2000 | 1000 | 500   | <=300 |       |       |       |
| 1.85   | C       |                  |      | 2000 | 1000  | 500   | <=300 |       |       |
| 2.20   | D       |                  |      |      | 2000  | 1000  | 500   | <=300 |       |
| 2.55   | E       |                  |      |      |       | 2000  | 1000  | 500   | <=300 |

a b c d e f g h

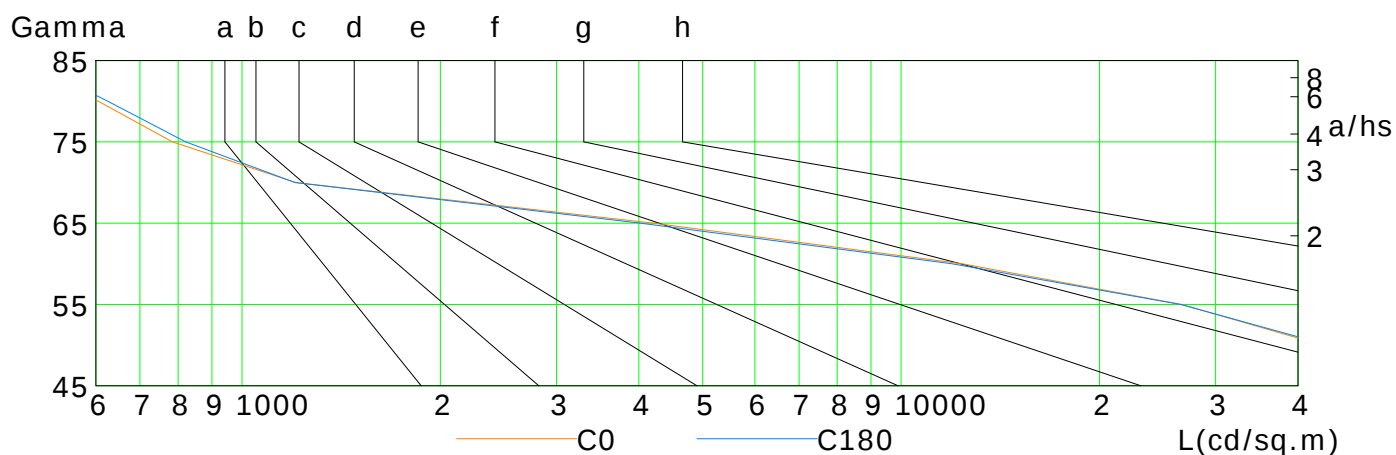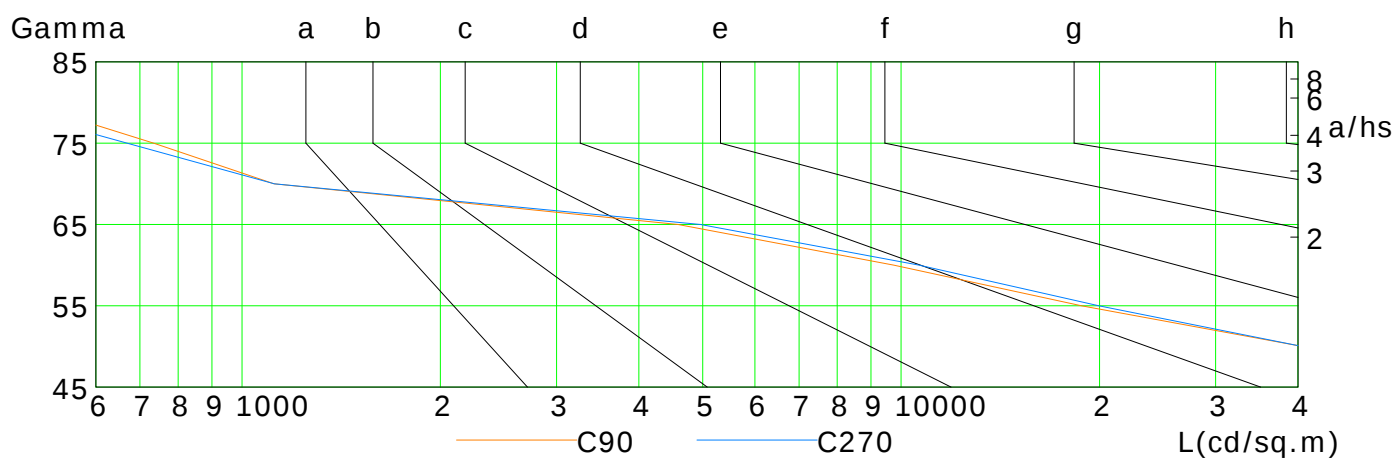

| L(cd/sq.m) | G45   | G50   | G55   | G60   | G65  | G70  | G75 | G80 | G85 |
|------------|-------|-------|-------|-------|------|------|-----|-----|-----|
| C0         | 57286 | 43653 | 26663 | 12382 | 4206 | 1207 | 784 | 605 | 437 |
| C90        | 55956 | 40704 | 18770 | 9745  | 4585 | 1119 | 735 | 467 | 344 |
| C180       | 57326 | 44517 | 26563 | 11964 | 4023 | 1203 | 821 | 625 | 471 |
| C270       | 56343 | 40614 | 19948 | 10643 | 4959 | 1120 | 669 | 401 | 290 |

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0


Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

## Illuminance at a Distance

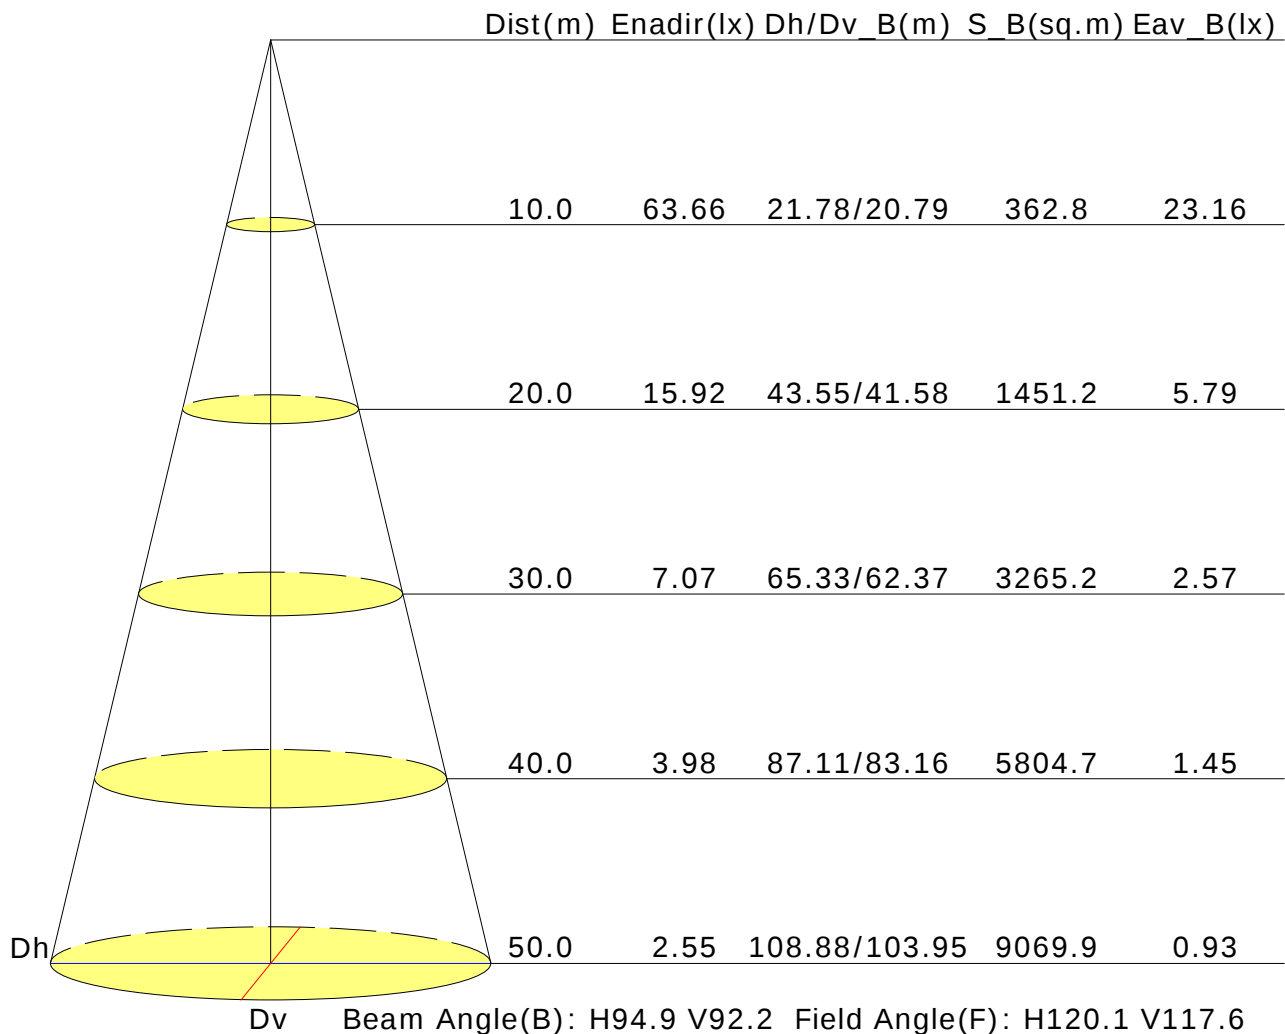

## UGR Table

|                                                    |                  |      |      |      |      |                |      |      |      |      |
|----------------------------------------------------|------------------|------|------|------|------|----------------|------|------|------|------|
| Reflectance:                                       |                  |      |      |      |      |                |      |      |      |      |
| Ceiling (cavity)                                   | 0.7              | 0.7  | 0.5  | 0.5  | 0.3  | 0.7            | 0.7  | 0.5  | 0.5  | 0.3  |
| Wall                                               | 0.5              | 0.3  | 0.5  | 0.3  | 0.3  | 0.5            | 0.3  | 0.5  | 0.3  | 0.3  |
| Reference plane                                    | 0.2              | 0.2  | 0.2  | 0.2  | 0.2  | 0.2            | 0.2  | 0.2  | 0.2  | 0.2  |
| Room dimensions                                    | Viewed crosswise |      |      |      |      | Viewed endwise |      |      |      |      |
| X=2H Y=2H                                          | 23.5             | 24.7 | 23.8 | 24.9 | 25.1 | 23.5           | 24.7 | 23.8 | 24.9 | 25.1 |
| 3H                                                 | 23.4             | 24.4 | 23.7 | 24.7 | 24.9 | 23.4           | 24.4 | 23.7 | 24.7 | 24.9 |
| 4H                                                 | 23.3             | 24.3 | 23.7 | 24.5 | 24.8 | 23.3           | 24.3 | 23.6 | 24.5 | 24.8 |
| 6H                                                 | 23.2             | 24.1 | 23.6 | 24.4 | 24.7 | 23.2           | 24.1 | 23.6 | 24.4 | 24.7 |
| 8H                                                 | 23.2             | 24.0 | 23.6 | 24.3 | 24.7 | 23.2           | 24.0 | 23.6 | 24.3 | 24.7 |
| 12H                                                | 23.2             | 24.0 | 23.5 | 24.3 | 24.6 | 23.2           | 23.9 | 23.5 | 24.3 | 24.6 |
| X=4H Y=2H                                          | 23.4             | 24.4 | 23.8 | 24.6 | 24.9 | 23.4           | 24.3 | 23.7 | 24.6 | 24.9 |
| 3H                                                 | 23.3             | 24.1 | 23.7 | 24.4 | 24.8 | 23.3           | 24.1 | 23.7 | 24.4 | 24.7 |
| 4H                                                 | 23.2             | 23.9 | 23.6 | 24.3 | 24.7 | 23.2           | 23.9 | 23.6 | 24.3 | 24.6 |
| 6H                                                 | 23.1             | 23.8 | 23.6 | 24.1 | 24.5 | 23.1           | 23.7 | 23.6 | 24.1 | 24.5 |
| 8H                                                 | 23.1             | 23.7 | 23.5 | 24.1 | 24.5 | 23.1           | 23.6 | 23.5 | 24.1 | 24.5 |
| 12H                                                | 23.1             | 23.6 | 23.5 | 24.0 | 24.4 | 23.0           | 23.5 | 23.5 | 24.0 | 24.4 |
| X=8H Y=4H                                          | 23.1             | 23.7 | 23.5 | 24.1 | 24.5 | 23.1           | 23.6 | 23.5 | 24.1 | 24.5 |
| 6H                                                 | 23.0             | 23.5 | 23.5 | 23.9 | 24.4 | 23.0           | 23.5 | 23.5 | 23.9 | 24.4 |
| 8H                                                 | 23.0             | 23.4 | 23.5 | 23.8 | 24.3 | 23.0           | 23.4 | 23.5 | 23.8 | 24.3 |
| 12H                                                | 23.0             | 23.3 | 23.5 | 23.8 | 24.3 | 22.9           | 23.3 | 23.4 | 23.8 | 24.3 |
| X=12H Y=4H                                         | 23.1             | 23.6 | 23.5 | 24.0 | 24.4 | 23.0           | 23.5 | 23.5 | 24.0 | 24.4 |
| 6H                                                 | 23.0             | 23.4 | 23.5 | 23.8 | 24.3 | 23.0           | 23.4 | 23.5 | 23.8 | 24.3 |
| 8H                                                 | 23.0             | 23.3 | 23.5 | 23.8 | 24.3 | 22.9           | 23.3 | 23.4 | 23.8 | 24.3 |
| Variations with the observer position at spacings: |                  |      |      |      |      |                |      |      |      |      |
| S=1.0H                                             | +1.3/-3.1        |      |      |      |      | +1.3/-3.1      |      |      |      |      |
| S=1.5H                                             | +2.9/-8.7        |      |      |      |      | +3.2/-8.8      |      |      |      |      |
| S=2.0H                                             | +4.8/-14.9       |      |      |      |      | +5.1/-15.6     |      |      |      |      |

Calculate in accordance with CIE Pub.117. The table is revised with 14307lm ( $8\log(F/F_0) = 9.2$ ).

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0

Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

## Utilisation Factor Table(Floor cavity)

| Utilisation Factors UF(F)                                                                                                                                                                        |      |       | SHR NOM = 1.25 |      |      |      |      |      |      |      |      |  |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------|-------|----------------|------|------|------|------|------|------|------|------|--|
| Room Reflectance                                                                                                                                                                                 |      |       | Room Index(RI) |      |      |      |      |      |      |      |      |  |
| Ceiling                                                                                                                                                                                          | Wall | Floor | 0.75           | 1.00 | 1.25 | 1.50 | 2.00 | 2.50 | 3.00 | 4.00 | 5.00 |  |
| 0.70                                                                                                                                                                                             | 0.50 | 0.20  | 0.71           | 0.81 | 0.87 | 0.91 | 0.97 | 1.01 | 1.03 | 1.06 | 1.08 |  |
|                                                                                                                                                                                                  | 0.30 |       | 0.65           | 0.75 | 0.82 | 0.86 | 0.93 | 0.97 | 1.00 | 1.03 | 1.06 |  |
|                                                                                                                                                                                                  | 0.20 |       | 0.60           | 0.71 | 0.78 | 0.83 | 0.89 | 0.94 | 0.97 | 1.01 | 1.04 |  |
| 0.50                                                                                                                                                                                             | 0.50 | 0.20  | 0.69           | 0.79 | 0.85 | 0.89 | 0.94 | 0.97 | 0.99 | 1.02 | 1.04 |  |
|                                                                                                                                                                                                  | 0.30 |       | 0.64           | 0.74 | 0.80 | 0.85 | 0.90 | 0.94 | 0.97 | 1.00 | 1.02 |  |
|                                                                                                                                                                                                  | 0.20 |       | 0.60           | 0.70 | 0.77 | 0.81 | 0.87 | 0.91 | 0.94 | 0.98 | 1.00 |  |
| 0.30                                                                                                                                                                                             | 0.50 | 0.20  | 0.68           | 0.77 | 0.83 | 0.86 | 0.91 | 0.94 | 0.96 | 0.98 | 1.00 |  |
|                                                                                                                                                                                                  | 0.30 |       | 0.63           | 0.73 | 0.79 | 0.83 | 0.88 | 0.92 | 0.94 | 0.97 | 0.98 |  |
|                                                                                                                                                                                                  | 0.20 |       | 0.59           | 0.69 | 0.76 | 0.80 | 0.86 | 0.89 | 0.92 | 0.95 | 0.97 |  |
| 0.00                                                                                                                                                                                             | 0.00 | 0.00  | 0.57           | 0.67 | 0.73 | 0.77 | 0.82 | 0.86 | 0.88 | 0.91 | 0.92 |  |
| <p>Rating:98W Photometrically tested without ceiling board.</p> <p>Multiply UF values by service correction factors</p> <p>Calculate in accordance with CIBSE Technical Memorandum NO.5 1980</p> |      |       |                |      |      |      |      |      |      |      |      |  |

## Utilisation Factor Table(Wall)

| Utilisation Factors UF(W)                                                                                                                                                                        |      |       | SHR NOM = 1.25 |      |      |      |      |      |      |      |      |  |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------|-------|----------------|------|------|------|------|------|------|------|------|--|
| Room Reflectance                                                                                                                                                                                 |      |       | Room Index(RI) |      |      |      |      |      |      |      |      |  |
| Ceiling                                                                                                                                                                                          | Wall | Floor | 0.75           | 1.00 | 1.25 | 1.50 | 2.00 | 2.50 | 3.00 | 4.00 | 5.00 |  |
| 0.70                                                                                                                                                                                             | 0.50 | 0.20  | 0.78           | 0.61 | 0.50 | 0.43 | 0.34 | 0.27 | 0.23 | 0.18 | 0.14 |  |
|                                                                                                                                                                                                  | 0.30 |       | 0.65           | 0.52 | 0.44 | 0.38 | 0.30 | 0.25 | 0.22 | 0.17 | 0.14 |  |
|                                                                                                                                                                                                  | 0.20 |       | 0.56           | 0.46 | 0.39 | 0.34 | 0.28 | 0.23 | 0.20 | 0.16 | 0.13 |  |
| 0.50                                                                                                                                                                                             | 0.50 | 0.20  | 0.75           | 0.58 | 0.48 | 0.41 | 0.32 | 0.30 | 0.22 | 0.17 | 0.13 |  |
|                                                                                                                                                                                                  | 0.30 |       | 0.63           | 0.51 | 0.42 | 0.36 | 0.29 | 0.24 | 0.20 | 0.16 | 0.13 |  |
|                                                                                                                                                                                                  | 0.20 |       | 0.55           | 0.45 | 0.38 | 0.33 | 0.27 | 0.22 | 0.19 | 0.15 | 0.12 |  |
| 0.30                                                                                                                                                                                             | 0.50 | 0.20  | 0.72           | 0.55 | 0.45 | 0.39 | 0.30 | 0.24 | 0.20 | 0.15 | 0.12 |  |
|                                                                                                                                                                                                  | 0.30 |       | 0.61           | 0.49 | 0.41 | 0.35 | 0.27 | 0.23 | 0.19 | 0.15 | 0.12 |  |
|                                                                                                                                                                                                  | 0.20 |       | 0.54           | 0.44 | 0.37 | 0.32 | 0.25 | 0.21 | 0.18 | 0.14 | 0.12 |  |
| 0.00                                                                                                                                                                                             | 0.00 | 0.00  | 0.42           | 0.32 | 0.26 | 0.22 | 0.17 | 0.14 | 0.12 | 0.09 | 0.07 |  |
| <p>Rating:98W Photometrically tested without ceiling board.</p> <p>Multiply UF values by service correction factors</p> <p>Calculate in accordance with CIBSE Technical Memorandum NO.5 1980</p> |      |       |                |      |      |      |      |      |      |      |      |  |

## Utilisation Factor Table(Ceiling cavity)

| Utilisation Factors UF(C)                                                                                                                                                         |      |       | SHR NOM = 1.25 |      |      |      |      |      |      |      |      |  |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------|-------|----------------|------|------|------|------|------|------|------|------|--|
| Room Reflectance                                                                                                                                                                  |      |       | Room Index(RI) |      |      |      |      |      |      |      |      |  |
| Ceiling                                                                                                                                                                           | Wall | Floor | 0.75           | 1.00 | 1.25 | 1.50 | 2.00 | 2.50 | 3.00 | 4.00 | 5.00 |  |
| 0.70                                                                                                                                                                              | 0.50 | 0.20  | 0.15           | 0.16 | 0.17 | 0.18 | 0.19 | 0.20 | 0.20 | 0.21 | 0.22 |  |
|                                                                                                                                                                                   | 0.30 |       | 0.10           | 0.11 | 0.13 | 0.14 | 0.16 | 0.17 | 0.18 | 0.19 | 0.20 |  |
|                                                                                                                                                                                   | 0.20 |       | 0.06           | 0.08 | 0.09 | 0.11 | 0.13 | 0.14 | 0.16 | 0.17 | 0.18 |  |
| 0.50                                                                                                                                                                              | 0.50 | 0.20  | 0.15           | 0.16 | 0.17 | 0.17 | 0.18 | 0.19 | 0.20 | 0.20 | 0.21 |  |
|                                                                                                                                                                                   | 0.30 |       | 0.10           | 0.11 | 0.13 | 0.14 | 0.15 | 0.16 | 0.17 | 0.18 | 0.19 |  |
|                                                                                                                                                                                   | 0.20 |       | 0.06           | 0.08 | 0.09 | 0.11 | 0.13 | 0.14 | 0.15 | 0.17 | 0.18 |  |
| 0.30                                                                                                                                                                              | 0.50 | 0.20  | 0.14           | 0.15 | 0.16 | 0.17 | 0.18 | 0.18 | 0.19 | 0.19 | 0.20 |  |
|                                                                                                                                                                                   | 0.30 |       | 0.09           | 0.11 | 0.12 | 0.13 | 0.15 | 0.16 | 0.17 | 0.18 | 0.18 |  |
|                                                                                                                                                                                   | 0.20 |       | 0.06           | 0.08 | 0.09 | 0.10 | 0.12 | 0.14 | 0.15 | 0.16 | 0.17 |  |
| 0.00                                                                                                                                                                              | 0.00 | 0.00  | 0.01           | 0.01 | 0.01 | 0.01 | 0.01 | 0.01 | 0.01 | 0.01 | 0.01 |  |
| Rating:98W Photometrically tested without ceiling board.<br>Multiply UF values by service correction factors<br>Calculate in accordance with CIBSE Technical Memorandum NO.5 1980 |      |       |                |      |      |      |      |      |      |      |      |  |