

Report No.:

Test Time: 18.12.2019 13:22

Luminaire Property

Luminaire Manufacturer:

Luminaire Description: FG 180 4x18LED 0,3A 36W 3000K закаленное стекло IP65 N

Number of Lamps: 1

Luminous Length (mm): 1200

Luminous Width (mm): 180

Luminous Height (mm): 76

Voltage: 221.3 V

Current: 0.168 A

Power: 36.14 W

Power Factor: 0.971

Photometric Results

CIE Class: Direct

Total Rated Lamp Lumens: 4480.3 lm

Measurement Flux: 4480.3 lm

Efficiency: 100%

Downward Ratio: 100%

Upward Ratio: 0%

Field Angle(C0/C180,C90/C270,C45/C225,C135/315): 156.2, 148.6, 149.2, 149.1

Beam Angle(C0/C180,C90/C270,C45/C225,C135/315): 115.5, 115.1, 115.4, 115.4

Luminaire Efficacy Rating (LER): 124.02

Central Intensity: 1588.53 cd

Max. Intensity: 1589.2 cd

Pos of Max. Intensity: H22.5 V0


S/MH(C0/C180): 1.29

S/MH(C90/C270): 1.30

Picture Of Luminaire



Luminous Intensity Distribution Curve

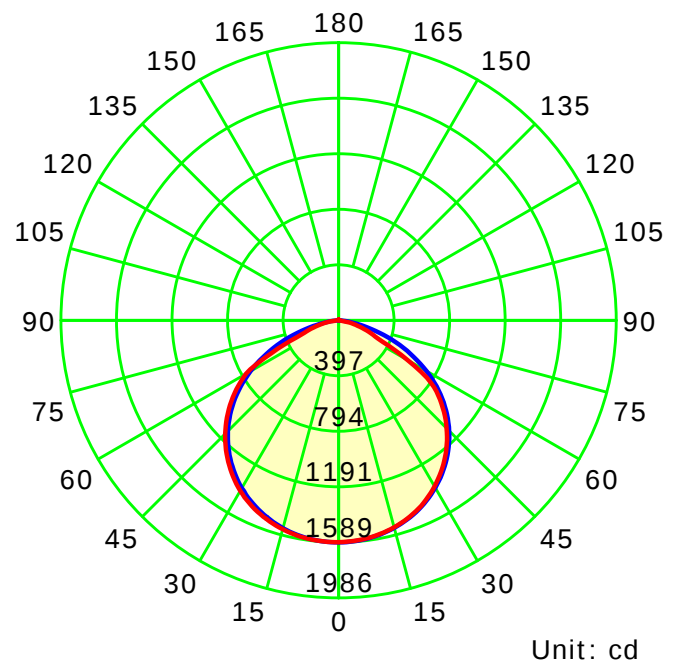

— C0-C180 — C90-C270

C Plane (°):0.0-360.0: 22.5

Gamma Plane (°):0.0-180.0:1.0

Test Lab:

Test Device: LSG-1800B

Test Type: TYPE C

Distance: 12.677 m



Temperature:

Humidity:

Operator:

Inspector:

Luminous Intensity Distribution Curve

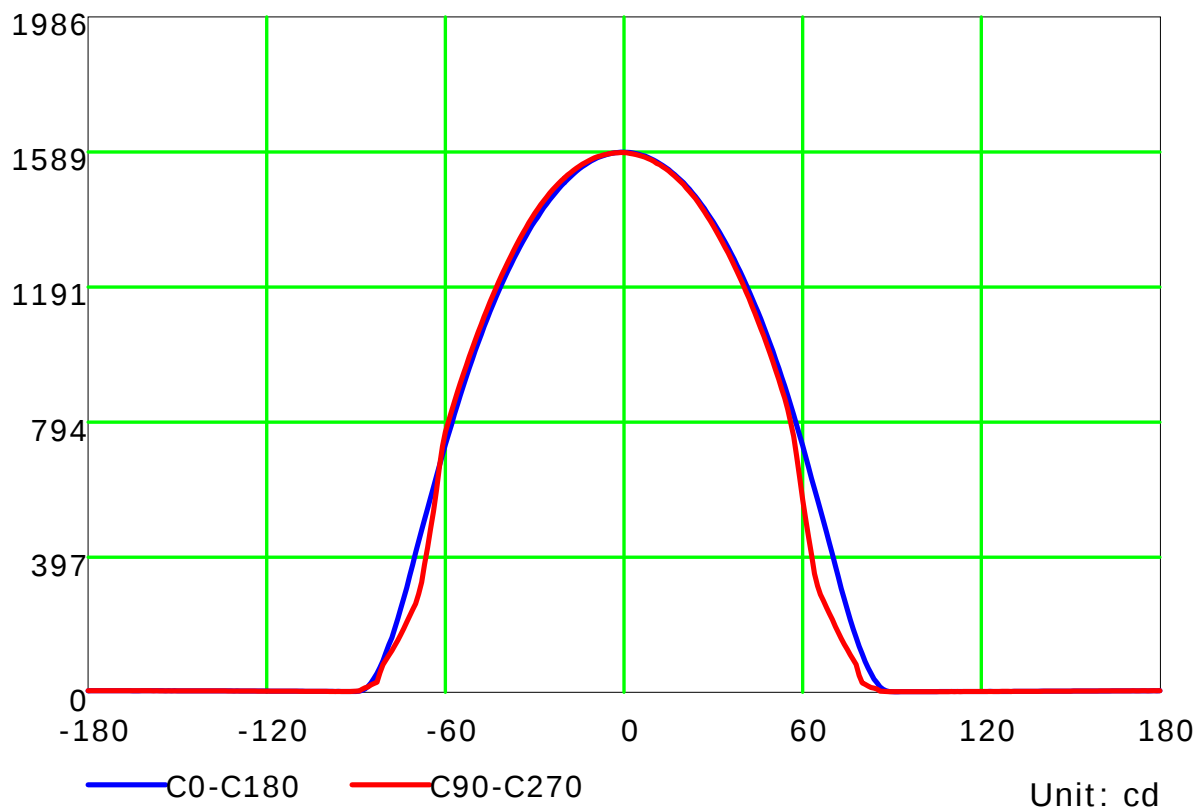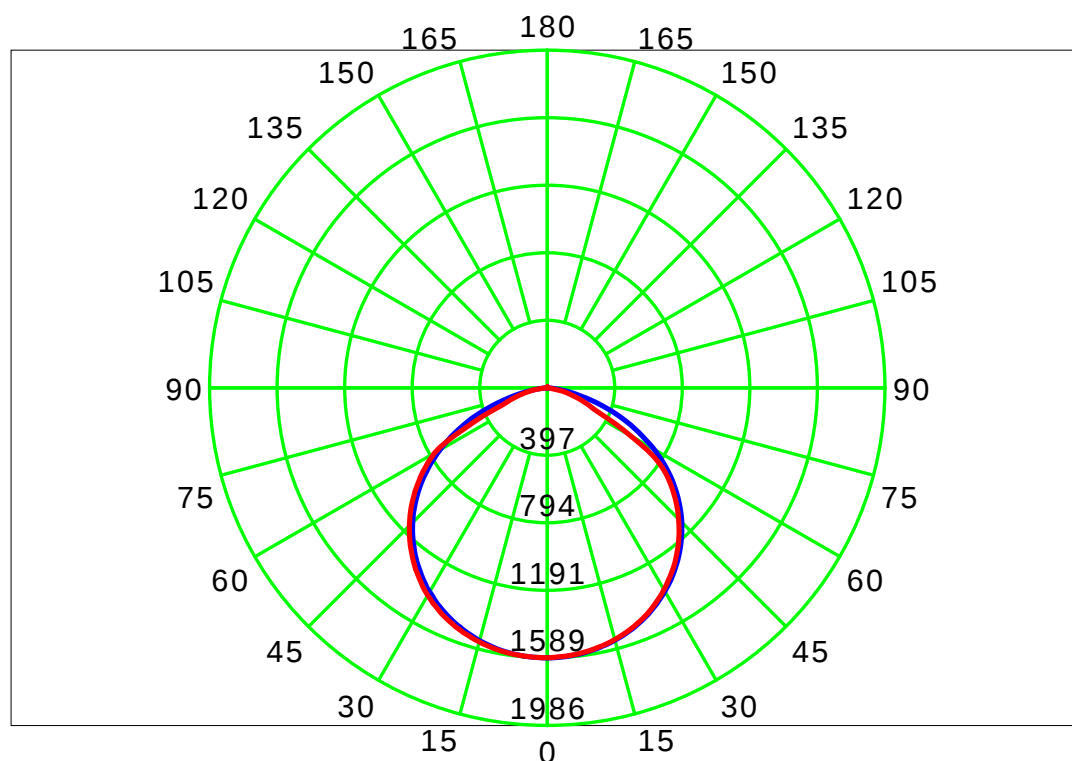

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Luminous Intensity Distribution Curve(cd / klm)

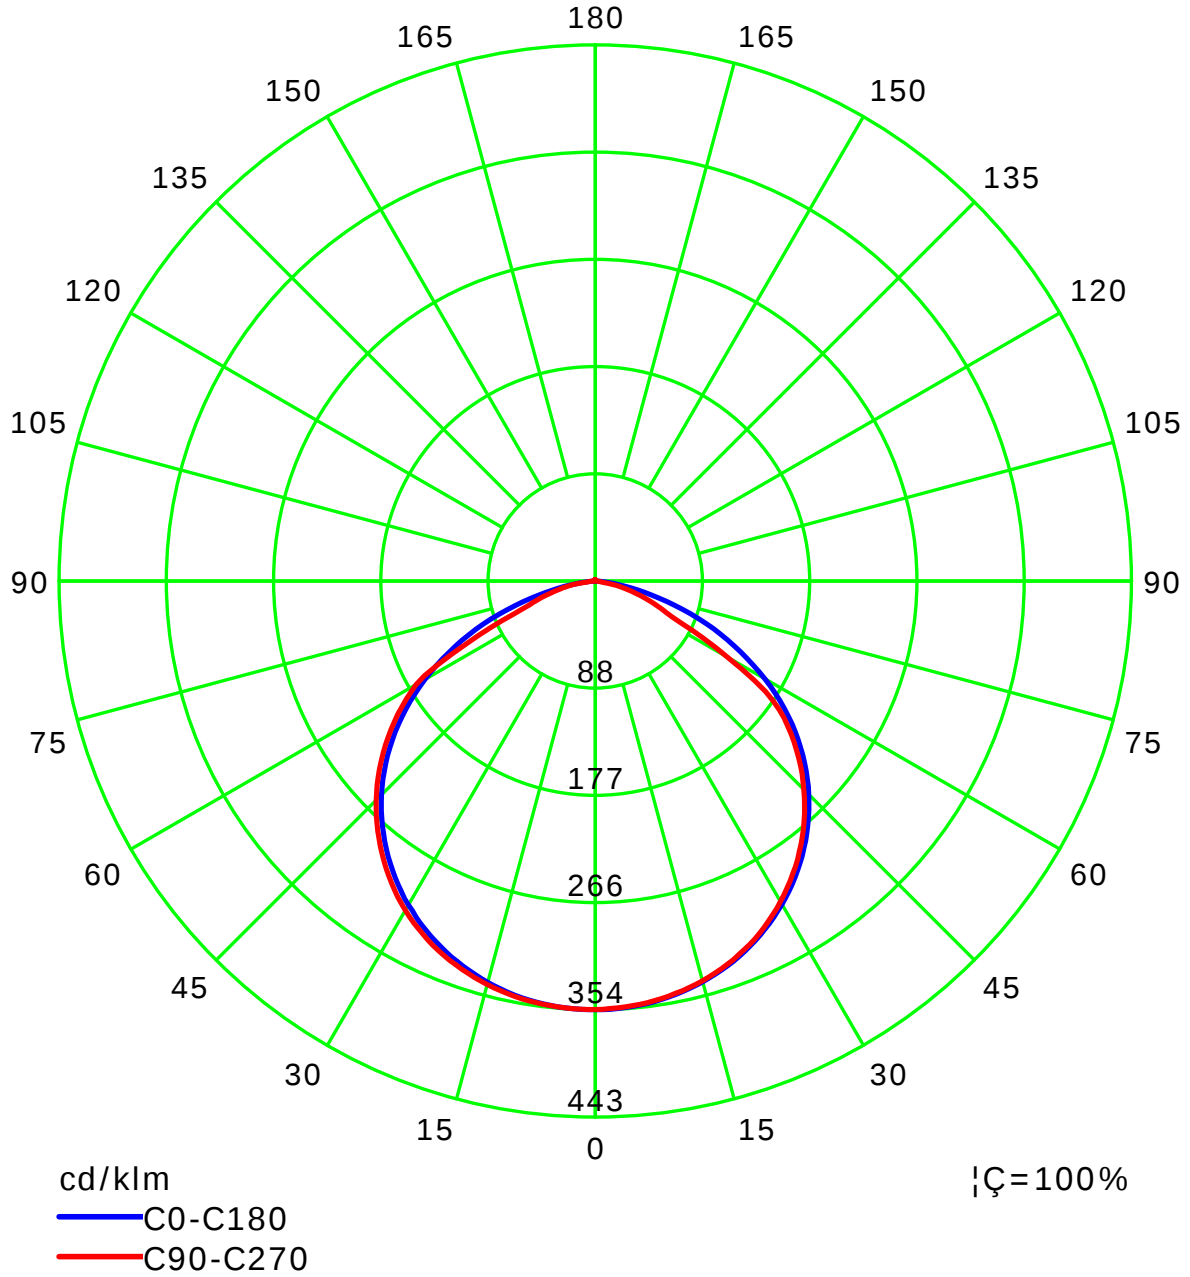

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1800B

Distance: 12.677 m



Humidity:

Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

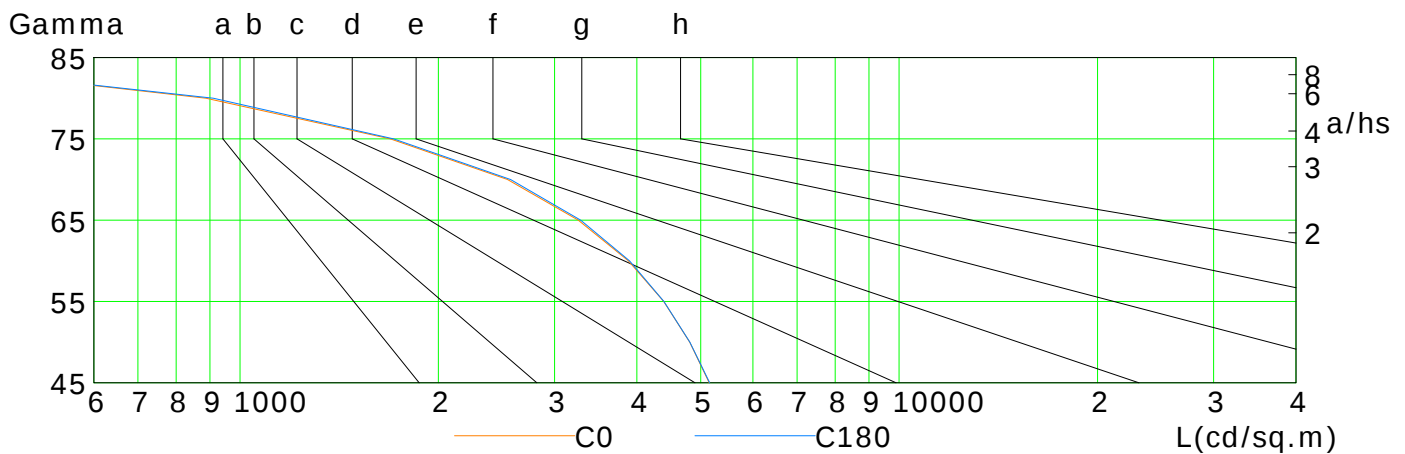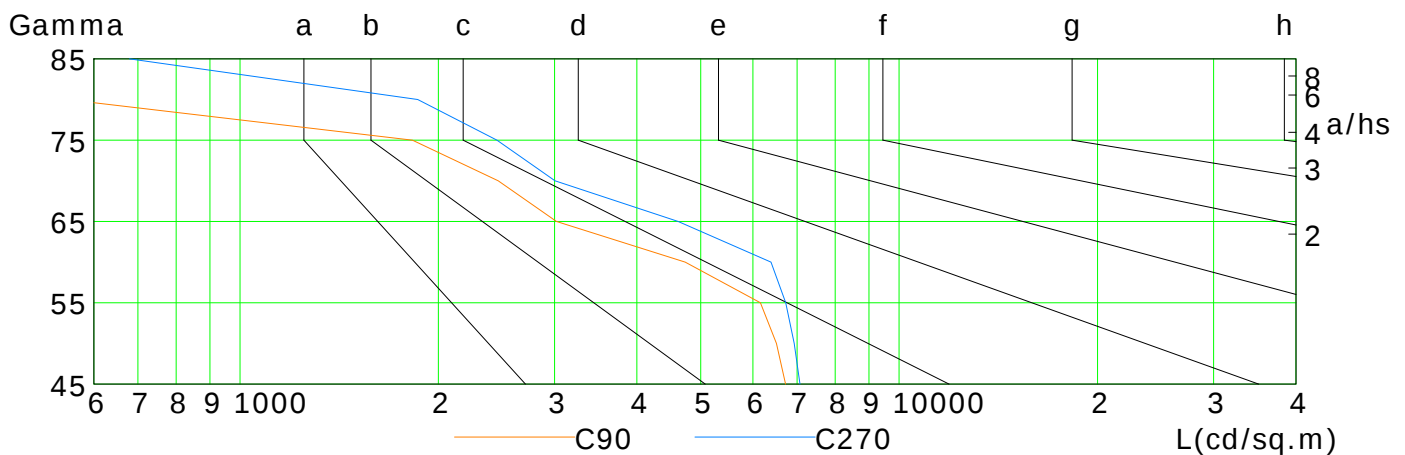

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	5149	4810	4395	3884	3259	2545	1691	888	253
C90	6723	6515	6159	4736	3020	2465	1826	547	297
C180	5159	4815	4397	3899	3288	2573	1710	911	250
C270	7071	6932	6729	6390	4622	3005	2454	1861	680

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Illuminance at a Distance

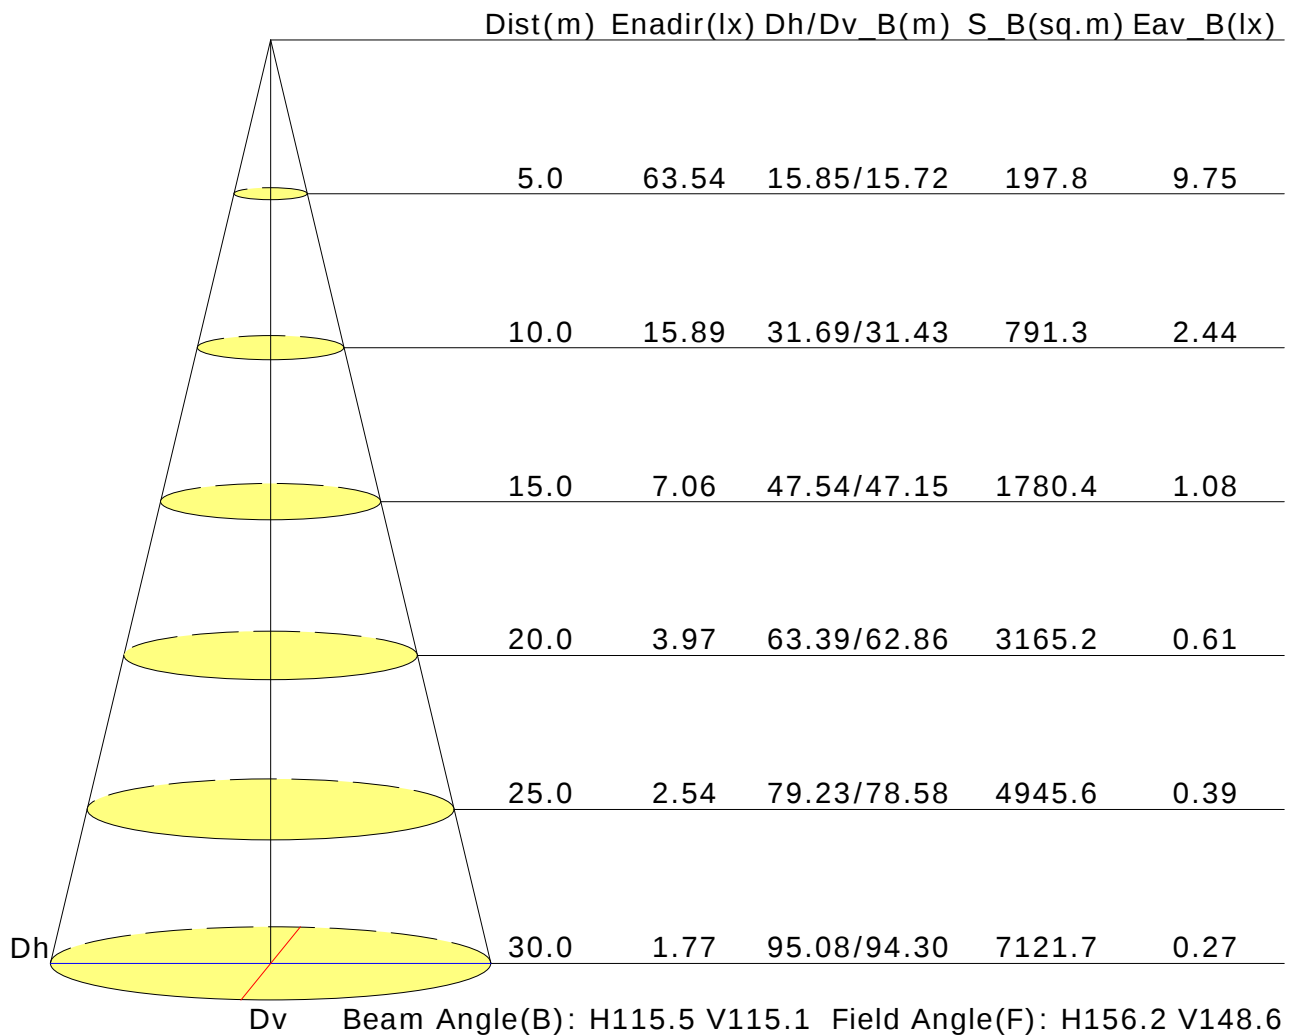

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	17.9	19.3	18.2	19.5	19.8	18.5	19.9	18.8	20.1	20.4
3H	19.0	20.2	19.3	20.5	20.8	19.1	20.3	19.4	20.6	20.9
4H	19.2	20.4	19.6	20.7	21.0	19.2	20.4	19.6	20.7	21.0
6H	19.3	20.4	19.7	20.7	21.0	19.3	20.3	19.6	20.7	21.0
8H	19.3	20.3	19.7	20.7	21.0	19.3	20.3	19.6	20.6	21.0
12H	19.3	20.3	19.7	20.6	20.9	19.2	20.2	19.6	20.6	20.9
X=4H Y=2H	18.5	19.6	18.8	19.9	20.2	18.9	20.1	19.3	20.4	20.7
3H	19.6	20.6	20.0	20.9	21.3	19.6	20.6	20.0	20.9	21.3
4H	20.0	20.8	20.4	21.2	21.6	19.8	20.7	20.2	21.0	21.4
6H	20.1	20.8	20.5	21.2	21.6	19.9	20.6	20.3	21.0	21.4
8H	20.1	20.8	20.5	21.2	21.6	19.9	20.6	20.3	21.0	21.4
12H	20.1	20.7	20.5	21.1	21.6	19.9	20.5	20.3	20.9	21.4
X=8H Y=4H	20.0	20.7	20.4	21.1	21.5	19.8	20.5	20.3	20.9	21.4
6H	20.1	20.7	20.6	21.1	21.6	20.0	20.5	20.4	21.0	21.4
8H	20.1	20.6	20.6	21.1	21.6	20.0	20.5	20.5	20.9	21.4
12H	20.1	20.6	20.6	21.0	21.5	19.9	20.4	20.5	20.9	21.4
X=12H Y=4H	19.9	20.6	20.4	21.0	21.5	19.8	20.4	20.3	20.9	21.3
6H	20.1	20.6	20.6	21.1	21.6	19.9	20.4	20.4	20.9	21.4
8H	20.1	20.6	20.6	21.0	21.5	20.0	20.4	20.5	20.9	21.4
Variations with the observer position at spacings:										
S=1.0H	+0.2/-0.3					+0.1/-0.2				
S=1.5H	+0.4/-0.7					+0.5/-0.8				
S=2.0H	+0.9/-1.6					+1.5/-2.9				

Calculate in accordance with CIE Pub.117. The table is revised with 4480lm ($8\log(F/F_0) = 5.2$).

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.58	0.69	0.76	0.82	0.89	0.94	0.97	1.02	1.04	
	0.30		0.50	0.61	0.69	0.75	0.83	0.89	0.93	0.98	1.01	
	0.20		0.44	0.55	0.64	0.70	0.78	0.84	0.89	0.94	0.98	
0.50	0.50	0.20	0.56	0.66	0.74	0.79	0.86	0.90	0.93	0.98	1.00	
	0.30		0.49	0.60	0.67	0.73	0.81	0.86	0.90	0.94	0.97	
	0.20		0.44	0.55	0.63	0.68	0.77	0.82	0.86	0.92	0.95	
0.30	0.50	0.20	0.55	0.65	0.71	0.76	0.83	0.87	0.90	0.94	0.96	
	0.30		0.48	0.59	0.66	0.71	0.79	0.84	0.87	0.91	0.94	
	0.20		0.44	0.54	0.62	0.67	0.75	0.80	0.84	0.89	0.92	
0.00	0.00	0.00	0.41	0.52	0.59	0.64	0.72	0.77	0.80	0.85	0.87	
Rating:36W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.98	0.80	0.67	0.58	0.46	0.38	0.32	0.25	0.20	
	0.30		0.82	0.68	0.59	0.51	0.41	0.35	0.30	0.23	0.19	
	0.20		0.70	0.60	0.52	0.46	0.38	0.32	0.28	0.22	0.18	
0.50	0.50	0.20	0.94	0.77	0.64	0.56	0.44	0.39	0.30	0.23	0.19	
	0.30		0.80	0.66	0.57	0.50	0.40	0.33	0.28	0.22	0.18	
	0.20		0.69	0.59	0.51	0.45	0.37	0.31	0.27	0.21	0.17	
0.30	0.50	0.20	0.92	0.74	0.62	0.53	0.42	0.34	0.29	0.22	0.18	
	0.30		0.78	0.65	0.55	0.48	0.38	0.32	0.27	0.21	0.17	
	0.20		0.69	0.58	0.50	0.44	0.36	0.30	0.26	0.20	0.17	
0.00	0.00	0.00	0.58	0.48	0.41	0.35	0.28	0.23	0.20	0.15	0.12	
Rating:36W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.17	0.18	0.19	0.19	0.20	0.21	0.21	0.22	0.22	
	0.30		0.10	0.11	0.13	0.14	0.16	0.17	0.18	0.19	0.20	
	0.20		0.05	0.07	0.08	0.10	0.12	0.13	0.15	0.16	0.17	
0.50	0.50	0.20	0.16	0.17	0.18	0.19	0.19	0.20	0.20	0.21	0.21	
	0.30		0.10	0.11	0.13	0.14	0.15	0.16	0.17	0.18	0.19	
	0.20		0.05	0.07	0.08	0.10	0.11	0.13	0.14	0.16	0.17	
0.30	0.50	0.20	0.16	0.17	0.17	0.18	0.19	0.19	0.19	0.20	0.20	
	0.30		0.10	0.11	0.12	0.13	0.15	0.16	0.16	0.18	0.18	
	0.20		0.05	0.07	0.08	0.09	0.11	0.13	0.14	0.15	0.16	
0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
Rating:36W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												