

Report No.:

Test Time: 12.03.2020 16:03

Luminaire Property

Luminaire Manufacturer:

Luminaire Description: FG 180 4x24LED 0,3A 32W 4000K закаленное стекло матовое IP65 N

Number of Lamps: 1

Luminous Length (mm): 1200

Luminous Width (mm): 180

Luminous Height (mm): 76

Voltage: 230.1 V

Current: 0.146 A

Power: 32.45 W

Power Factor: 0.966

Photometric Results

CIE Class: Direct

Total Rated Lamp Lumens: 3727.1 lm

Measurement Flux: 3727.1 lm

Efficiency: 100%

Downward Ratio: 100%

Upward Ratio: 0%

Field Angle(C0/C180,C90/C270,C45/C225,C135/315): 151.9, 143.4, 147.0, 147.0

Beam Angle(C0/C180,C90/C270,C45/C225,C135/315): 100.0, 95.1, 98.0, 98.0

Luminaire Efficacy Rating (LER): 114.91

Central Intensity: 1580.32 cd

Max. Intensity: 1581.27 cd

Pos of Max. Intensity: H22.5 V0


S/MH(C0/C180): 1.25

S/MH(C90/C270): 1.24

Picture Of Luminaire



Luminous Intensity Distribution Curve

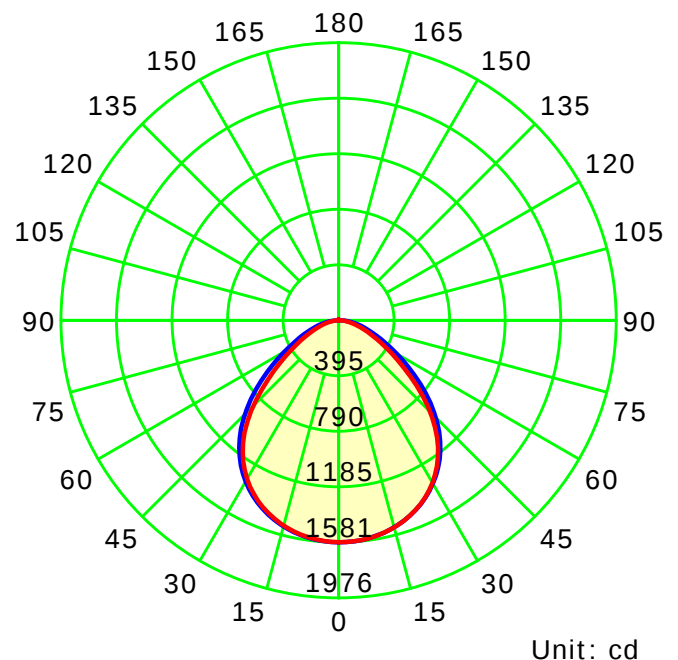

— C0-C180 — C90-C270

C Plane (°):0.0-360.0: 22.5

Gamma Plane (°):0.0-180.0:2.0

Test Lab:

Test Device: LSG-1800B

Test Type: TYPE C

Distance: 12.677 m



Temperature:

Humidity:

Operator:

Inspector:

Luminous Intensity Distribution Curve

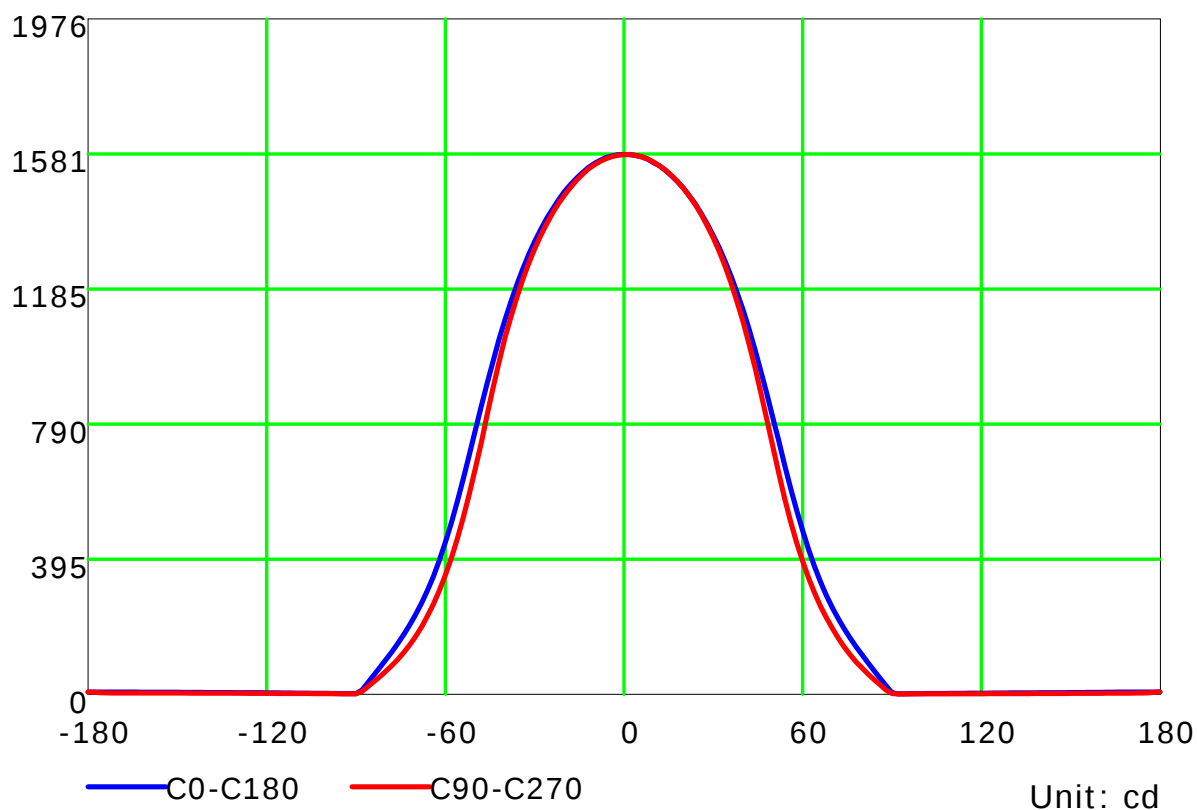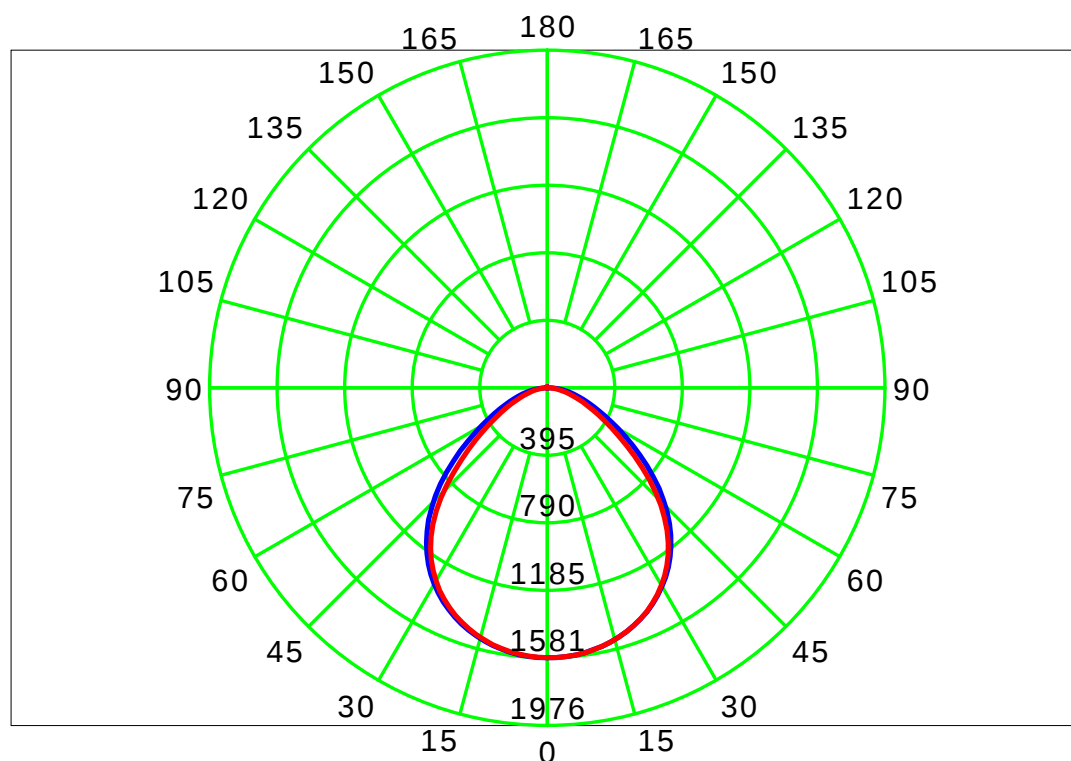

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0


Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Luminous Intensity Distribution Curve(cd / klm)

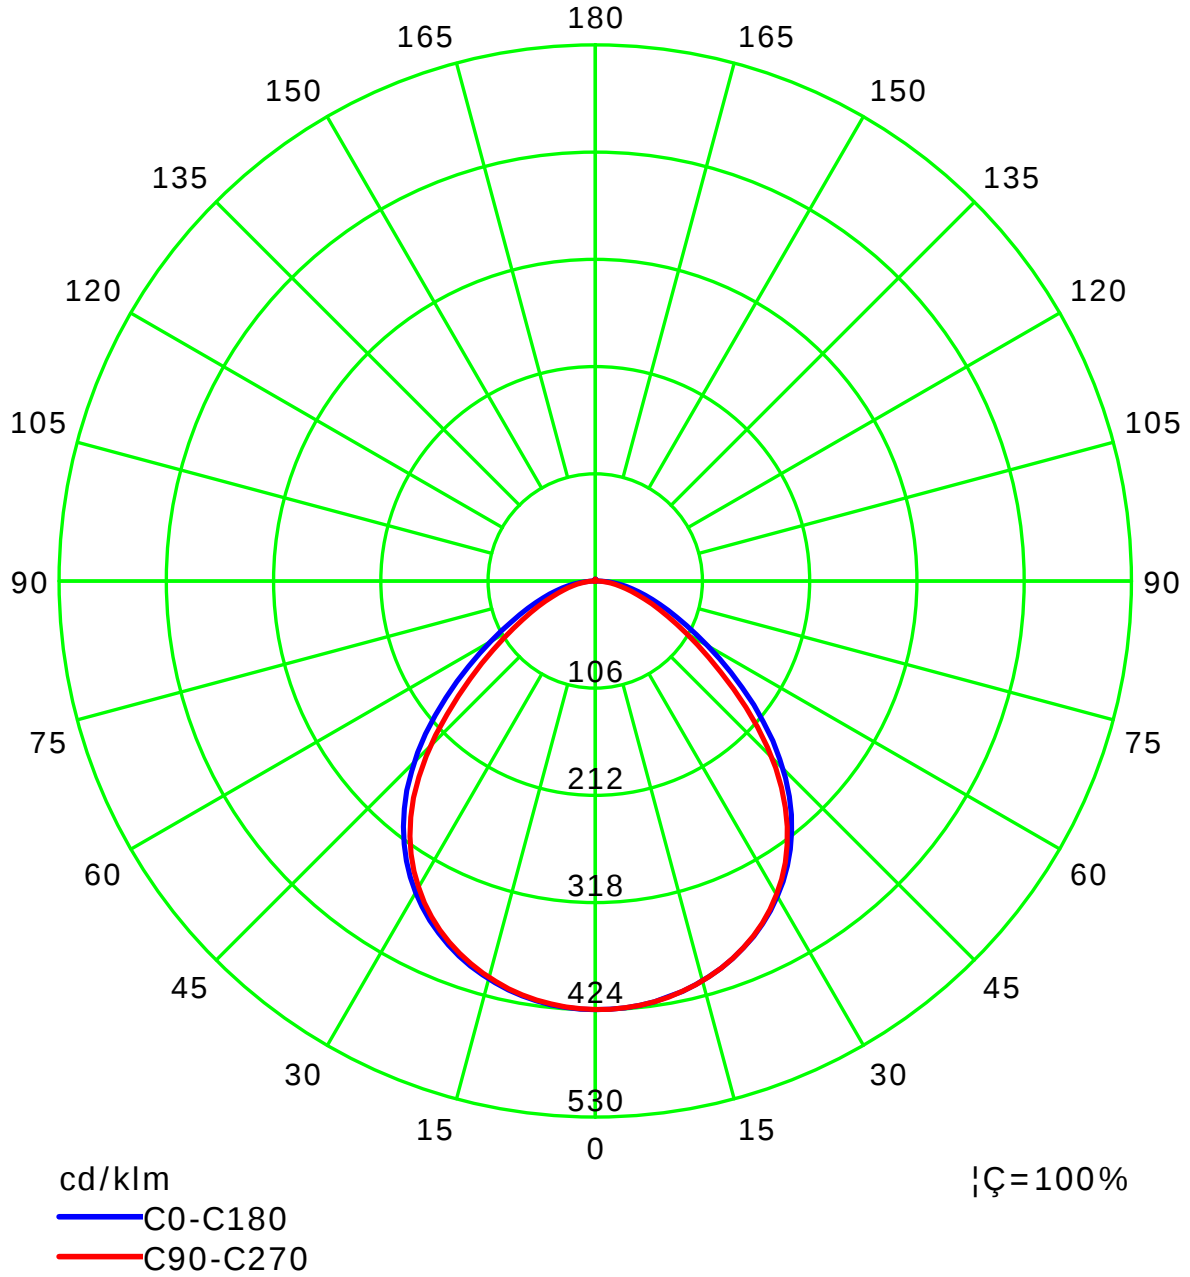

C Plane (°): 0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°): 0.0-180.0: 2.0

Test Device: LSG-1800B

Distance: 12.677 m



Humidity:

Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

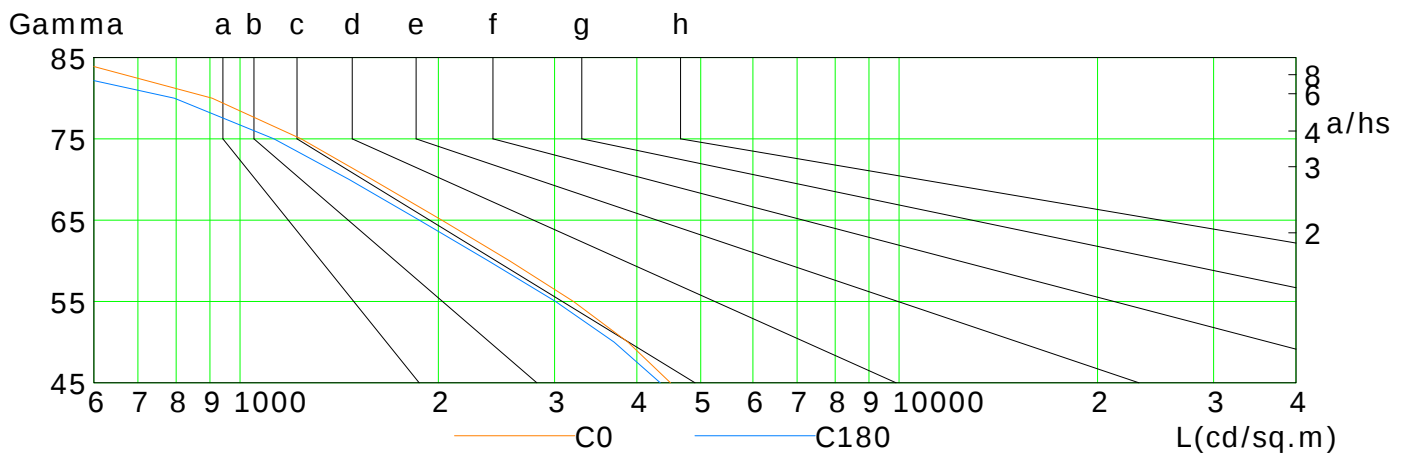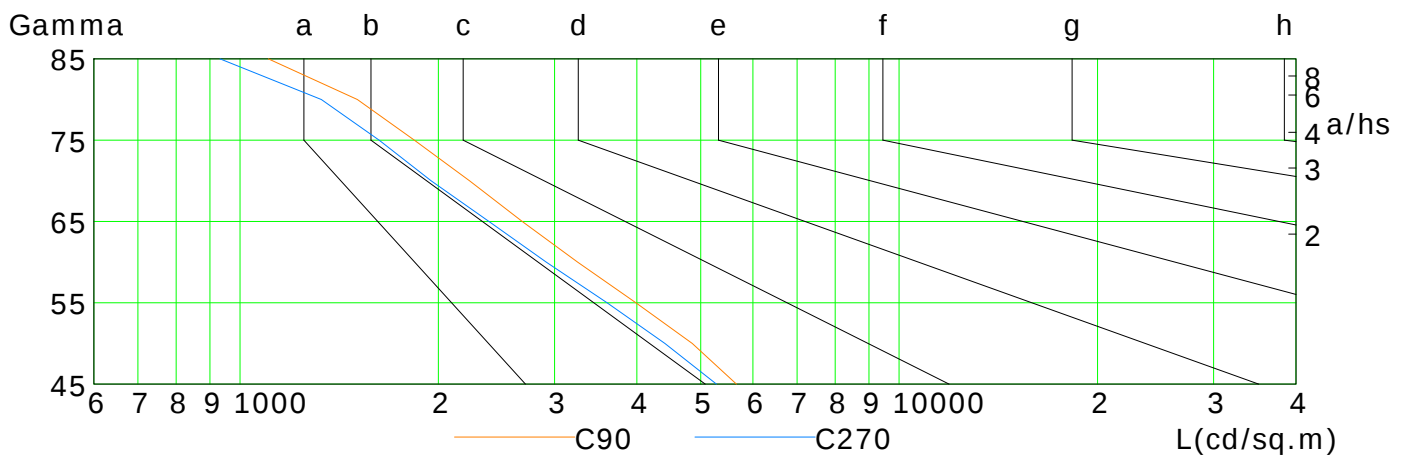

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	4499	3877	3205	2565	2024	1587	1238	907	535
C90	5664	4854	3987	3253	2680	2229	1838	1507	1104
C180	4339	3694	3011	2380	1871	1465	1126	795	417
C270	5282	4412	3605	2915	2386	1950	1626	1328	933

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0


Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Illuminance at a Distance

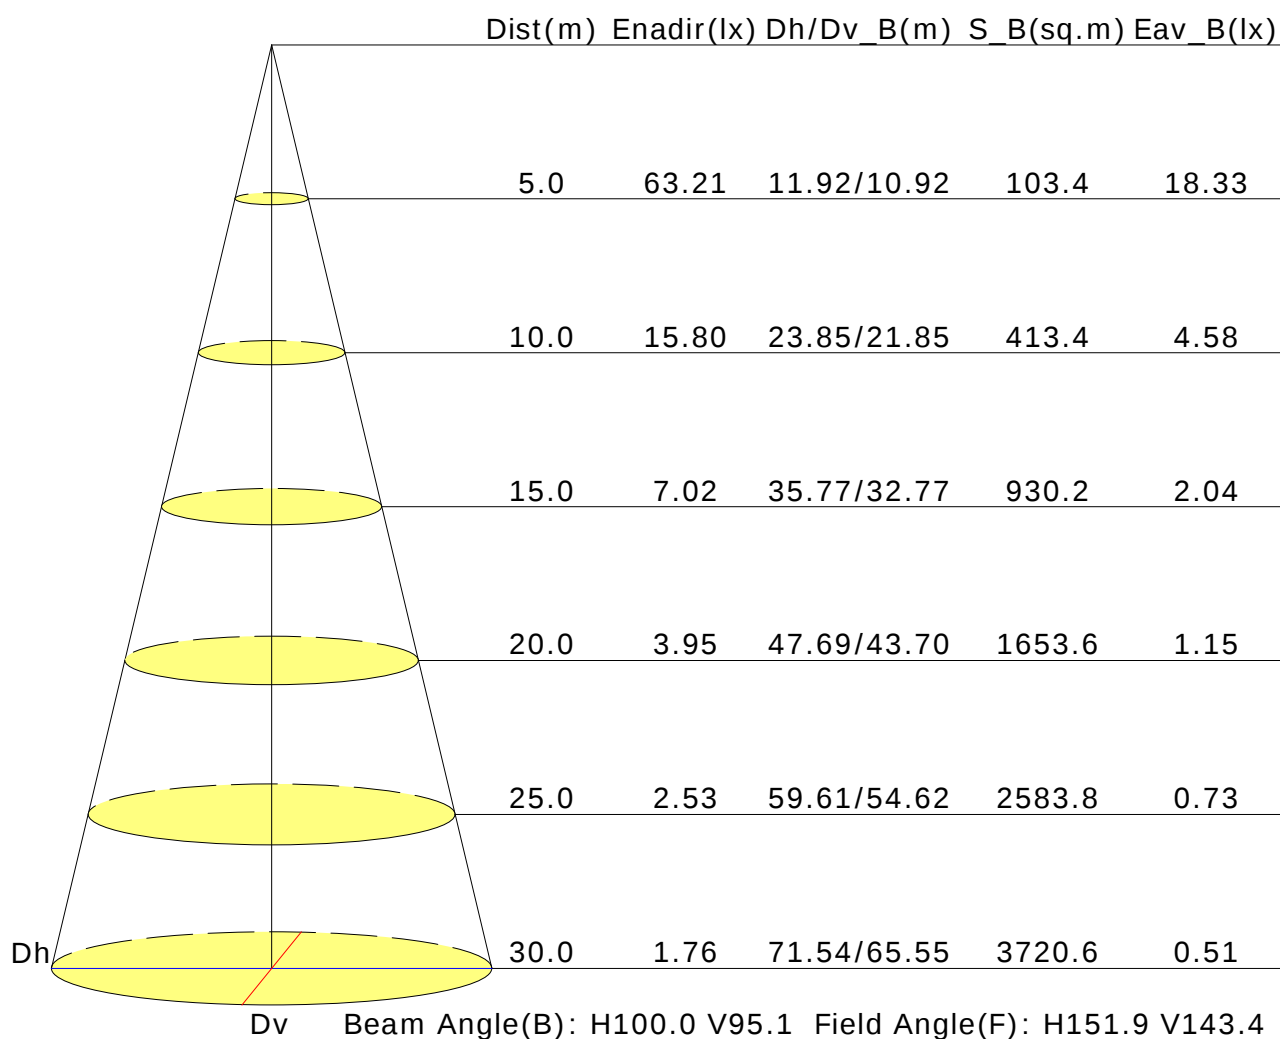

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	16.5	17.7	16.8	18.0	18.2	16.4	17.6	16.7	17.9	18.1
3H	17.2	18.3	17.5	18.6	18.9	17.0	18.2	17.3	18.4	18.7
4H	17.4	18.5	17.8	18.8	19.1	17.2	18.3	17.6	18.6	18.9
6H	17.6	18.6	18.0	18.9	19.2	17.4	18.4	17.8	18.7	19.0
8H	17.6	18.6	18.0	18.9	19.3	17.4	18.4	17.8	18.7	19.1
12H	17.7	18.6	18.0	18.9	19.3	17.5	18.4	17.8	18.7	19.1
X=4H Y=2H	16.7	17.8	17.1	18.1	18.4	16.6	17.7	17.0	18.0	18.3
3H	17.6	18.5	18.0	18.9	19.2	17.4	18.4	17.8	18.7	19.0
4H	18.0	18.8	18.4	19.2	19.5	17.7	18.6	18.2	18.9	19.3
6H	18.2	19.0	18.7	19.3	19.8	18.0	18.7	18.4	19.1	19.5
8H	18.3	19.0	18.7	19.4	19.8	18.1	18.7	18.5	19.1	19.6
12H	18.3	18.9	18.8	19.4	19.8	18.1	18.7	18.6	19.1	19.6
X=8H Y=4H	18.0	18.7	18.5	19.1	19.5	17.8	18.5	18.3	18.9	19.3
6H	18.4	18.9	18.8	19.4	19.8	18.1	18.7	18.6	19.1	19.6
8H	18.5	19.0	19.0	19.4	19.9	18.2	18.7	18.7	19.2	19.7
12H	18.6	19.0	19.1	19.5	20.0	18.3	18.7	18.8	19.2	19.7
X=12H Y=4H	18.0	18.6	18.5	19.0	19.5	17.8	18.4	18.3	18.8	19.3
6H	18.4	18.8	18.9	19.3	19.8	18.1	18.6	18.6	19.1	19.6
8H	18.5	18.9	19.0	19.4	19.9	18.3	18.7	18.8	19.2	19.7
Variations with the observer position at spacings:										
S=1.0H	+0.3/-0.4					+0.4/-0.6				
S=1.5H	+0.6/-1.2					+0.7/-1.3				
S=2.0H	+1.4/-1.9					+1.7/-2.0				

Calculate in accordance with CIE Pub.117. The table is revised with 3727lm ($8\log(F/F_0) = 4.6$).

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0

Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.63	0.73	0.80	0.85	0.91	0.96	0.99	1.03	1.05	
	0.30		0.56	0.66	0.73	0.78	0.86	0.91	0.94	0.99	1.02	
	0.20		0.50	0.61	0.68	0.74	0.81	0.87	0.91	0.96	0.99	
0.50	0.50	0.20	0.61	0.71	0.77	0.82	0.88	0.92	0.95	0.99	1.01	
	0.30		0.55	0.65	0.72	0.77	0.84	0.88	0.91	0.96	0.98	
	0.20		0.50	0.60	0.67	0.72	0.80	0.85	0.88	0.93	0.96	
0.30	0.50	0.20	0.60	0.69	0.75	0.79	0.85	0.89	0.92	0.95	0.97	
	0.30		0.54	0.64	0.70	0.75	0.81	0.86	0.89	0.93	0.95	
	0.20		0.50	0.59	0.66	0.71	0.78	0.83	0.86	0.90	0.93	
0.00	0.00	0.00	0.48	0.57	0.64	0.68	0.75	0.79	0.82	0.86	0.88	
Rating:32W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.91	0.74	0.62	0.54	0.42	0.35	0.30	0.23	0.19	
	0.30		0.76	0.63	0.54	0.47	0.38	0.32	0.28	0.22	0.18	
	0.20		0.65	0.55	0.48	0.43	0.35	0.30	0.26	0.20	0.17	
0.50	0.50	0.20	0.87	0.70	0.59	0.51	0.40	0.37	0.28	0.22	0.18	
	0.30		0.74	0.61	0.52	0.46	0.37	0.31	0.26	0.21	0.17	
	0.20		0.64	0.54	0.47	0.41	0.34	0.29	0.25	0.20	0.16	
0.30	0.50	0.20	0.84	0.67	0.57	0.49	0.38	0.32	0.27	0.21	0.17	
	0.30		0.72	0.59	0.51	0.44	0.35	0.30	0.25	0.20	0.16	
	0.20		0.63	0.53	0.46	0.40	0.33	0.28	0.24	0.19	0.16	
0.00	0.00	0.00	0.52	0.43	0.36	0.31	0.25	0.21	0.18	0.14	0.11	
Rating:32W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.16	0.17	0.18	0.19	0.20	0.20	0.21	0.22	0.22	
	0.30		0.10	0.11	0.13	0.14	0.16	0.17	0.18	0.19	0.20	
	0.20		0.05	0.07	0.09	0.10	0.12	0.14	0.15	0.16	0.18	
0.50	0.50	0.20	0.15	0.17	0.17	0.18	0.19	0.20	0.20	0.21	0.21	
	0.30		0.10	0.11	0.12	0.14	0.15	0.16	0.17	0.18	0.19	
	0.20		0.05	0.07	0.09	0.10	0.12	0.13	0.14	0.16	0.17	
0.30	0.50	0.20	0.15	0.16	0.17	0.17	0.18	0.19	0.19	0.20	0.20	
	0.30		0.09	0.11	0.12	0.13	0.15	0.16	0.17	0.18	0.18	
	0.20		0.05	0.07	0.08	0.10	0.12	0.13	0.14	0.16	0.17	
0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
Rating:32W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												