

Report No.:

Test Time: 12.03.2020 16:03

Luminaire Property

Luminaire Manufacturer:

Luminaire Description: FG 180 4x40LED 0,3A 38W 4000K закаленное стекло матовое IP65 N

Number of Lamps: 1

Luminous Length (mm): 1200

Luminous Width (mm): 180

Luminous Height (mm): 76

Voltage: 230.2 V

Current: 0.172 A

Power: 38.38 W

Power Factor: 0.967

Photometric Results

CIE Class: Direct

Total Rated Lamp Lumens: 4431.1 lm

Measurement Flux: 4431.1 lm

Efficiency: 100%

Downward Ratio: 100%

Upward Ratio: 0%

Field Angle(C0/C180,C90/C270,C45/C225,C135/315): 151.9, 143.4, 147.0, 147.0

Beam Angle(C0/C180,C90/C270,C45/C225,C135/315): 100.0, 95.1, 98.0, 98.0

Luminaire Efficacy Rating (LER): 115.50

Central Intensity: 1878.82 cd


Max. Intensity: 1879.95 cd

Pos of Max. Intensity: H22.5 V0


S/MH(C0/C180): 1.25

S/MH(C90/C270): 1.24

Picture Of Luminaire



Luminous Intensity Distribution Curve

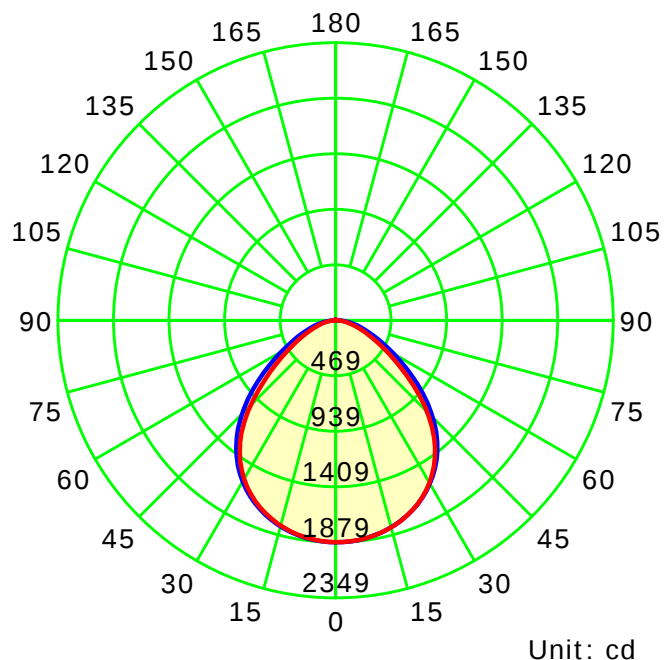

— C0-C180 — C90-C270

C Plane (°):0.0-360.0: 22.5

Gamma Plane (°):0.0-180.0:2.0

Test Lab:

Test Device: LSG-1800B

Test Type: TYPE C

Distance: 12.677 m



Temperature:

Humidity:

Operator:

Inspector:

Luminous Intensity Distribution Curve

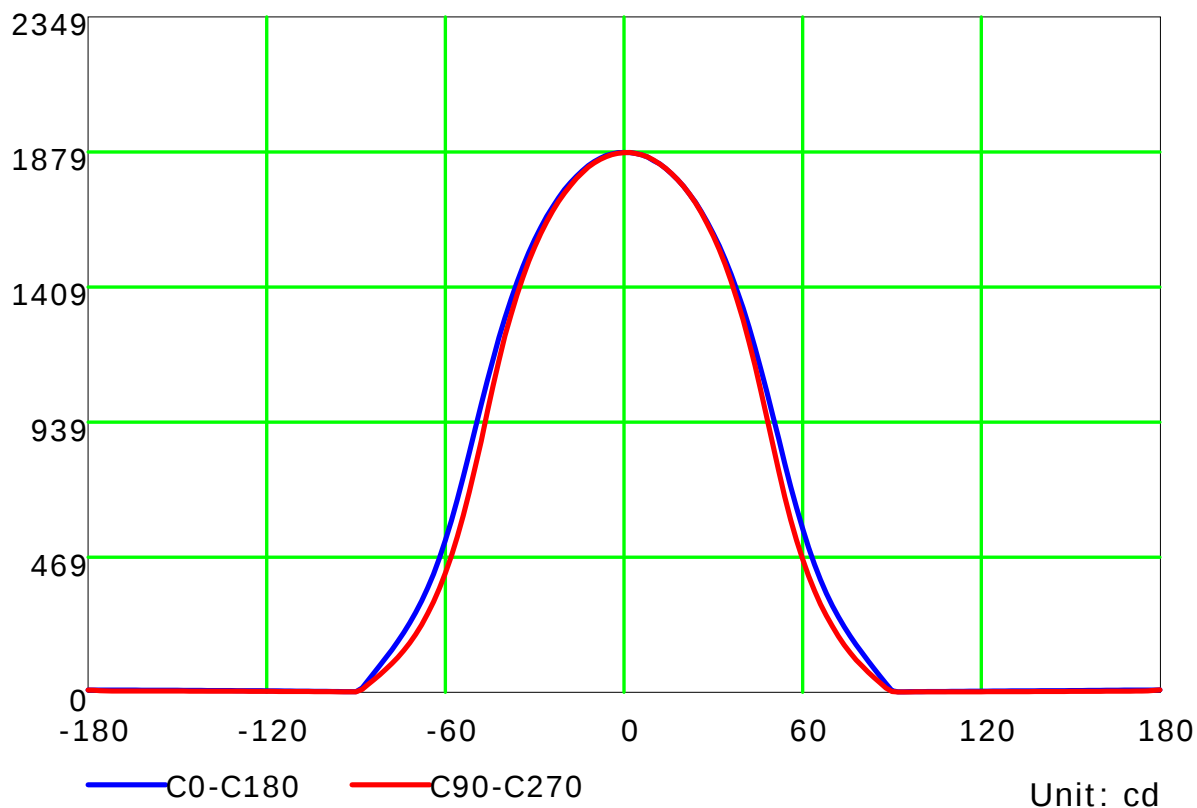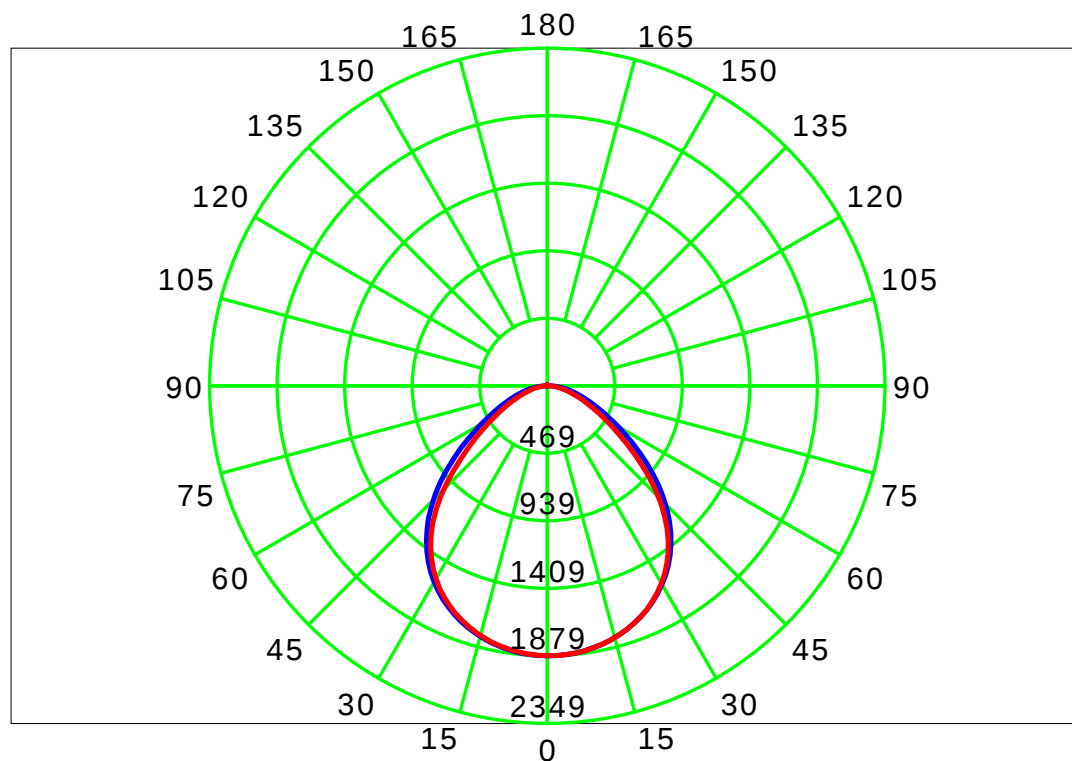

C Plane (°): 0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°): 0.0-180.0: 2.0


Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:



Luminous Intensity Distribution Curve(cd / klm)

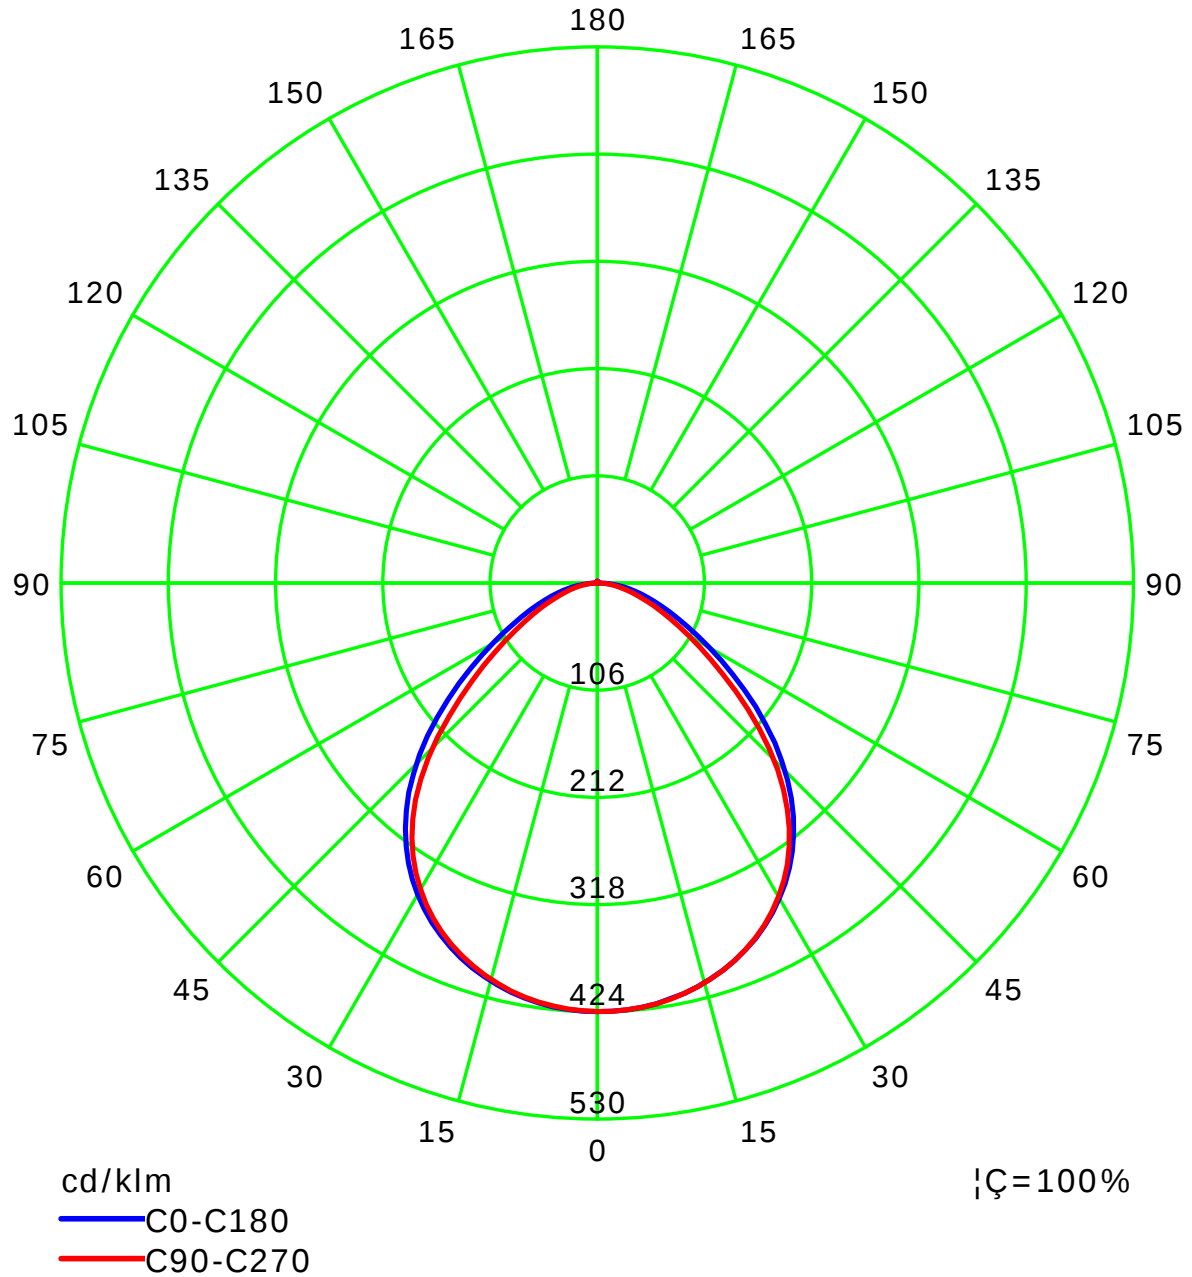

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

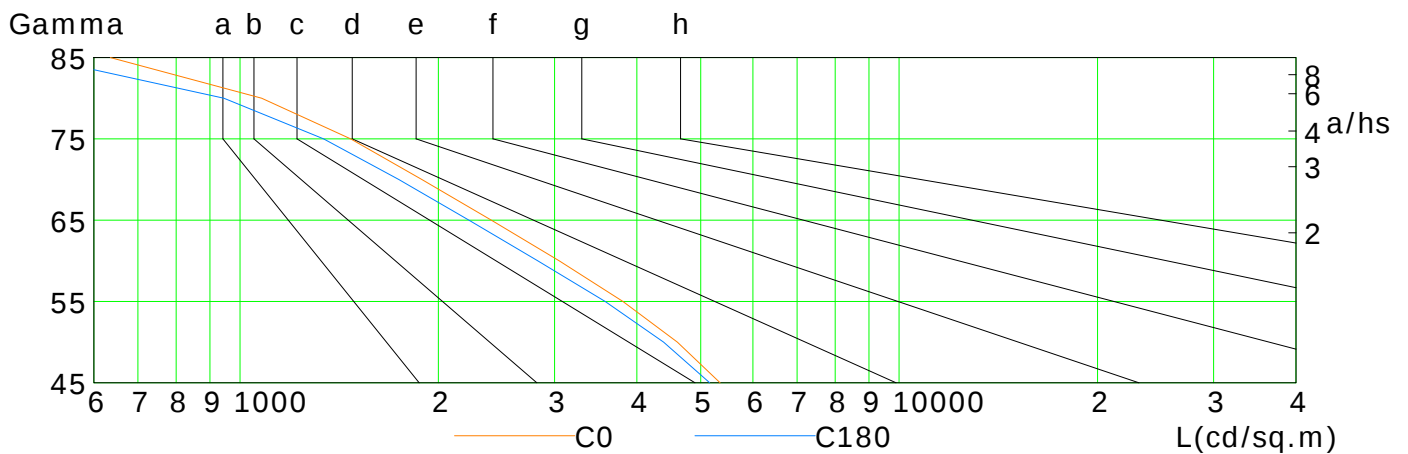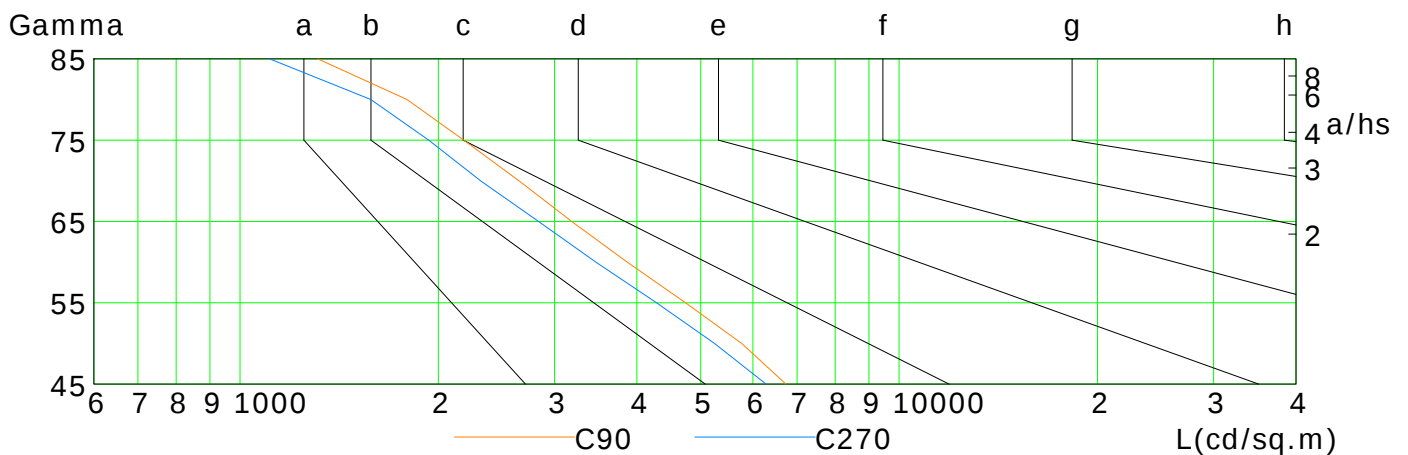

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	5349	4609	3810	3049	2406	1887	1472	1079	636
C90	6734	5771	4740	3867	3186	2650	2185	1792	1312
C180	5159	4391	3580	2830	2225	1741	1339	945	496
C270	6280	5245	4286	3466	2837	2318	1933	1579	1109

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0


Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Illuminance at a Distance

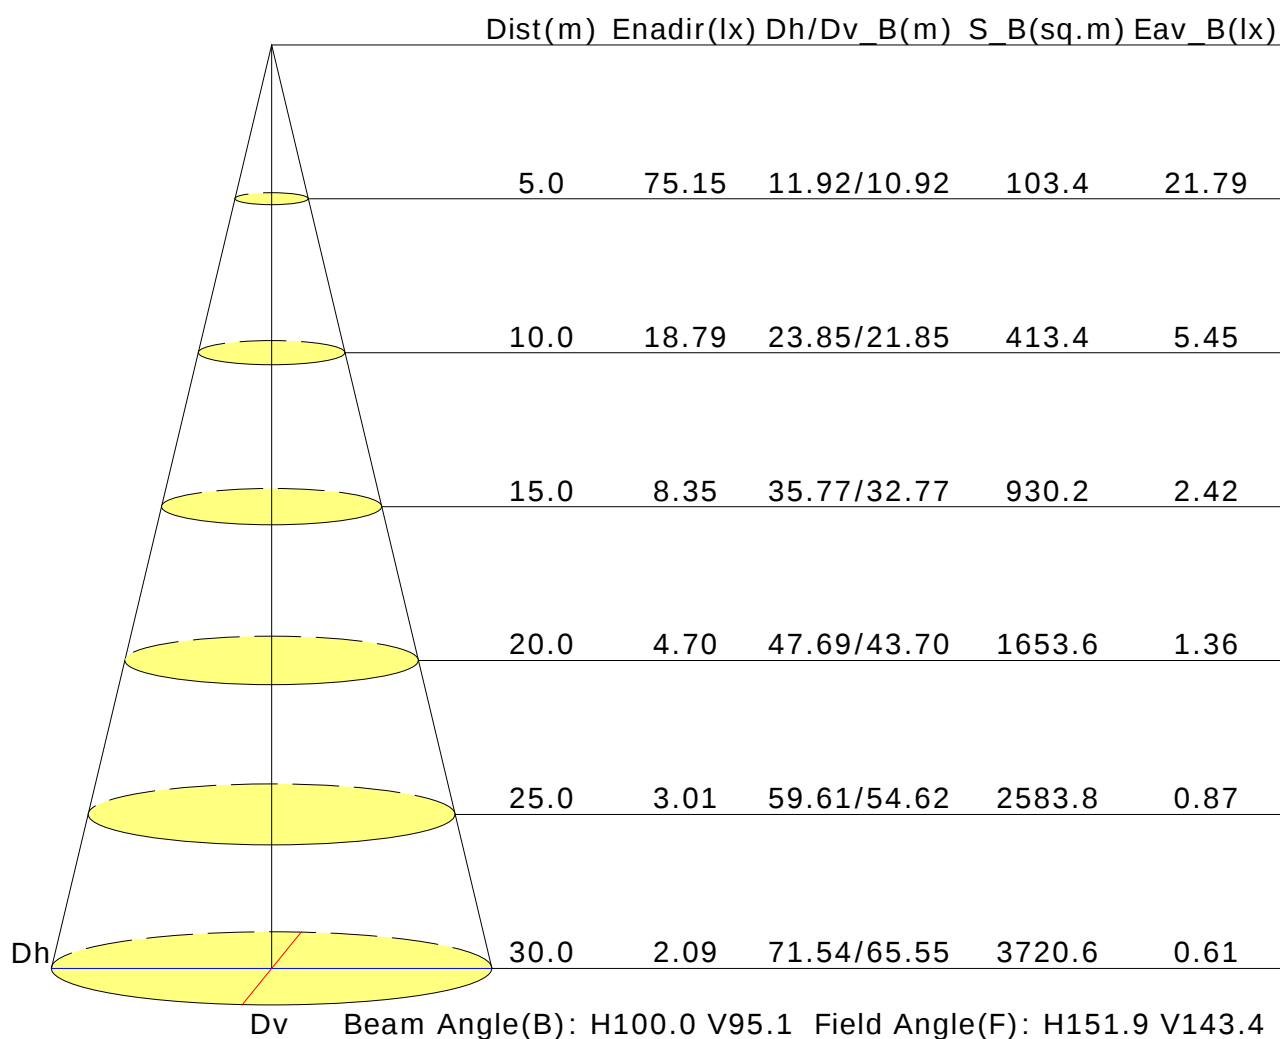

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	17.1	18.3	17.4	18.6	18.8	17.0	18.2	17.3	18.5	18.7
3H	17.8	18.9	18.1	19.2	19.5	17.6	18.8	17.9	19.0	19.3
4H	18.0	19.1	18.4	19.4	19.7	17.8	18.9	18.2	19.2	19.5
6H	18.2	19.2	18.6	19.5	19.9	18.0	19.0	18.4	19.3	19.6
8H	18.3	19.2	18.6	19.5	19.9	18.0	19.0	18.4	19.3	19.7
12H	18.3	19.2	18.6	19.5	19.9	18.1	19.0	18.4	19.3	19.7
X=4H Y=2H	17.3	18.4	17.7	18.7	19.0	17.2	18.3	17.6	18.6	18.9
3H	18.2	19.1	18.6	19.5	19.8	18.0	19.0	18.4	19.3	19.6
4H	18.6	19.4	19.0	19.8	20.1	18.3	19.2	18.8	19.5	19.9
6H	18.8	19.6	19.3	19.9	20.4	18.6	19.3	19.0	19.7	20.1
8H	18.9	19.6	19.3	20.0	20.4	18.7	19.3	19.1	19.7	20.2
12H	18.9	19.5	19.4	20.0	20.4	18.7	19.3	19.2	19.7	20.2
X=8H Y=4H	18.6	19.3	19.1	19.7	20.1	18.4	19.1	18.9	19.5	19.9
6H	19.0	19.5	19.4	20.0	20.4	18.7	19.3	19.2	19.7	20.2
8H	19.1	19.6	19.6	20.0	20.5	18.8	19.3	19.3	19.8	20.3
12H	19.2	19.6	19.7	20.1	20.6	18.9	19.3	19.4	19.8	20.3
X=12H Y=4H	18.6	19.2	19.1	19.6	20.1	18.4	19.0	18.9	19.4	19.9
6H	19.0	19.4	19.5	19.9	20.4	18.7	19.2	19.2	19.7	20.2
8H	19.1	19.5	19.6	20.0	20.5	18.9	19.3	19.4	19.8	20.3
Variations with the observer position at spacings:										
S=1.0H	+0.3/-0.4					+0.4/-0.6				
S=1.5H	+0.6/-1.2					+0.7/-1.3				
S=2.0H	+1.4/-1.9					+1.7/-2.0				

Calculate in accordance with CIE Pub.117. The table is revised with 4431lm ($8\log(F/F_0) = 5.2$).

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0

Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.63	0.73	0.80	0.85	0.91	0.96	0.99	1.03	1.05	
	0.30		0.56	0.66	0.73	0.78	0.86	0.91	0.94	0.99	1.02	
	0.20		0.50	0.61	0.68	0.74	0.81	0.87	0.91	0.96	0.99	
0.50	0.50	0.20	0.61	0.71	0.77	0.82	0.88	0.92	0.95	0.99	1.01	
	0.30		0.55	0.65	0.72	0.77	0.84	0.88	0.91	0.96	0.98	
	0.20		0.50	0.60	0.67	0.72	0.80	0.85	0.88	0.93	0.96	
0.30	0.50	0.20	0.60	0.69	0.75	0.79	0.85	0.89	0.92	0.95	0.97	
	0.30		0.54	0.64	0.70	0.75	0.81	0.86	0.89	0.93	0.95	
	0.20		0.50	0.59	0.66	0.71	0.78	0.83	0.86	0.90	0.93	
0.00	0.00	0.00	0.48	0.57	0.64	0.68	0.75	0.79	0.82	0.86	0.88	
Rating:38W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.91	0.74	0.62	0.54	0.42	0.35	0.30	0.23	0.19	
	0.30		0.76	0.63	0.54	0.47	0.38	0.32	0.28	0.22	0.18	
	0.20		0.65	0.55	0.48	0.43	0.35	0.30	0.26	0.20	0.17	
0.50	0.50	0.20	0.87	0.70	0.59	0.51	0.40	0.37	0.28	0.22	0.18	
	0.30		0.74	0.61	0.52	0.46	0.37	0.31	0.26	0.21	0.17	
	0.20		0.64	0.54	0.47	0.41	0.34	0.29	0.25	0.20	0.16	
0.30	0.50	0.20	0.84	0.67	0.57	0.49	0.38	0.32	0.27	0.21	0.17	
	0.30		0.72	0.59	0.51	0.44	0.35	0.30	0.25	0.20	0.16	
	0.20		0.63	0.53	0.46	0.40	0.33	0.28	0.24	0.19	0.16	
0.00	0.00	0.00	0.52	0.43	0.36	0.31	0.25	0.21	0.18	0.14	0.11	
Rating:38W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.16	0.17	0.18	0.19	0.20	0.20	0.21	0.22	0.22	
	0.30		0.10	0.11	0.13	0.14	0.16	0.17	0.18	0.19	0.20	
	0.20		0.05	0.07	0.09	0.10	0.12	0.14	0.15	0.16	0.18	
0.50	0.50	0.20	0.15	0.17	0.17	0.18	0.19	0.20	0.20	0.21	0.21	
	0.30		0.10	0.11	0.12	0.14	0.15	0.16	0.17	0.18	0.19	
	0.20		0.05	0.07	0.09	0.10	0.12	0.13	0.14	0.16	0.17	
0.30	0.50	0.20	0.15	0.16	0.17	0.17	0.18	0.19	0.19	0.20	0.20	
	0.30		0.09	0.11	0.12	0.13	0.15	0.16	0.17	0.18	0.18	
	0.20		0.05	0.07	0.08	0.10	0.12	0.13	0.14	0.16	0.17	
0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
Rating:38W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												