



OOO "FAROS"

www.farosled.ru

Tel: +7 (8422) 583-386, 583-387

E-mail: info@farosled.ru

Page 1 of 9 Pages

Report No.:

Test Time: 18.12.2019 13:22

Luminaire Property

Luminaire Manufacturer:

Luminaire Description: FG 180 4x40LED 0,3A 38W 4000K закаленное стекло IP65 N

Number of Lamps: 1

Luminous Length (mm): 1200

Luminous Width (mm): 180

Luminous Height (mm): 76

Voltage: 221.4 V

Current: 0.179 A

Power: 38.52 W

Power Factor: 0.972

Photometric Results

CIE Class: Direct

Total Rated Lamp Lumens: 5074.4 lm

Measurement Flux: 5074.4 lm

Efficiency: 100%

Downward Ratio: 100%

Upward Ratio: 0%

Field Angle(C0/C180,C90/C270,C45/C225,C135/315): 156.2, 148.6, 149.2, 149.1

Beam Angle(C0/C180,C90/C270,C45/C225,C135/315): 115.5, 115.1, 115.4, 115.4

Luminaire Efficacy Rating (LER): 131.79

Central Intensity: 1799.19 cd


Max. Intensity: 1799.94 cd

Pos of Max. Intensity: H22.5 V0


S/MH(C0/C180): 1.29

S/MH(C90/C270): 1.30

Picture Of Luminaire



Luminous Intensity Distribution Curve

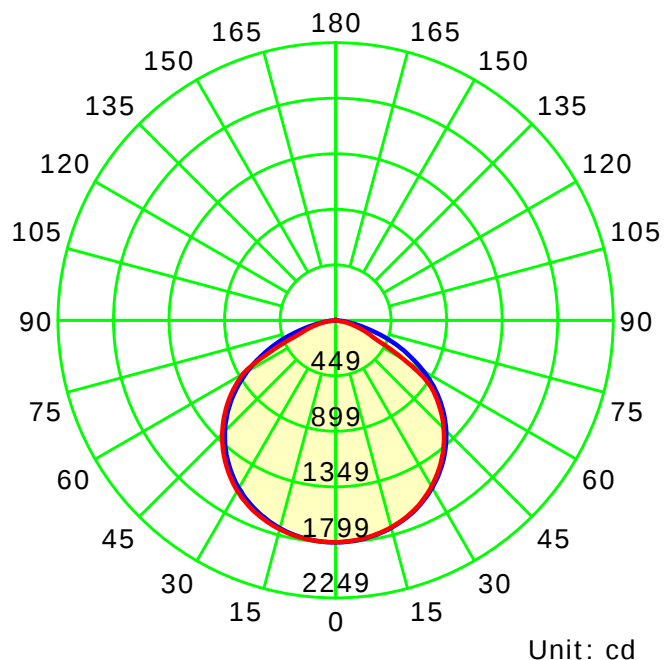

— C0-C180 — C90-C270

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:1.0



Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Luminous Intensity Distribution Curve

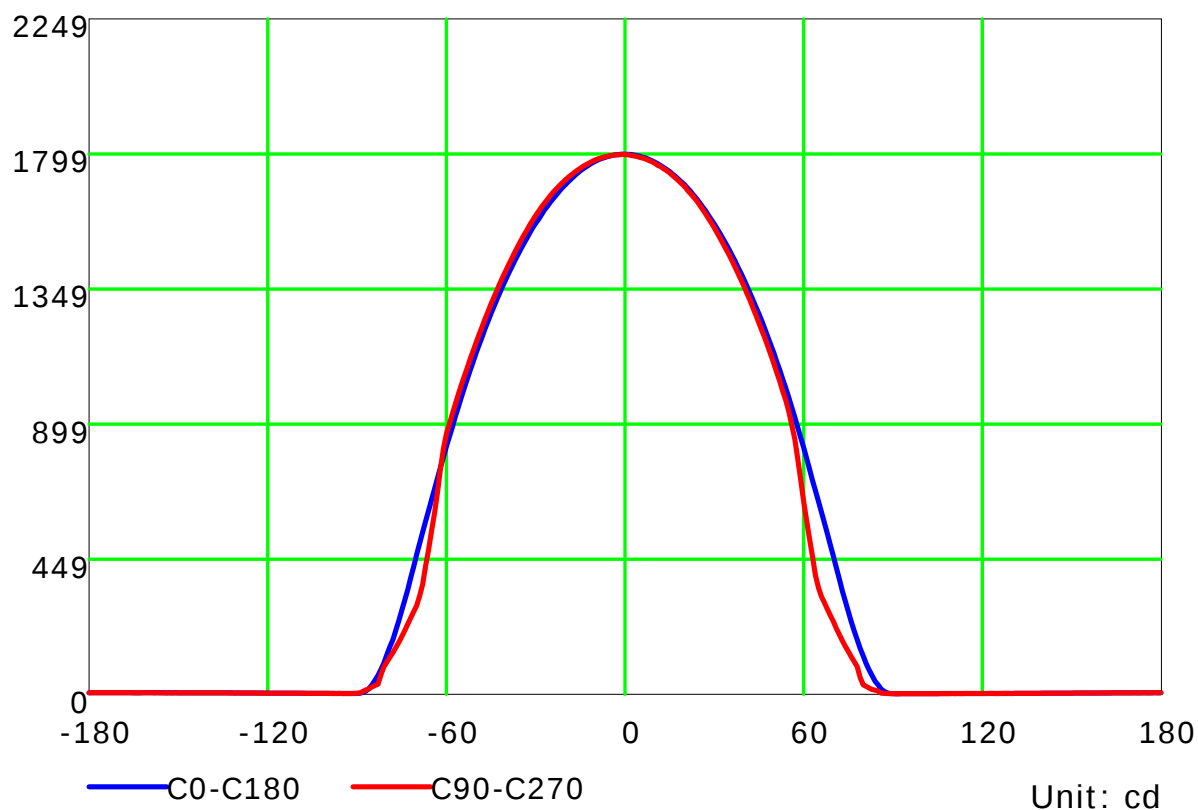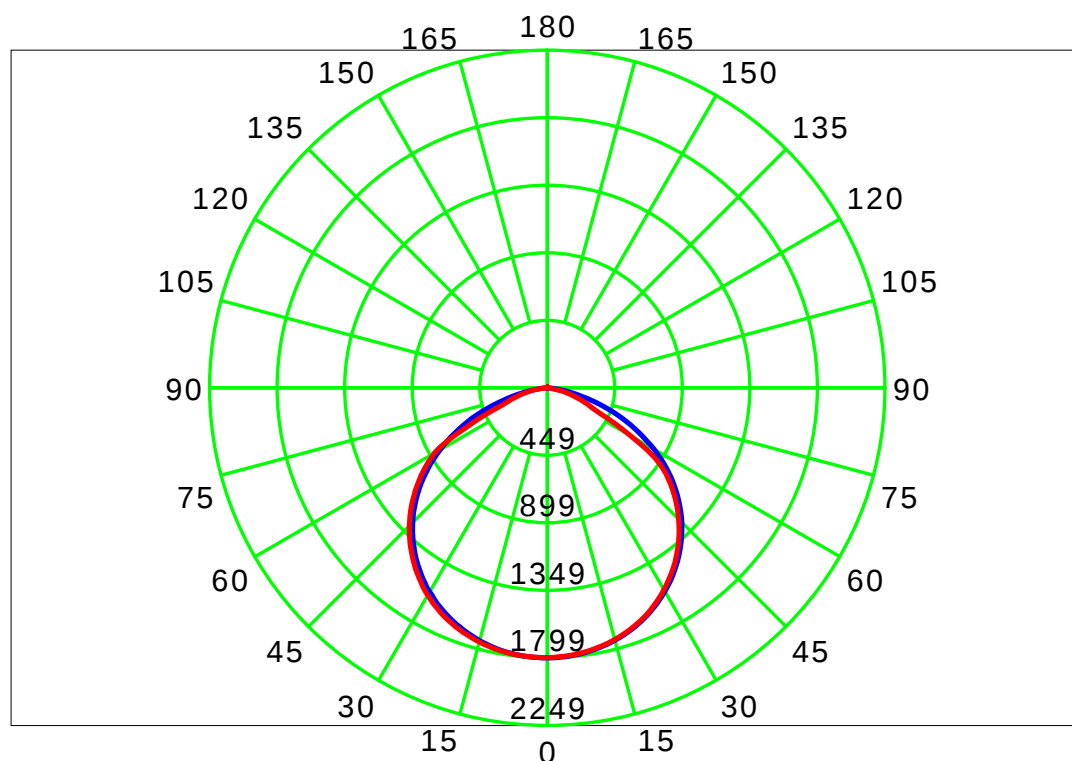

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:



Luminous Intensity Distribution Curve(cd / klm)

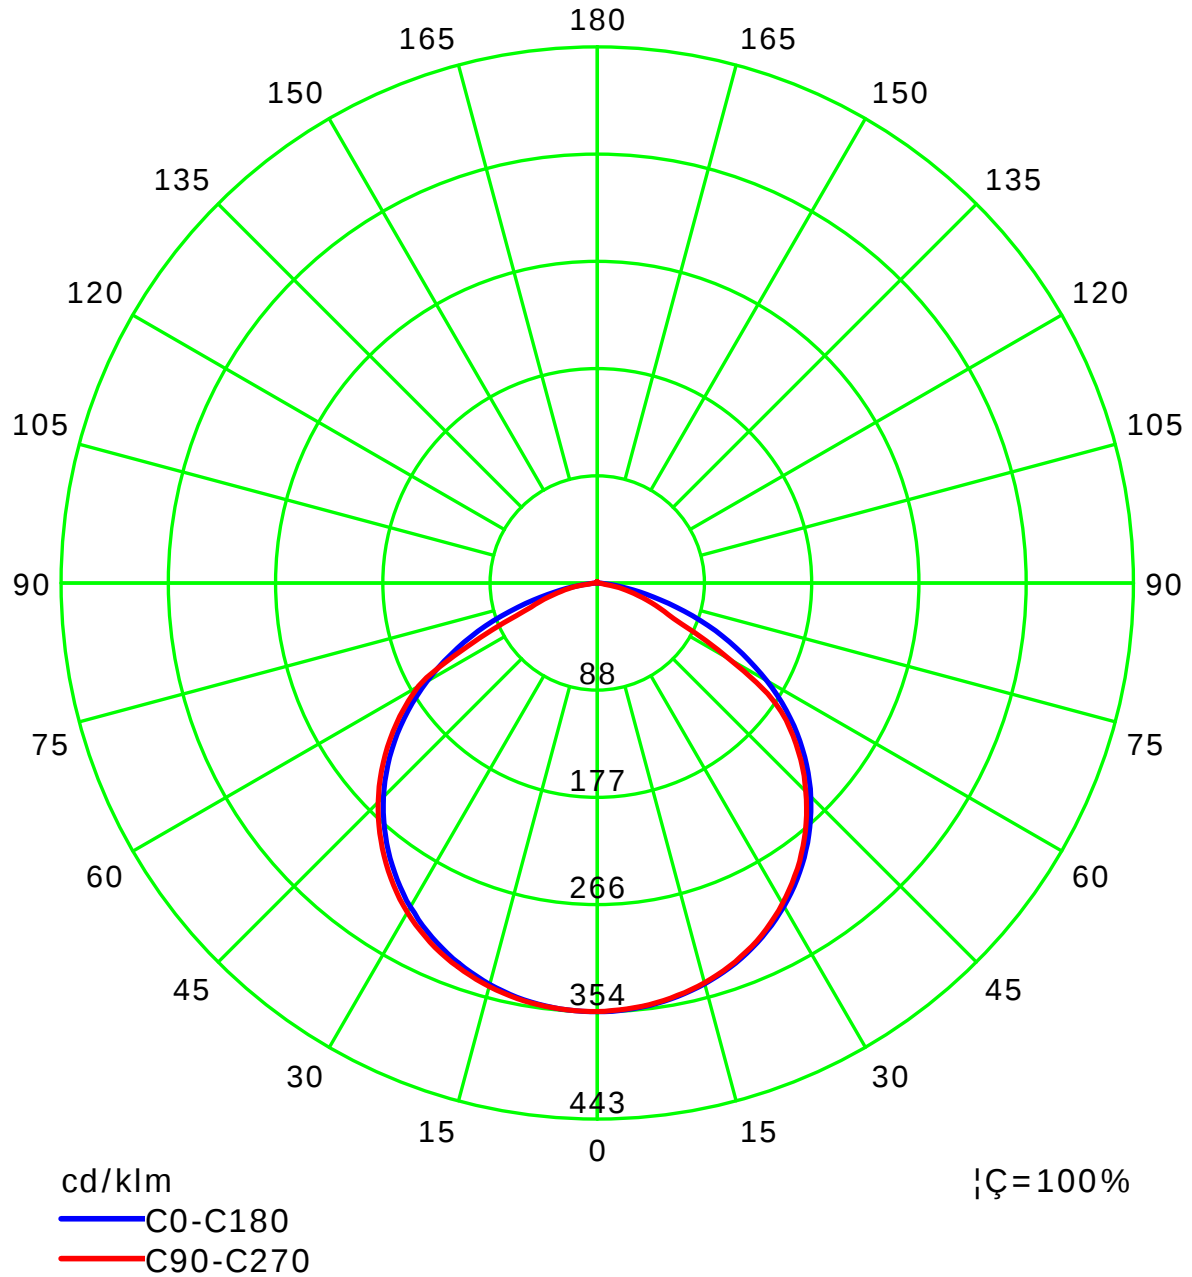

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

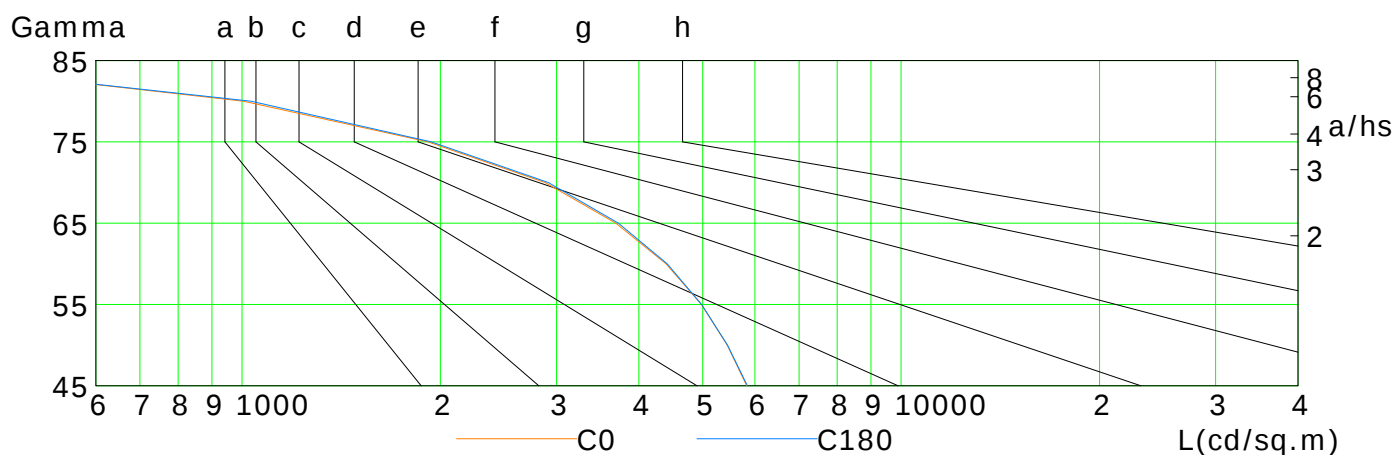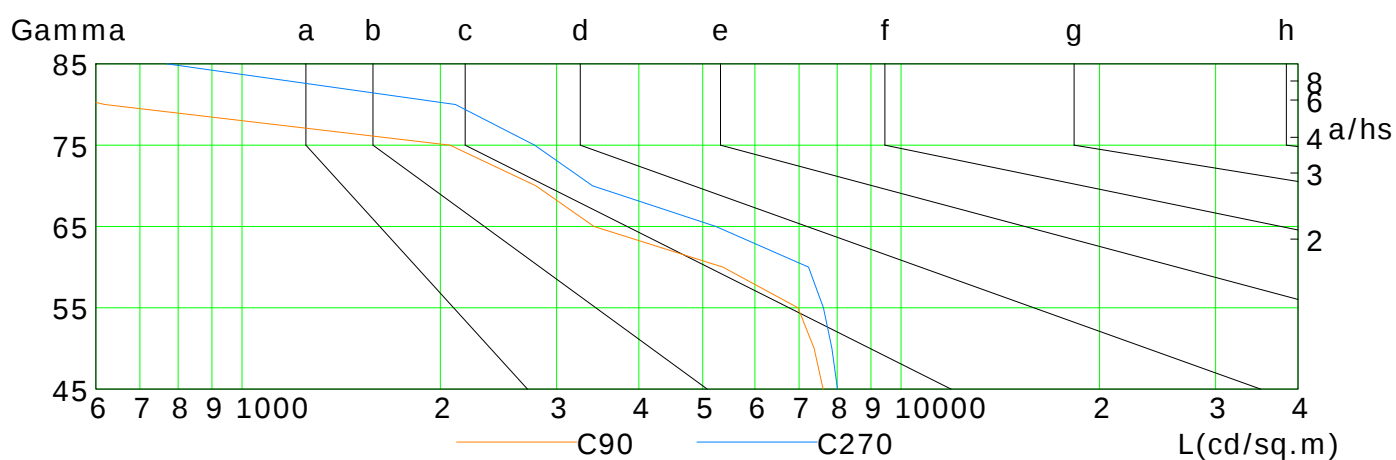

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	5832	5447	4977	4399	3691	2883	1915	1005	287
C90	7615	7379	6975	5364	3421	2791	2068	620	336
C180	5843	5453	4980	4416	3724	2915	1936	1032	283
C270	8009	7851	7622	7237	5235	3404	2779	2107	770

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Illuminance at a Distance

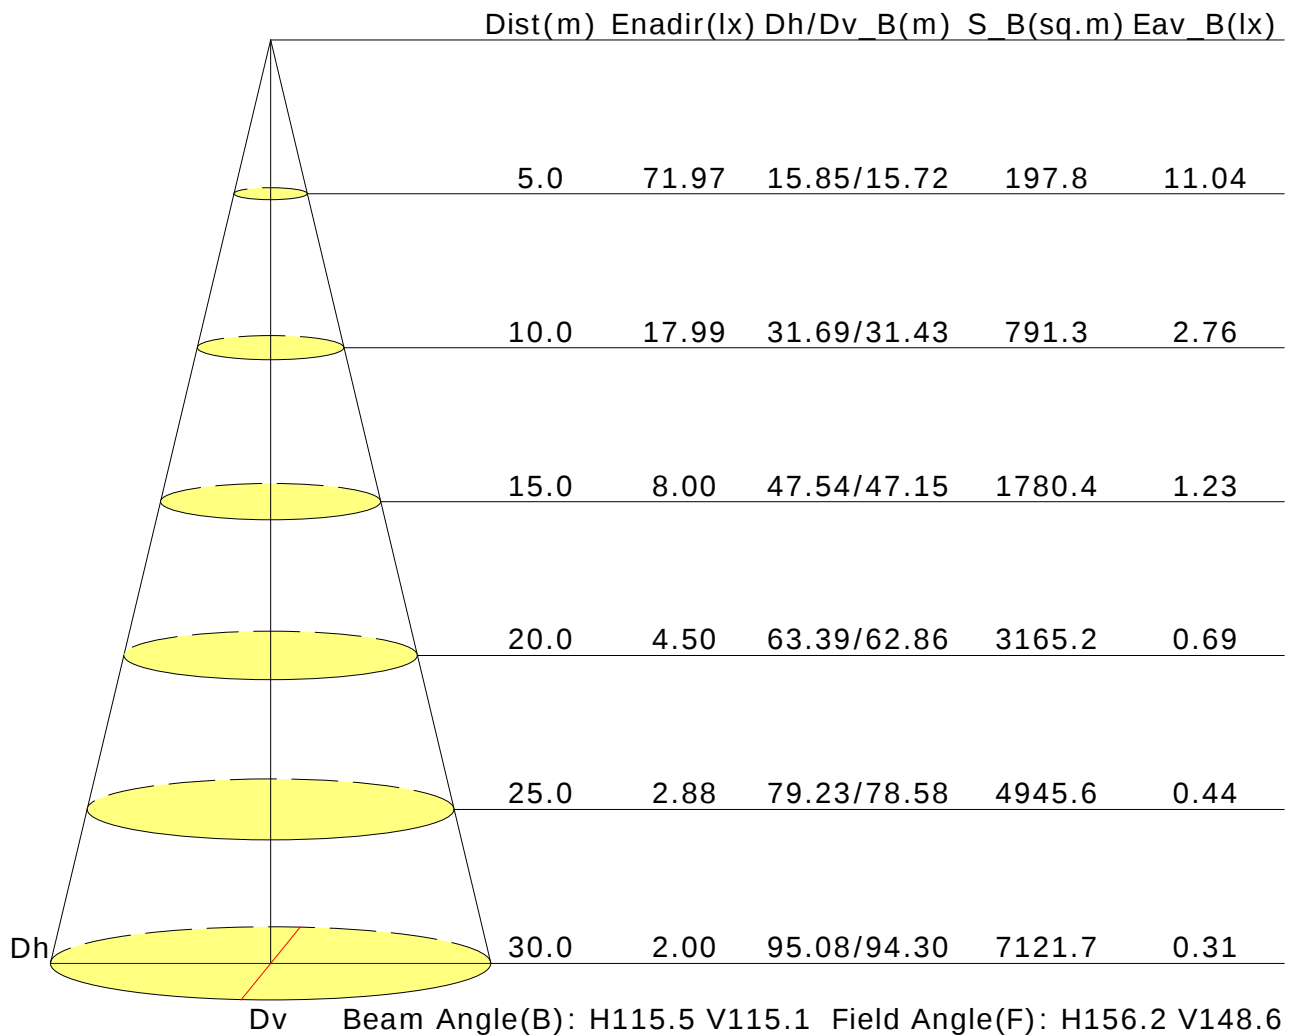

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	18.4	19.7	18.7	20.0	20.2	18.9	20.3	19.2	20.5	20.8
3H	19.4	20.6	19.7	20.9	21.2	19.5	20.7	19.9	21.0	21.3
4H	19.7	20.8	20.0	21.1	21.4	19.7	20.8	20.0	21.1	21.4
6H	19.8	20.8	20.1	21.1	21.5	19.7	20.8	20.1	21.1	21.4
8H	19.7	20.8	20.1	21.1	21.4	19.7	20.7	20.1	21.1	21.4
12H	19.7	20.7	20.1	21.0	21.4	19.7	20.6	20.1	21.0	21.3
X=4H Y=2H	18.9	20.1	19.3	20.4	20.7	19.4	20.5	19.7	20.8	21.1
3H	20.1	21.0	20.4	21.4	21.7	20.0	21.0	20.4	21.3	21.7
4H	20.4	21.3	20.8	21.6	22.0	20.2	21.1	20.6	21.5	21.8
6H	20.5	21.3	20.9	21.7	22.1	20.3	21.1	20.7	21.5	21.9
8H	20.5	21.2	20.9	21.6	22.1	20.3	21.0	20.8	21.4	21.9
12H	20.5	21.1	20.9	21.5	22.0	20.3	20.9	20.7	21.3	21.8
X=8H Y=4H	20.4	21.1	20.8	21.5	21.9	20.2	21.0	20.7	21.4	21.8
6H	20.6	21.1	21.0	21.6	22.0	20.4	20.9	20.9	21.4	21.9
8H	20.6	21.1	21.1	21.5	22.0	20.4	20.9	20.9	21.4	21.8
12H	20.6	21.0	21.1	21.5	22.0	20.4	20.8	20.9	21.3	21.8
X=12H Y=4H	20.4	21.0	20.8	21.4	21.9	20.2	20.9	20.7	21.3	21.7
6H	20.5	21.0	21.0	21.5	22.0	20.4	20.9	20.9	21.3	21.8
8H	20.6	21.0	21.1	21.5	22.0	20.4	20.8	20.9	21.3	21.8
Variations with the observer position at spacings:										
S=1.0H	+0.2/-0.3					+0.1/-0.2				
S=1.5H	+0.4/-0.7					+0.5/-0.8				
S=2.0H	+0.9/-1.6					+1.5/-2.9				

Calculate in accordance with CIE Pub.117. The table is revised with 5074Im ($8\log(F/F_0) = 5.6$).

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.58	0.69	0.76	0.82	0.89	0.94	0.97	1.02	1.04	
	0.30		0.50	0.61	0.69	0.75	0.83	0.89	0.93	0.98	1.01	
	0.20		0.44	0.55	0.64	0.70	0.78	0.84	0.89	0.94	0.98	
0.50	0.50	0.20	0.56	0.66	0.74	0.79	0.86	0.90	0.93	0.98	1.00	
	0.30		0.49	0.60	0.67	0.73	0.81	0.86	0.90	0.94	0.97	
	0.20		0.44	0.55	0.63	0.68	0.77	0.82	0.86	0.92	0.95	
0.30	0.50	0.20	0.55	0.65	0.71	0.76	0.83	0.87	0.90	0.94	0.96	
	0.30		0.48	0.59	0.66	0.71	0.79	0.84	0.87	0.91	0.94	
	0.20		0.44	0.54	0.62	0.67	0.75	0.80	0.84	0.89	0.92	
0.00	0.00	0.00	0.41	0.52	0.59	0.64	0.72	0.77	0.80	0.85	0.87	
Rating:39W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.98	0.80	0.67	0.58	0.46	0.38	0.32	0.25	0.20	
	0.30		0.82	0.68	0.59	0.51	0.41	0.35	0.30	0.23	0.19	
	0.20		0.70	0.60	0.52	0.46	0.38	0.32	0.28	0.22	0.18	
0.50	0.50	0.20	0.94	0.77	0.64	0.56	0.44	0.39	0.30	0.23	0.19	
	0.30		0.80	0.66	0.57	0.50	0.40	0.33	0.28	0.22	0.18	
	0.20		0.69	0.59	0.51	0.45	0.37	0.31	0.27	0.21	0.17	
0.30	0.50	0.20	0.92	0.74	0.62	0.53	0.42	0.34	0.29	0.22	0.18	
	0.30		0.78	0.65	0.55	0.48	0.38	0.32	0.27	0.21	0.17	
	0.20		0.69	0.58	0.50	0.44	0.36	0.30	0.26	0.20	0.17	
0.00	0.00	0.00	0.58	0.48	0.41	0.35	0.28	0.23	0.20	0.15	0.12	
Rating:39W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.17	0.18	0.19	0.19	0.20	0.21	0.21	0.22	0.22	
	0.30		0.10	0.11	0.13	0.14	0.16	0.17	0.18	0.19	0.20	
	0.20		0.05	0.07	0.08	0.10	0.12	0.13	0.15	0.16	0.17	
0.50	0.50	0.20	0.16	0.17	0.18	0.19	0.19	0.20	0.20	0.21	0.21	
	0.30		0.10	0.11	0.13	0.14	0.15	0.16	0.17	0.18	0.19	
	0.20		0.05	0.07	0.08	0.10	0.11	0.13	0.14	0.16	0.17	
0.30	0.50	0.20	0.16	0.17	0.17	0.18	0.19	0.19	0.19	0.20	0.20	
	0.30		0.10	0.11	0.12	0.13	0.15	0.16	0.16	0.18	0.18	
	0.20		0.05	0.07	0.08	0.09	0.11	0.13	0.14	0.15	0.16	
0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
Rating:39W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												