

Report No.: 1

Test Time: 12.03.2020 16:03

Luminaire Property

Luminaire Manufacturer:

Luminaire Description: FG 180 4x18LED 0,3A 36W 5000K закаленное стекло матовое IP65 N

Number of Lamps: 1

Luminous Length (mm): 1200

Luminous Width (mm): 180

Luminous Height (mm): 76

Voltage: 230.0 V

Current: 0.161 A

Power: 35.96 W

Power Factor: 0.965

Photometric Results

CIE Class: Direct

Total Rated Lamp Lumens: 4162.0 lm

Measurement Flux: 4162 lm

Efficiency: 100%

Downward Ratio: 100%

Upward Ratio: 0%

Field Angle(C0/C180,C90/C270,C45/C225,C135/315): 151.9, 143.4, 147.0, 147.0

Beam Angle(C0/C180,C90/C270,C45/C225,C135/315): 100.0, 95.1, 98.0, 98.0

Luminaire Efficacy Rating (LER): 115.79

Central Intensity: 1764.73 cd

Max. Intensity: 1765.8 cd

Pos of Max. Intensity: H22.5 V0


S/MH(C0/C180): 1.25

S/MH(C90/C270): 1.24

Picture Of Luminaire



Luminous Intensity Distribution Curve

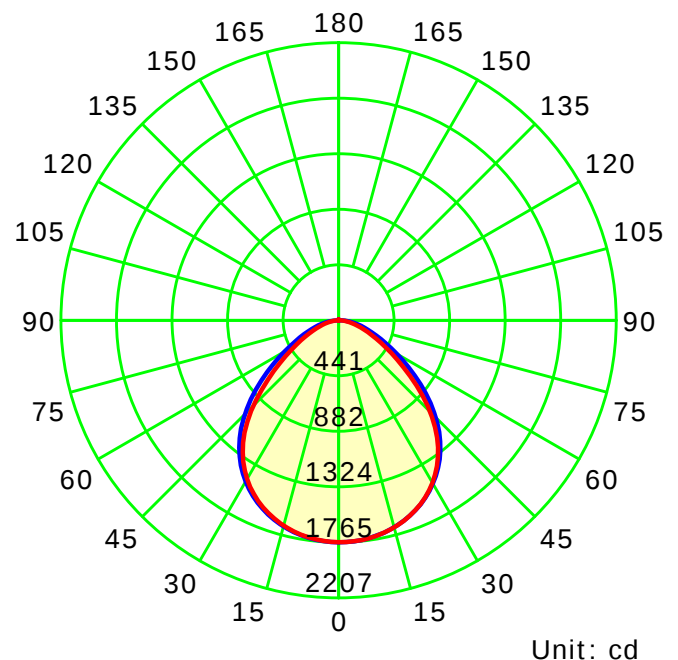

— C0-C180 — C90-C270

C Plane (°):0.0-360.0: 22.5

Gamma Plane (°):0.0-180.0:2.0

Test Lab:

Test Device: LSG-1800B

Test Type: TYPE C

Distance: 12.677 m



Temperature:

Humidity:

Operator:

Inspector:

Luminous Intensity Distribution Curve

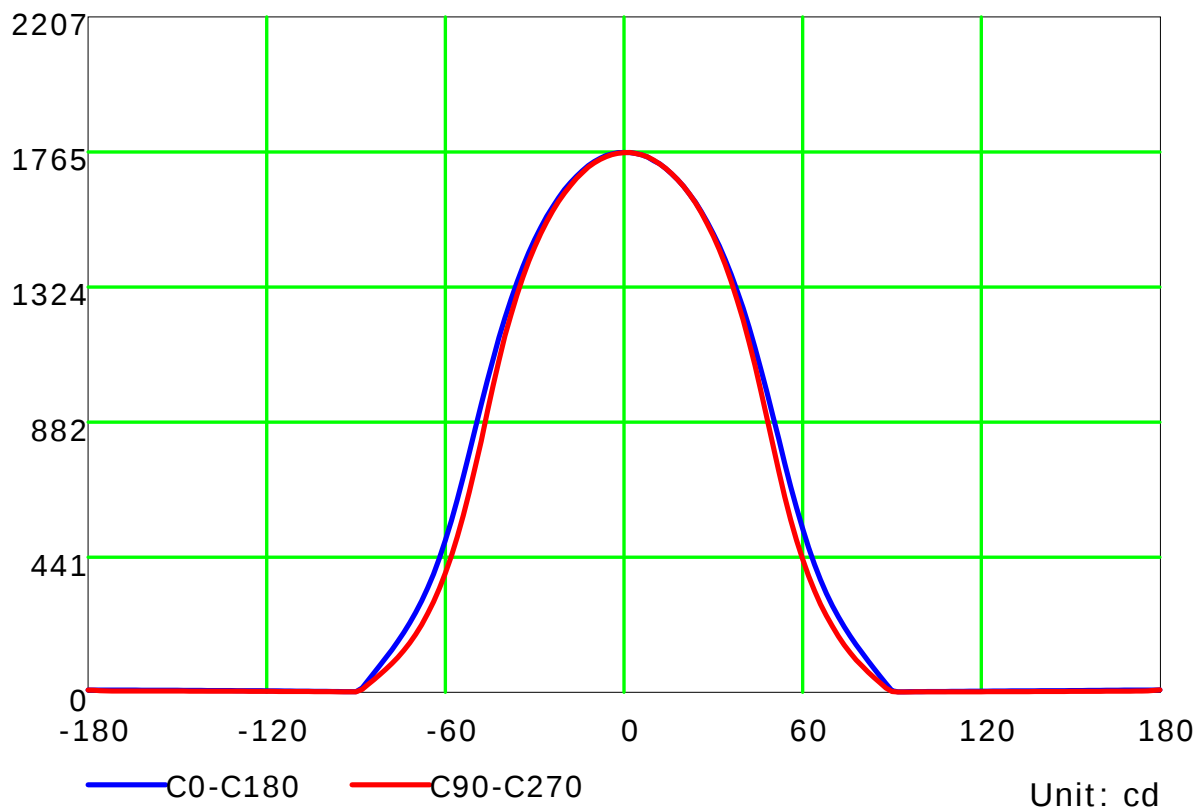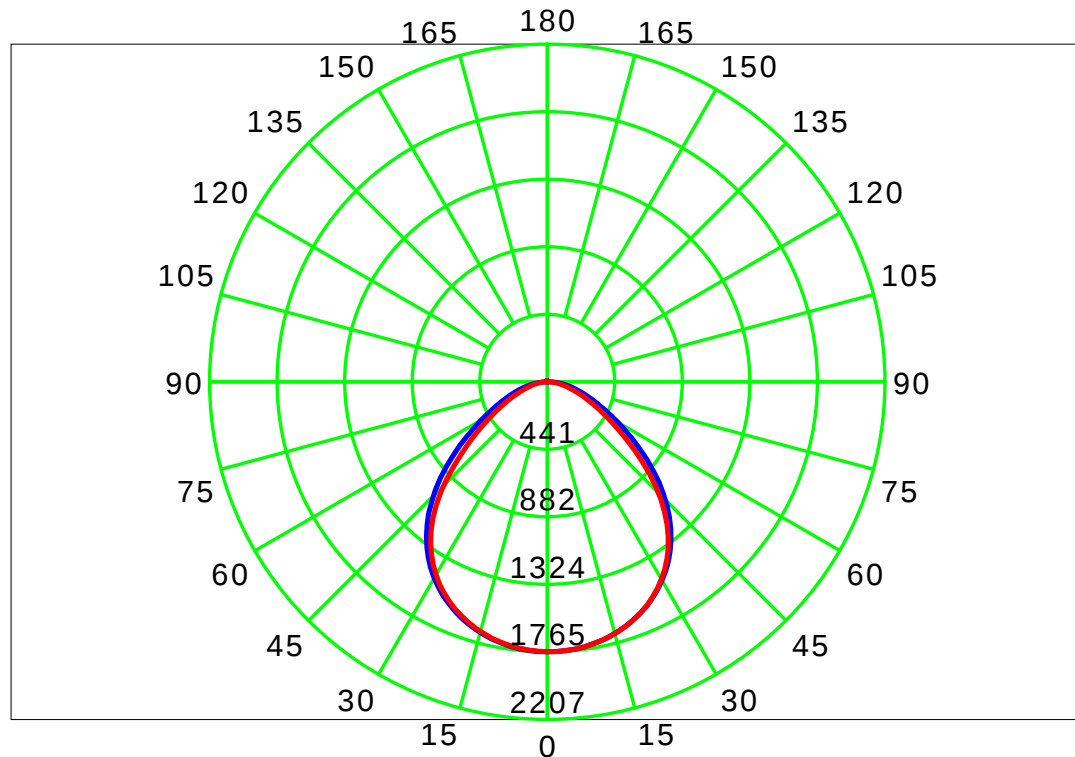

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0


Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:



Luminous Intensity Distribution Curve(cd / klm)

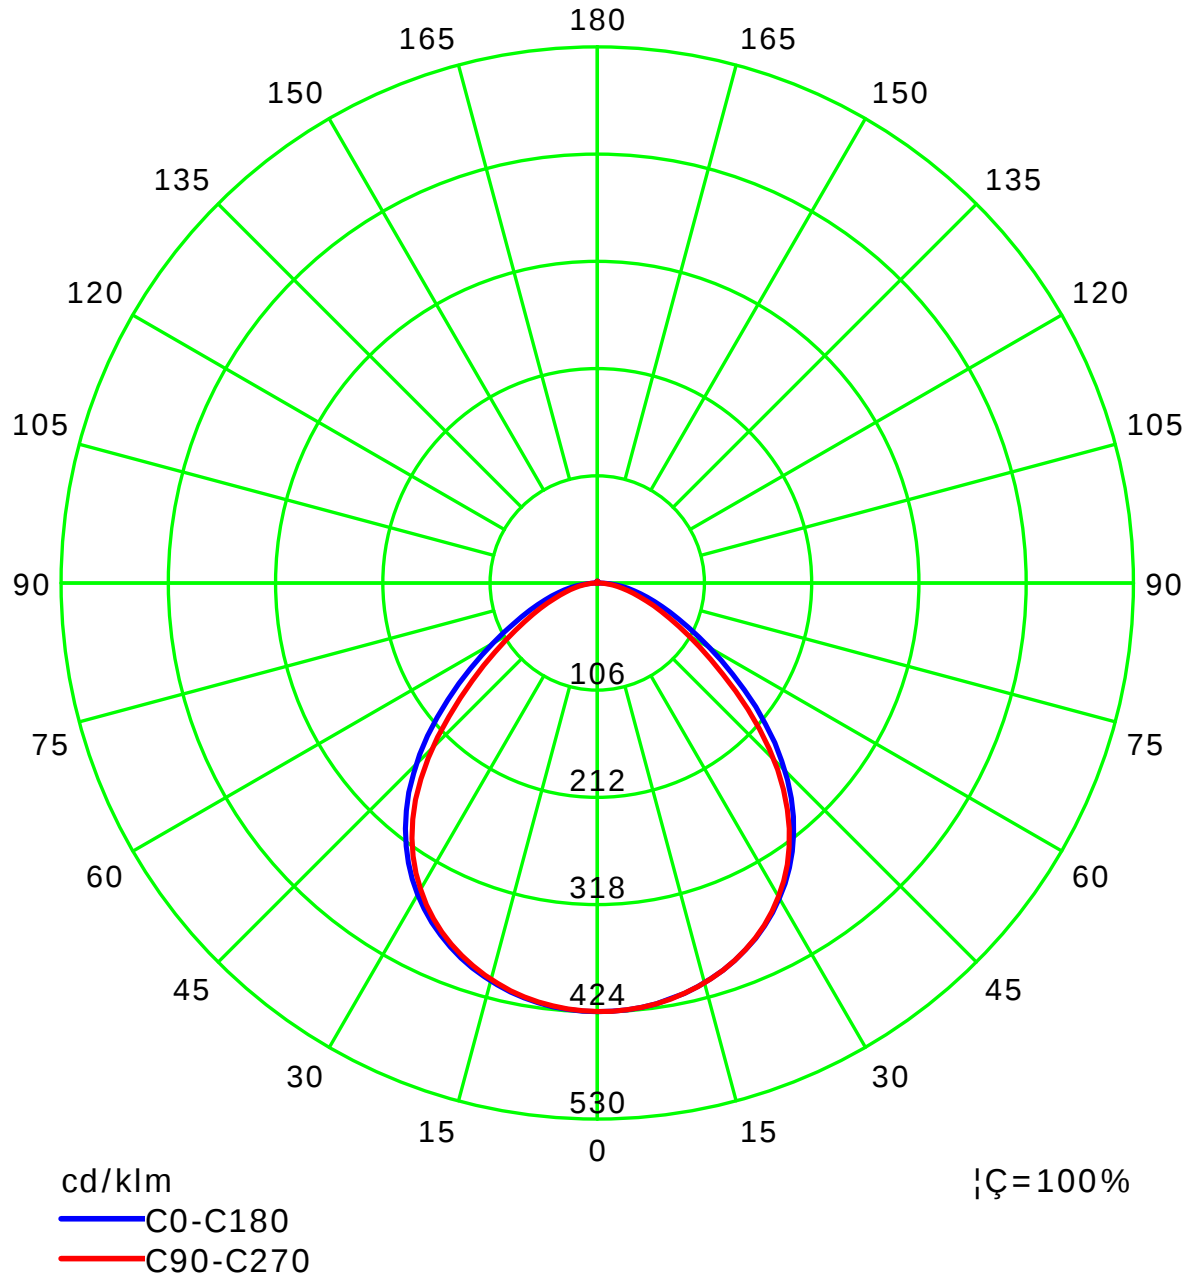

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

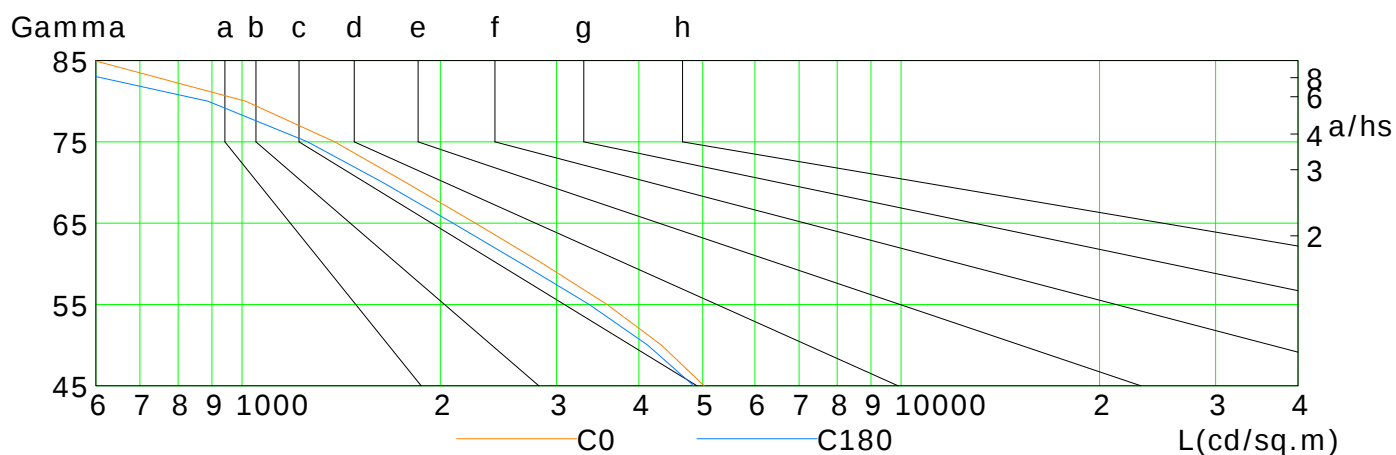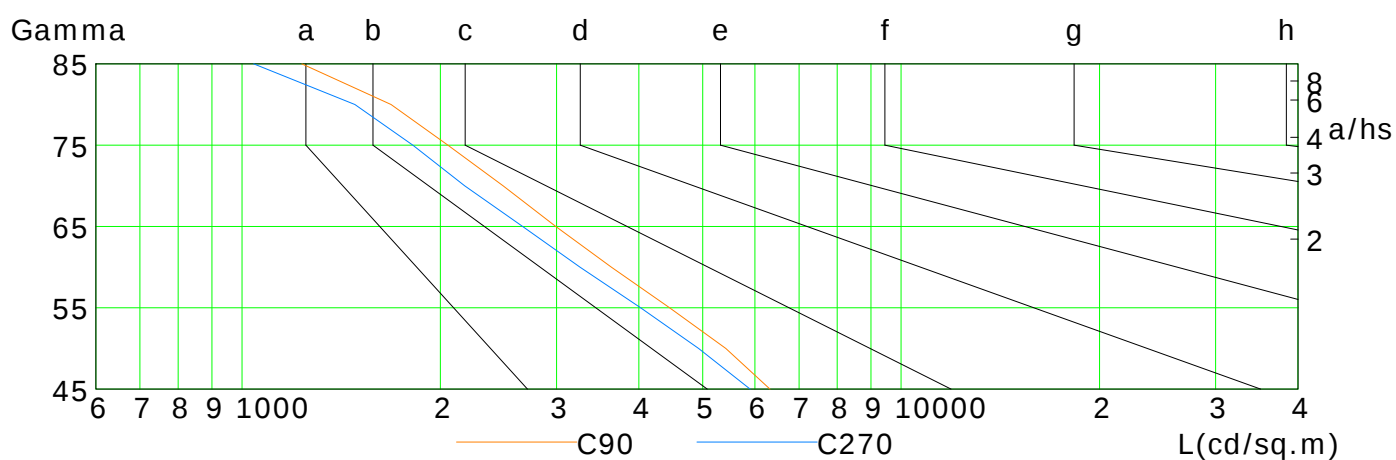

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	5024	4329	3579	2864	2260	1773	1382	1013	597
C90	6325	5421	4453	3633	2992	2490	2053	1683	1233
C180	4846	4125	3363	2658	2090	1635	1257	888	466
C270	5899	4927	4025	3255	2665	2177	1816	1483	1041

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0


Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Illuminance at a Distance

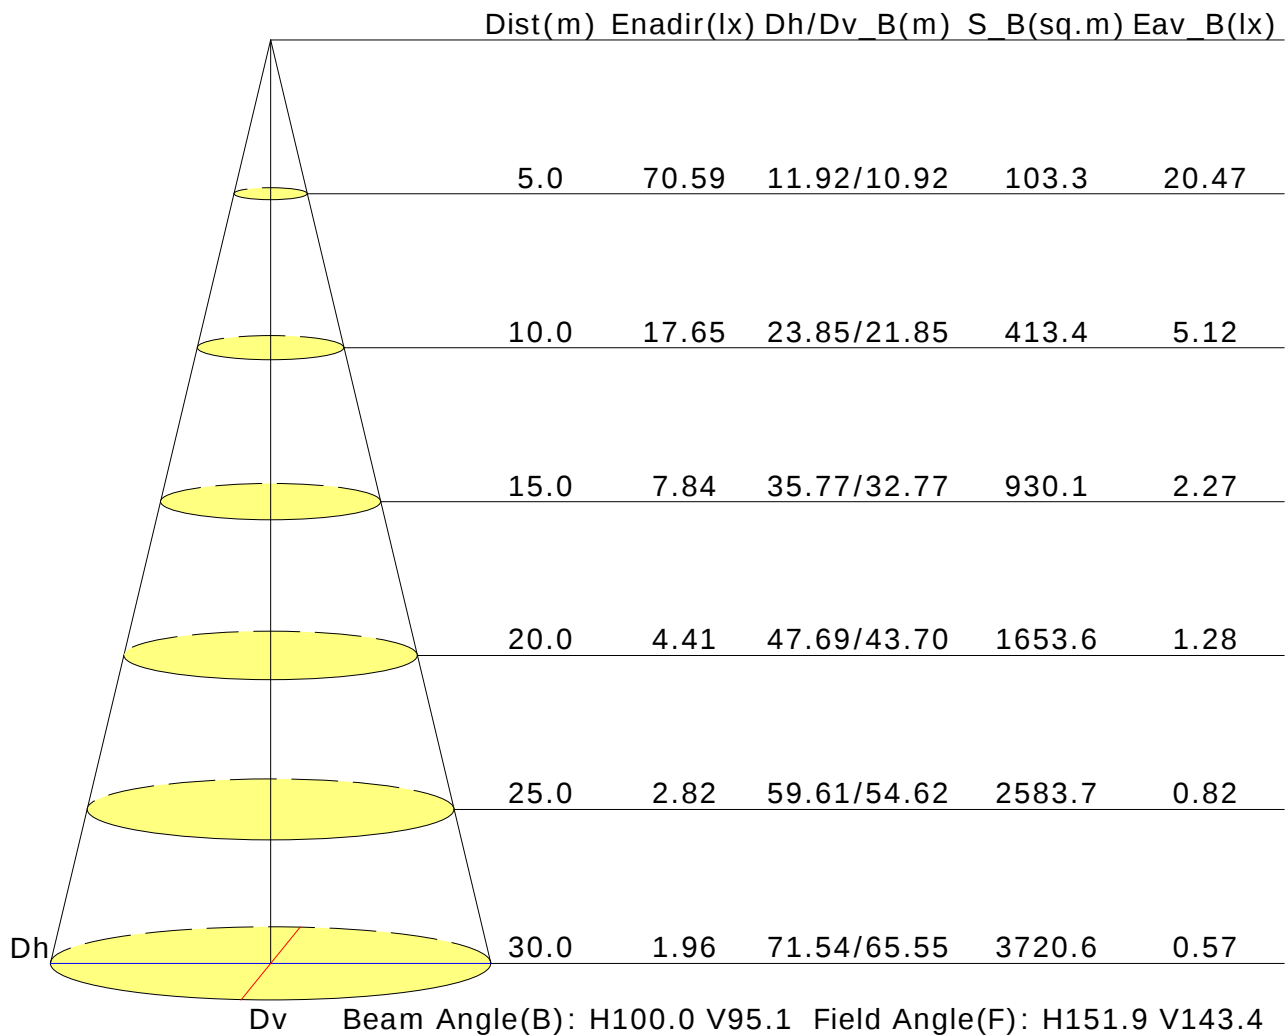

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	16.9	18.1	17.2	18.4	18.6	16.7	18.0	17.0	18.2	18.5
3H	17.6	18.7	17.9	19.0	19.3	17.4	18.5	17.7	18.8	19.1
4H	17.8	18.9	18.2	19.2	19.5	17.6	18.7	18.0	19.0	19.3
6H	18.0	19.0	18.4	19.3	19.6	17.8	18.8	18.1	19.1	19.4
8H	18.0	19.0	18.4	19.3	19.7	17.8	18.8	18.2	19.1	19.4
12H	18.0	19.0	18.4	19.3	19.7	17.8	18.8	18.2	19.1	19.4
X=4H Y=2H	17.1	18.2	17.5	18.5	18.8	17.0	18.1	17.4	18.4	18.7
3H	18.0	18.9	18.4	19.3	19.6	17.8	18.7	18.2	19.1	19.4
4H	18.4	19.2	18.8	19.5	19.9	18.1	19.0	18.5	19.3	19.7
6H	18.6	19.3	19.0	19.7	20.1	18.4	19.1	18.8	19.5	19.9
8H	18.7	19.4	19.1	19.8	20.2	18.4	19.1	18.9	19.5	19.9
12H	18.7	19.3	19.2	19.8	20.2	18.5	19.1	18.9	19.5	20.0
X=8H Y=4H	18.4	19.1	18.9	19.5	19.9	18.2	18.9	18.7	19.3	19.7
6H	18.8	19.3	19.2	19.7	20.2	18.5	19.0	19.0	19.5	20.0
8H	18.9	19.3	19.4	19.8	20.3	18.6	19.1	19.1	19.6	20.1
12H	19.0	19.4	19.5	19.8	20.4	18.7	19.1	19.2	19.6	20.1
X=12H Y=4H	18.4	19.0	18.9	19.4	19.9	18.2	18.8	18.7	19.2	19.7
6H	18.8	19.2	19.2	19.7	20.2	18.5	19.0	19.0	19.5	19.9
8H	18.9	19.3	19.4	19.8	20.3	18.6	19.1	19.1	19.5	20.0
Variations with the observer position at spacings:										
S=1.0H	+0.3/-0.4					+0.4/-0.6				
S=1.5H	+0.6/-1.2					+0.7/-1.3				
S=2.0H	+1.4/-1.9					+1.7/-2.0				

Calculate in accordance with CIE Pub.117. The table is revised with 4162lm ($8\log(F/F_0) = 5.0$).

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0

Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.63	0.73	0.80	0.85	0.91	0.96	0.99	1.03	1.05	
	0.30		0.56	0.66	0.73	0.78	0.86	0.91	0.94	0.99	1.02	
	0.20		0.50	0.61	0.68	0.74	0.81	0.87	0.91	0.96	0.99	
0.50	0.50	0.20	0.61	0.71	0.77	0.82	0.88	0.92	0.95	0.99	1.01	
	0.30		0.55	0.65	0.72	0.77	0.84	0.88	0.91	0.96	0.98	
	0.20		0.50	0.60	0.67	0.72	0.80	0.85	0.88	0.93	0.96	
0.30	0.50	0.20	0.60	0.69	0.75	0.79	0.85	0.89	0.92	0.95	0.97	
	0.30		0.54	0.64	0.70	0.75	0.81	0.86	0.89	0.93	0.95	
	0.20		0.50	0.59	0.66	0.71	0.78	0.83	0.86	0.90	0.93	
0.00	0.00	0.00	0.48	0.57	0.64	0.68	0.75	0.79	0.82	0.86	0.88	
Rating:36W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.91	0.74	0.62	0.54	0.42	0.35	0.30	0.23	0.19	
	0.30		0.76	0.63	0.54	0.47	0.38	0.32	0.28	0.22	0.18	
	0.20		0.65	0.55	0.48	0.43	0.35	0.30	0.26	0.20	0.17	
0.50	0.50	0.20	0.87	0.70	0.59	0.51	0.40	0.37	0.28	0.22	0.18	
	0.30		0.74	0.61	0.52	0.46	0.37	0.31	0.26	0.21	0.17	
	0.20		0.64	0.54	0.47	0.41	0.34	0.29	0.25	0.20	0.16	
0.30	0.50	0.20	0.84	0.67	0.57	0.49	0.38	0.32	0.27	0.21	0.17	
	0.30		0.72	0.59	0.51	0.44	0.35	0.30	0.25	0.20	0.16	
	0.20		0.63	0.53	0.46	0.40	0.33	0.28	0.24	0.19	0.16	
0.00	0.00	0.00	0.52	0.43	0.36	0.31	0.25	0.21	0.18	0.14	0.11	
Rating:36W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.16	0.17	0.18	0.19	0.20	0.20	0.21	0.22	0.22	
	0.30		0.10	0.11	0.13	0.14	0.16	0.17	0.18	0.19	0.20	
	0.20		0.05	0.07	0.09	0.10	0.12	0.14	0.15	0.16	0.18	
0.50	0.50	0.20	0.15	0.17	0.17	0.18	0.19	0.20	0.20	0.21	0.21	
	0.30		0.10	0.11	0.12	0.14	0.15	0.16	0.17	0.18	0.19	
	0.20		0.05	0.07	0.09	0.10	0.12	0.13	0.14	0.16	0.17	
0.30	0.50	0.20	0.15	0.16	0.17	0.17	0.18	0.19	0.19	0.20	0.20	
	0.30		0.09	0.11	0.12	0.13	0.15	0.16	0.17	0.18	0.18	
	0.20		0.05	0.07	0.08	0.10	0.12	0.13	0.14	0.16	0.17	
0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
Rating:36W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												