

Report No.:

Test Time: 18.12.2019 13:22

Luminaire Property

Luminaire Manufacturer:

Luminaire Description: FG 180 4x24LED 0,3A 32W 5000K закаленное стекло IP65 N

Number of Lamps: 1

Luminous Length (mm): 1200

Luminous Width (mm): 180

Luminous Height (mm): 76

Voltage: 221.2 V

Current: 0.150 A

Power: 32.21 W

Power Factor: 0.970

Photometric Results

CIE Class: Direct

Total Rated Lamp Lumens: 4242.0 lm

Measurement Flux: 4242 lm

Efficiency: 100%

Downward Ratio: 100%

Upward Ratio: 0%

Field Angle(C0/C180,C90/C270,C45/C225,C135/315): 156.2, 148.6, 149.2, 149.1

Beam Angle(C0/C180,C90/C270,C45/C225,C135/315): 115.5, 115.1, 115.4, 115.4

Luminaire Efficacy Rating (LER): 131.75

Central Intensity: 1504.04 cd

Max. Intensity: 1504.68 cd

Pos of Max. Intensity: H22.5 V0


S/MH(C0/C180): 1.29

S/MH(C90/C270): 1.30

Picture Of Luminaire



Luminous Intensity Distribution Curve

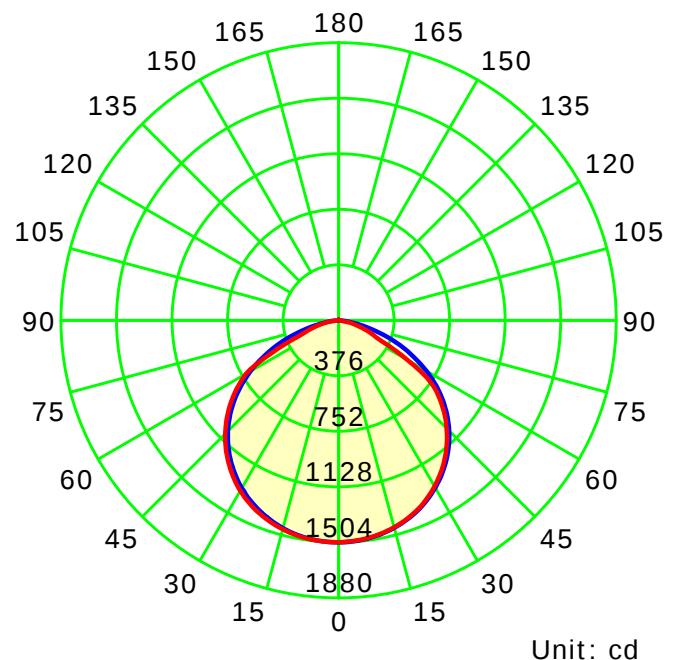

— C0-C180 — C90-C270

C Plane (°):0.0-360.0: 22.5

Gamma Plane (°):0.0-180.0:1.0

Test Lab:

Test Device: LSG-1800B

Test Type: TYPE C

Distance: 12.677 m



Temperature:

Humidity:

Operator:

Inspector:

Luminous Intensity Distribution Curve

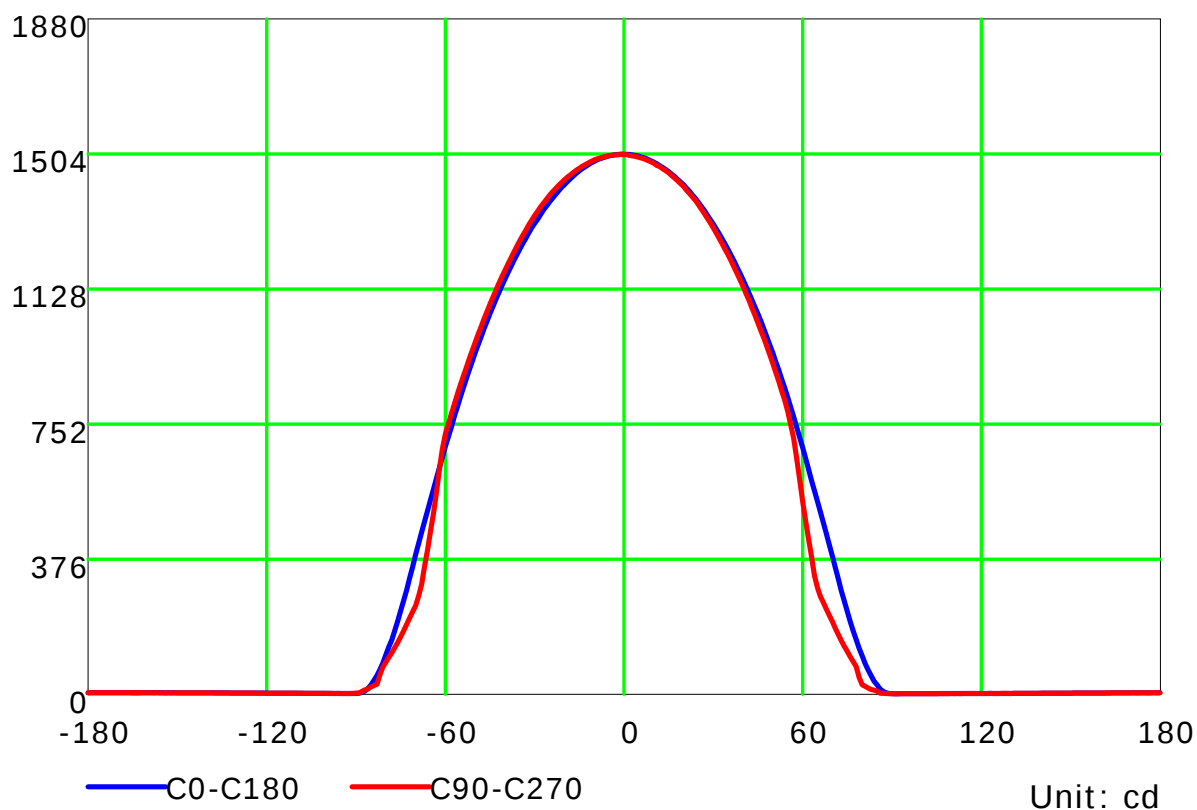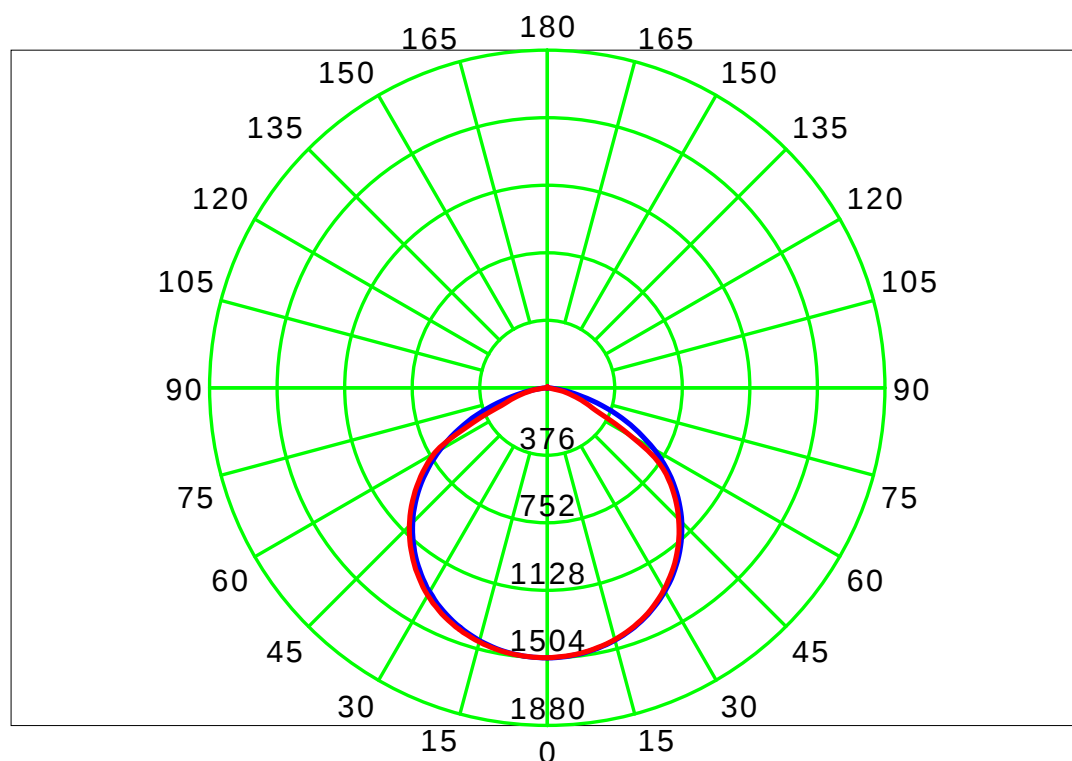

C Plane (°): 0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°): 0.0-180.0: 1.0


Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Luminous Intensity Distribution Curve(cd / klm)

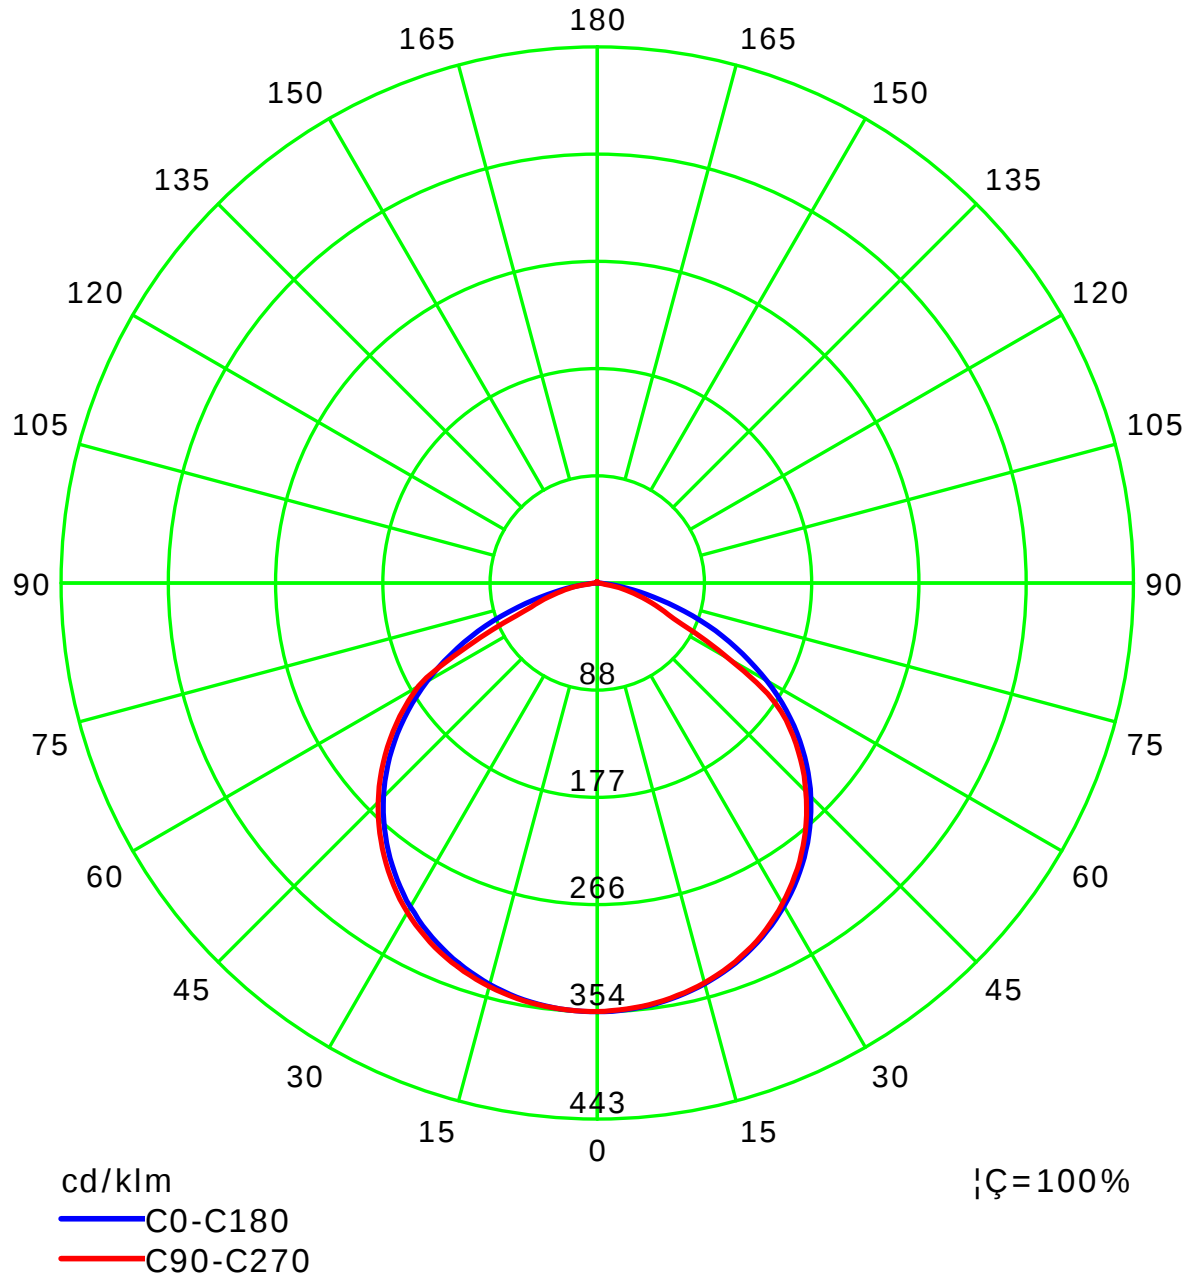

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1800B

Distance: 12.677 m



Humidity:

Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

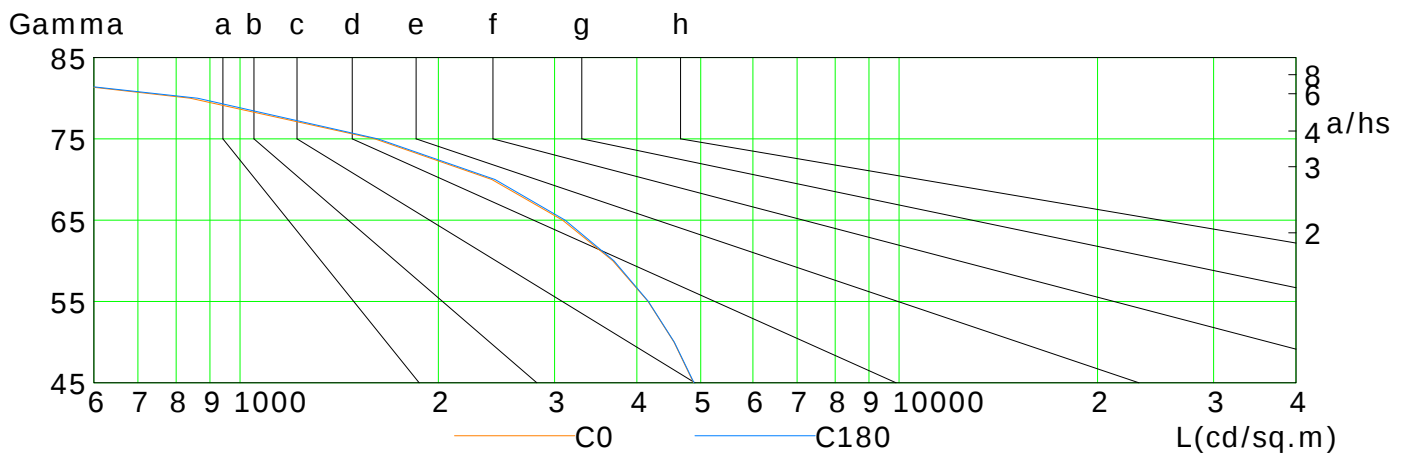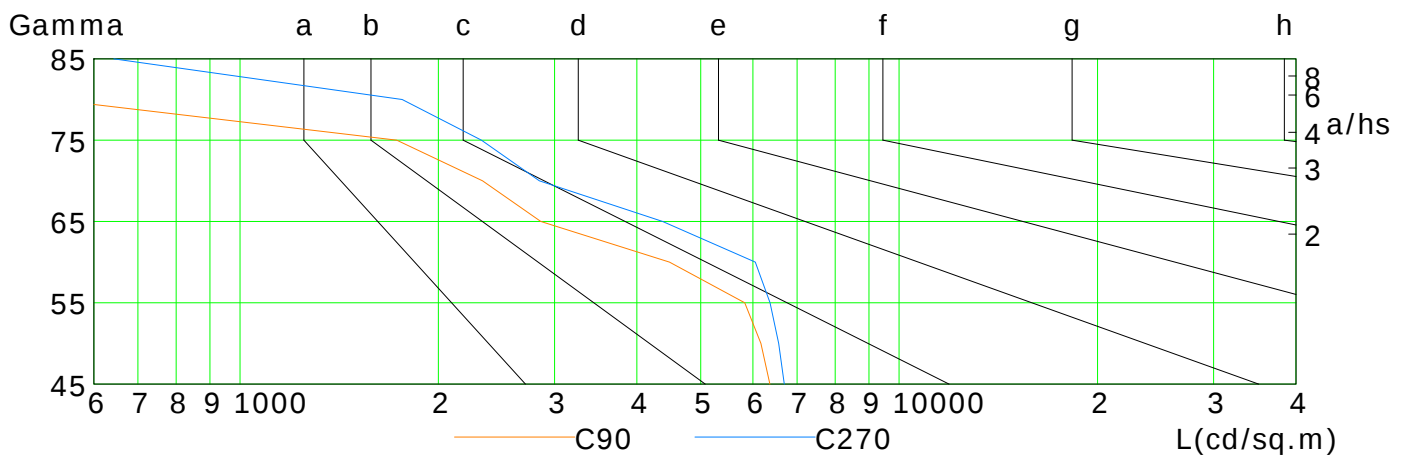

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	4875	4554	4161	3677	3086	2410	1601	840	240
C90	6366	6168	5831	4484	2860	2333	1729	518	281
C180	4884	4559	4163	3692	3113	2437	1619	862	237
C270	6695	6563	6371	6050	4376	2846	2324	1762	644

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:1.0


Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Illuminance at a Distance

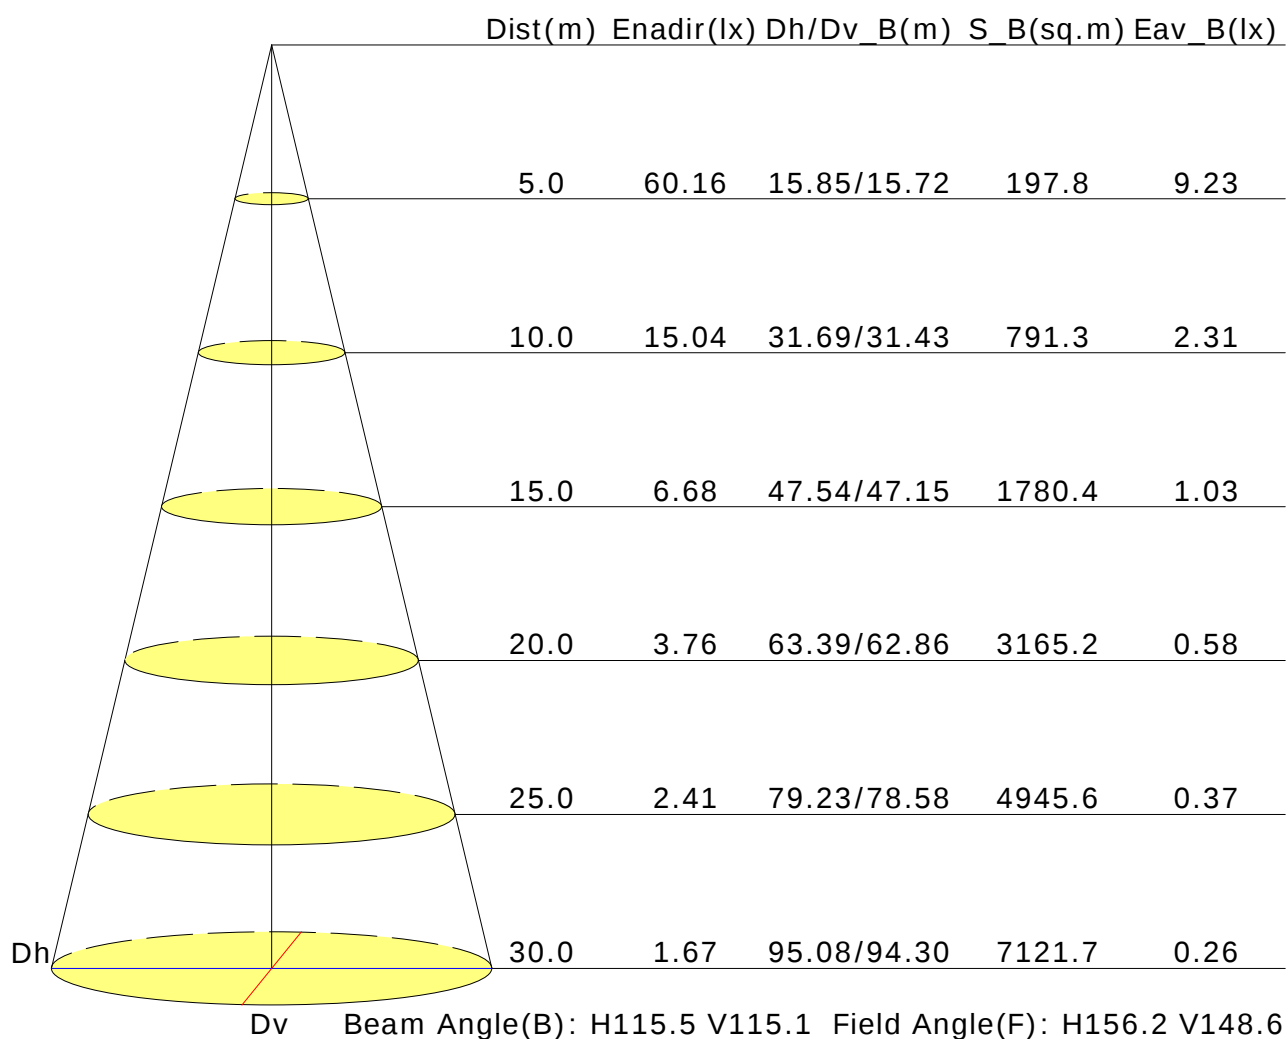

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	17.7	19.1	18.1	19.3	19.6	18.3	19.7	18.6	19.9	20.2
3H	18.8	20.0	19.1	20.3	20.6	18.9	20.1	19.2	20.4	20.7
4H	19.1	20.2	19.4	20.5	20.8	19.0	20.2	19.4	20.5	20.8
6H	19.1	20.2	19.5	20.5	20.8	19.1	20.2	19.5	20.5	20.8
8H	19.1	20.1	19.5	20.5	20.8	19.1	20.1	19.5	20.4	20.8
12H	19.1	20.1	19.5	20.4	20.8	19.0	20.0	19.4	20.4	20.7
X=4H Y=2H	18.3	19.4	18.6	19.7	20.0	18.7	19.9	19.1	20.2	20.5
3H	19.4	20.4	19.8	20.8	21.1	19.4	20.4	19.8	20.7	21.1
4H	19.8	20.6	20.2	21.0	21.4	19.6	20.5	20.0	20.8	21.2
6H	19.9	20.7	20.3	21.0	21.5	19.7	20.5	20.1	20.8	21.3
8H	19.9	20.6	20.3	21.0	21.4	19.7	20.4	20.1	20.8	21.2
12H	19.9	20.5	20.3	20.9	21.4	19.7	20.3	20.1	20.7	21.2
X=8H Y=4H	19.8	20.5	20.2	20.9	21.3	19.6	20.3	20.1	20.7	21.2
6H	19.9	20.5	20.4	20.9	21.4	19.8	20.3	20.2	20.8	21.2
8H	19.9	20.4	20.4	20.9	21.4	19.8	20.3	20.3	20.7	21.2
12H	19.9	20.4	20.4	20.8	21.4	19.8	20.2	20.3	20.7	21.2
X=12H Y=4H	19.8	20.4	20.2	20.8	21.3	19.6	20.2	20.1	20.7	21.1
6H	19.9	20.4	20.4	20.9	21.4	19.7	20.2	20.2	20.7	21.2
8H	19.9	20.4	20.4	20.8	21.4	19.8	20.2	20.3	20.7	21.2
Variations with the observer position at spacings:										
S=1.0H	+0.2/-0.3					+0.1/-0.2				
S=1.5H	+0.4/-0.7					+0.5/-0.8				
S=2.0H	+0.9/-1.6					+1.5/-2.9				

Calculate in accordance with CIE Pub.117. The table is revised with 4242Im ($8\log(F/F_0) = 5.0$).

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:1.0

Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.58	0.69	0.76	0.82	0.89	0.94	0.97	1.02	1.04	
	0.30		0.50	0.61	0.69	0.75	0.83	0.89	0.93	0.98	1.01	
	0.20		0.44	0.55	0.64	0.70	0.78	0.84	0.89	0.94	0.98	
0.50	0.50	0.20	0.56	0.66	0.74	0.79	0.86	0.90	0.93	0.98	1.00	
	0.30		0.49	0.60	0.67	0.73	0.81	0.86	0.90	0.94	0.97	
	0.20		0.44	0.55	0.63	0.68	0.77	0.82	0.86	0.92	0.95	
0.30	0.50	0.20	0.55	0.65	0.71	0.76	0.83	0.87	0.90	0.94	0.96	
	0.30		0.48	0.59	0.66	0.71	0.79	0.84	0.87	0.91	0.94	
	0.20		0.44	0.54	0.62	0.67	0.75	0.80	0.84	0.89	0.92	
0.00	0.00	0.00	0.41	0.52	0.59	0.64	0.72	0.77	0.80	0.85	0.87	
Rating:32W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.98	0.80	0.67	0.58	0.46	0.38	0.32	0.25	0.20	
	0.30		0.82	0.68	0.59	0.51	0.41	0.35	0.30	0.23	0.19	
	0.20		0.70	0.60	0.52	0.46	0.38	0.32	0.28	0.22	0.18	
0.50	0.50	0.20	0.94	0.77	0.64	0.56	0.44	0.39	0.30	0.23	0.19	
	0.30		0.80	0.66	0.57	0.50	0.40	0.33	0.28	0.22	0.18	
	0.20		0.69	0.59	0.51	0.45	0.37	0.31	0.27	0.21	0.17	
0.30	0.50	0.20	0.92	0.74	0.62	0.53	0.42	0.34	0.29	0.22	0.18	
	0.30		0.78	0.65	0.55	0.48	0.38	0.32	0.27	0.21	0.17	
	0.20		0.69	0.58	0.50	0.44	0.36	0.30	0.26	0.20	0.17	
0.00	0.00	0.00	0.58	0.48	0.41	0.35	0.28	0.23	0.20	0.15	0.12	
Rating:32W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.17	0.18	0.19	0.19	0.20	0.21	0.21	0.22	0.22	
	0.30		0.10	0.11	0.13	0.14	0.16	0.17	0.18	0.19	0.20	
	0.20		0.05	0.07	0.08	0.10	0.12	0.13	0.15	0.16	0.17	
0.50	0.50	0.20	0.16	0.17	0.18	0.19	0.19	0.20	0.20	0.21	0.21	
	0.30		0.10	0.11	0.13	0.14	0.15	0.16	0.17	0.18	0.19	
	0.20		0.05	0.07	0.08	0.10	0.11	0.13	0.14	0.16	0.17	
0.30	0.50	0.20	0.16	0.17	0.17	0.18	0.19	0.19	0.19	0.20	0.20	
	0.30		0.10	0.11	0.12	0.13	0.15	0.16	0.16	0.18	0.18	
	0.20		0.05	0.07	0.08	0.09	0.11	0.13	0.14	0.15	0.16	
0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
Rating:32W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												