

Report No.:

Test Time: 04.08.2020 15:16

Luminaire Property

Luminaire Manufacturer:

Luminaire Description: FI 135 24LED 0.35A 37W 5000K prozrachniy 1-10

Number of Lamps: 1

Luminous Length (mm): 1262

Luminous Width (mm): 124

Luminous Height (mm): 85

Voltage: 232.1 V

Current: 0.151 A

Power: 37.21 W

Power Factor: 0.981

Photometric Results

CIE Class: Direct

Total Rated Lamp Lumens: 4959.9 lm

Measurement Flux: 4959.9 lm

Efficiency: 100%

Downward Ratio: 98%

Upward Ratio: 2%

Field Angle(C0/C180,C90/C270,C45/C225,C135/315): 154.1, 165.2, 165.3, 165.4

Beam Angle(C0/C180,C90/C270,C45/C225,C135/315): 108.6, 91.5, 100.8, 101.6

Luminaire Efficacy Rating (LER): 133.35

Central Intensity: 1913.84 cd

Max. Intensity: 2092.59 cd

Pos of Max. Intensity: H112.5 V18


S/MH(C0/C180): 1.19

S/MH(C90/C270): 1.04

Picture Of Luminaire



Luminous Intensity Distribution Curve

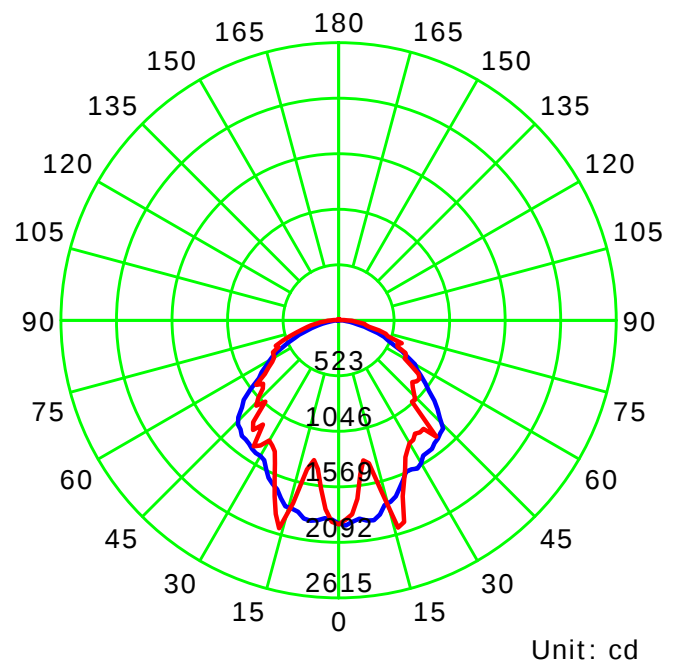

— C0-C180 — C90-C270

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0



Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:


Luminous Intensity Distribution Curve

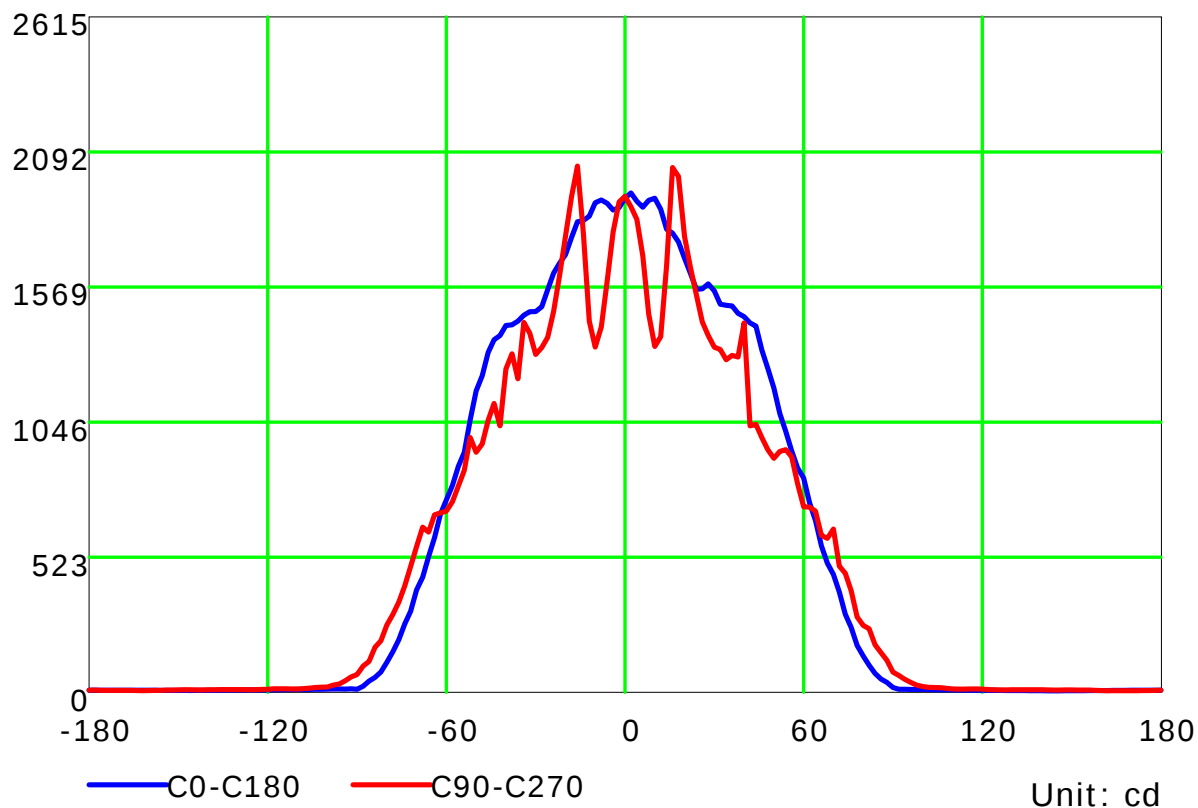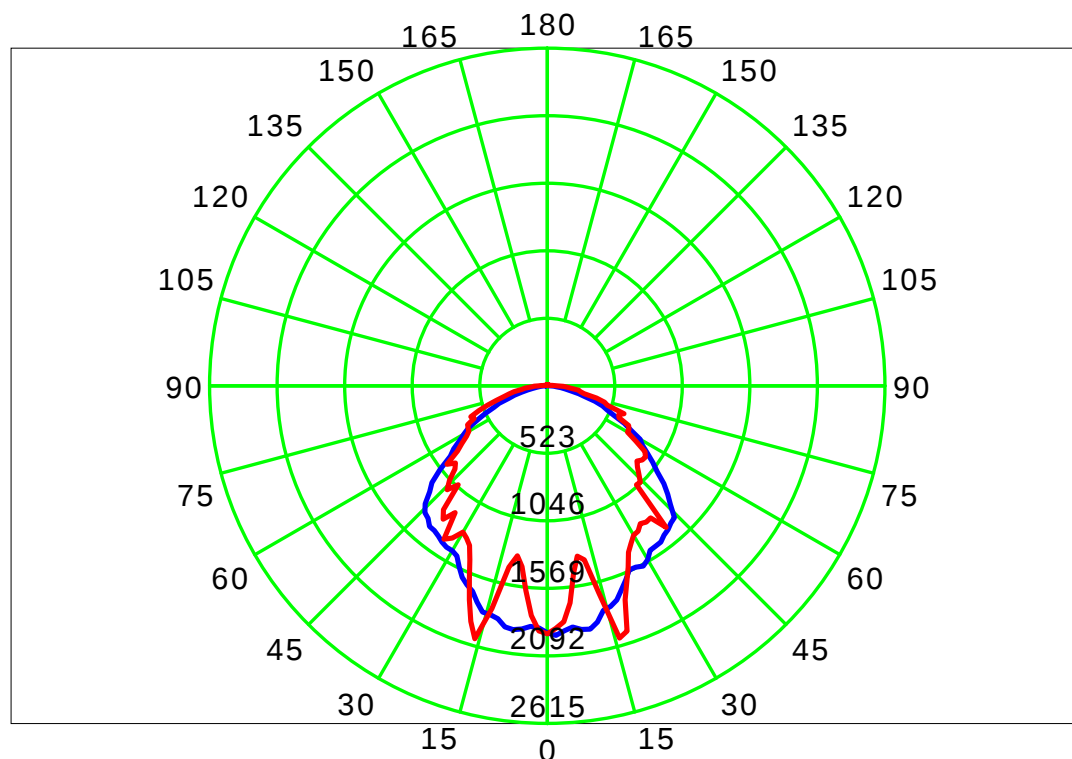

C Plane (°): 0.0-360.0: 22.5
Test Lab:
Test Type: TYPE C
Temperature:
Operator:

Gamma Plane (°): 0.0-180.0: 2.0
Test Device: LSG-1800B
Distance: 12.677 m
Humidity:
Inspector:

Luminous Intensity Distribution Curve(cd / klm)

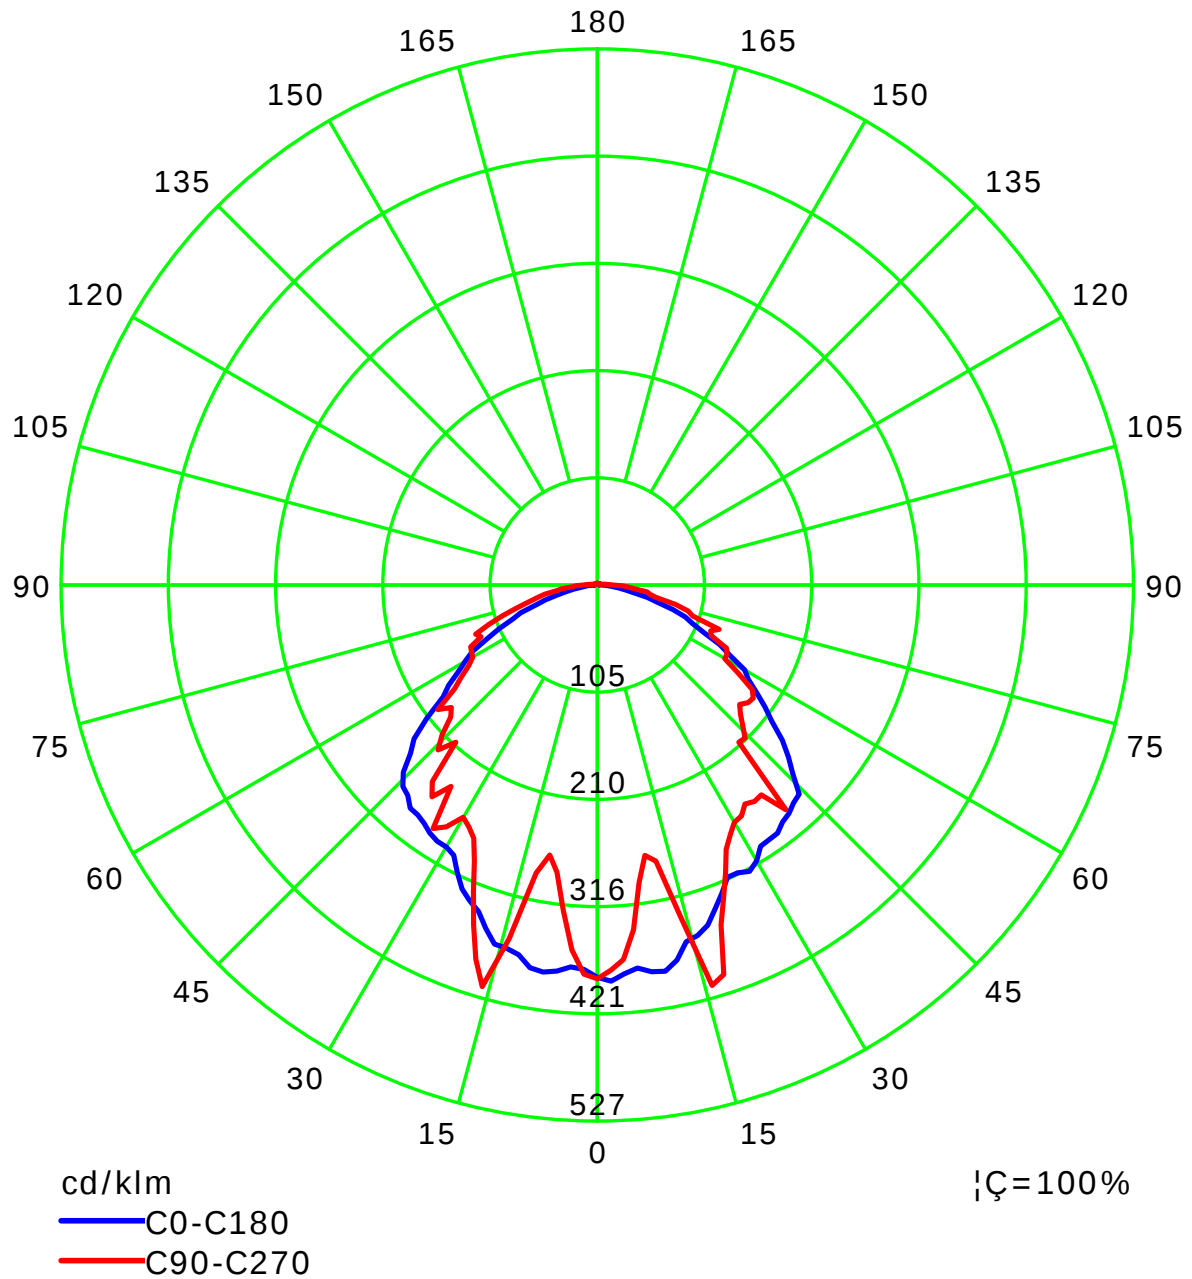

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0

Test Device: LSG-1800B

Distance: 12.677 m



Humidity:

Inspector:

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

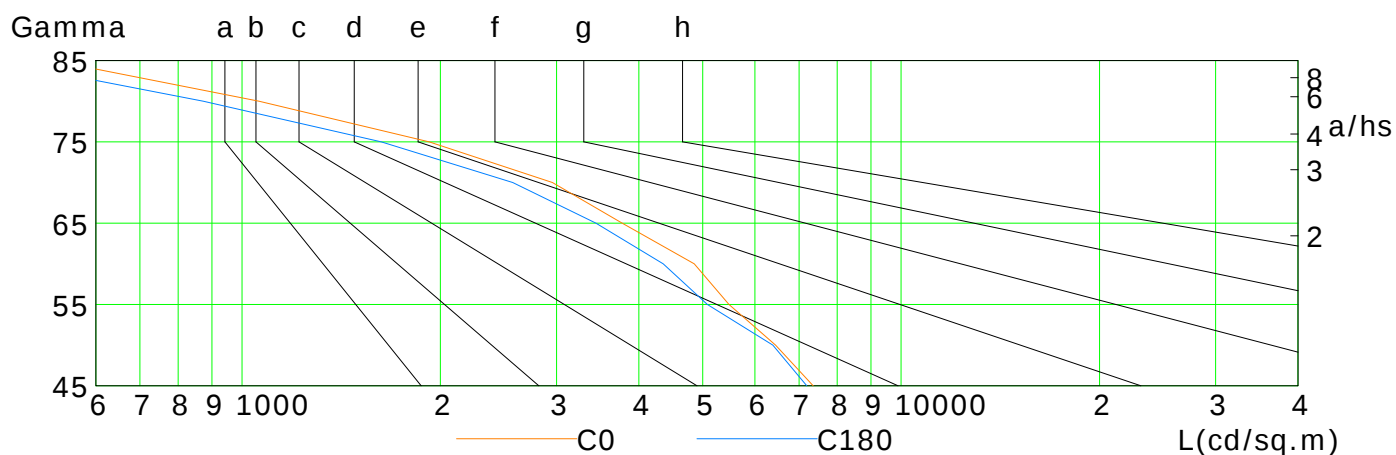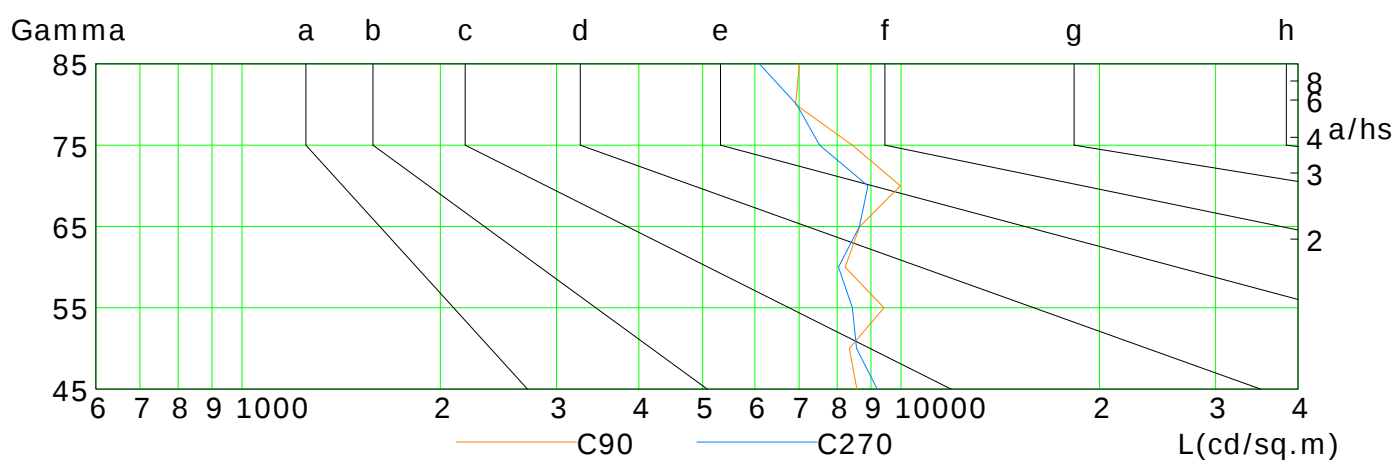

L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	7356	6450	5480	4853	3774	2957	1923	1061	518
C90	8569	8343	9415	8223	8653	9975	8433	6914	7008
C180	7191	6389	5081	4356	3444	2574	1627	873	421
C270	9197	8559	8433	8035	8645	8903	7521	6942	6096

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0


Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Illuminance at a Distance

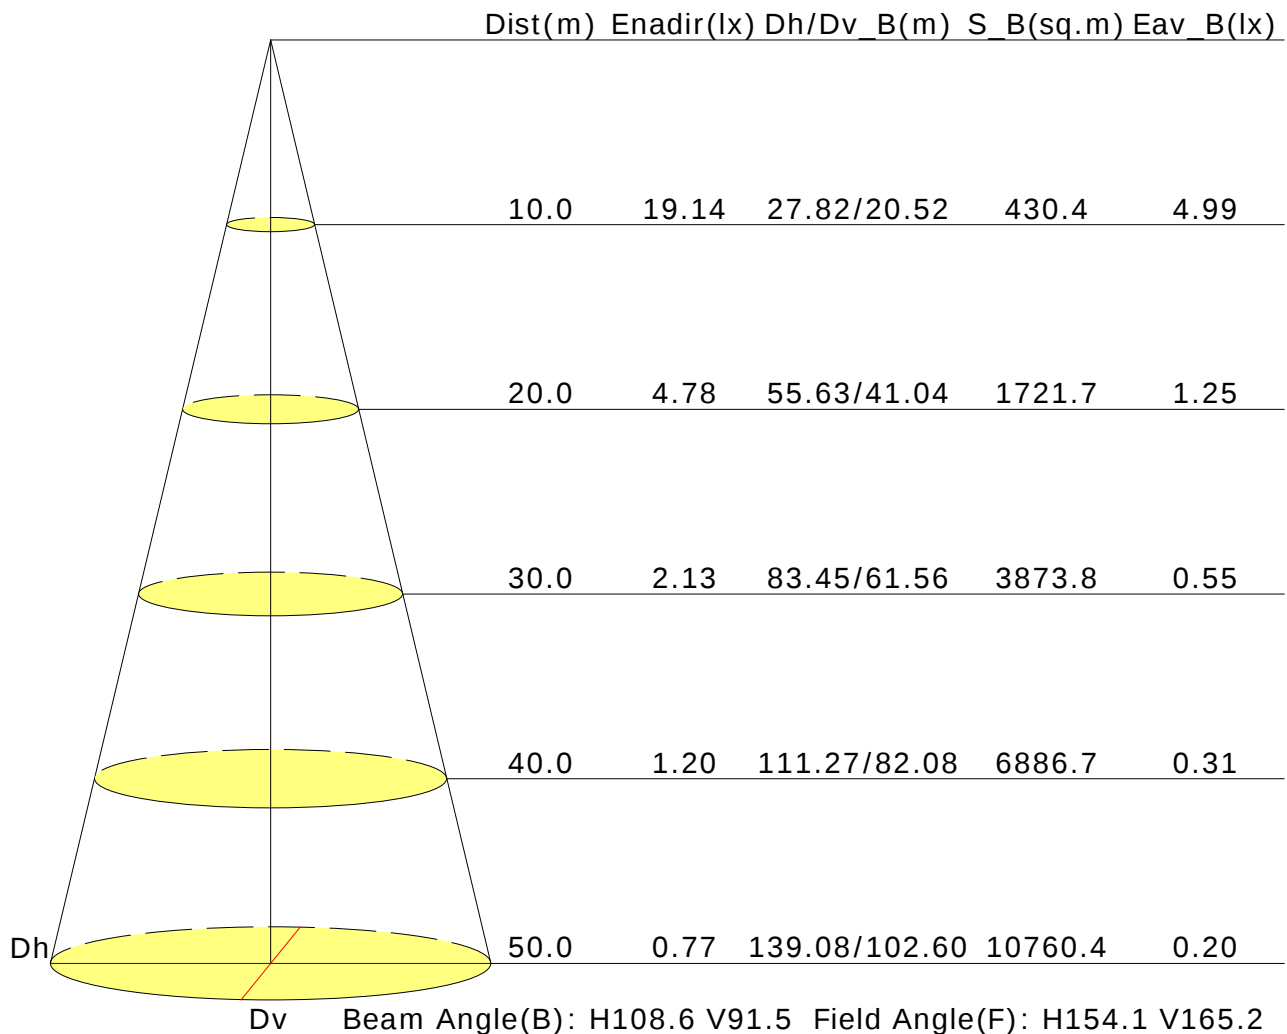

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	18.2	19.6	18.5	19.8	20.1	18.9	20.3	19.2	20.6	20.8
3H	19.1	20.4	19.5	20.7	21.0	21.0	22.2	21.3	22.5	22.8
4H	19.4	20.6	19.8	20.9	21.3	21.8	22.9	22.1	23.3	23.6
6H	19.5	20.6	19.9	21.0	21.4	22.3	23.4	22.7	23.8	24.1
8H	19.6	20.6	20.0	21.0	21.3	22.6	23.6	23.0	24.0	24.4
12H	19.5	20.6	20.0	20.9	21.3	22.8	23.8	23.2	24.1	24.5
X=4H Y=2H	18.7	19.9	19.1	20.2	20.5	19.3	20.5	19.7	20.8	21.1
3H	19.8	20.8	20.2	21.2	21.6	21.5	22.5	21.9	22.9	23.3
4H	20.2	21.1	20.6	21.5	21.9	22.4	23.3	22.9	23.7	24.1
6H	20.4	21.2	20.9	21.6	22.1	23.1	23.9	23.6	24.3	24.8
8H	20.4	21.2	20.9	21.6	22.1	23.4	24.1	23.9	24.6	25.0
12H	20.5	21.1	20.9	21.6	22.1	23.7	24.3	24.1	24.8	25.3
X=8H Y=4H	20.6	21.3	21.0	21.8	22.2	22.6	23.3	23.0	23.7	24.2
6H	20.9	21.5	21.4	22.0	22.5	23.4	24.0	23.9	24.4	24.9
8H	21.0	21.5	21.5	22.0	22.5	23.7	24.3	24.2	24.8	25.3
12H	21.0	21.5	21.6	22.0	22.6	24.1	24.5	24.6	25.1	25.6
X=12H Y=4H	20.6	21.3	21.1	21.7	22.2	22.5	23.2	23.0	23.7	24.2
6H	21.0	21.5	21.5	22.0	22.5	23.4	23.9	23.9	24.4	24.9
8H	21.1	21.6	21.6	22.1	22.6	23.8	24.2	24.3	24.8	25.3
Variations with the observer position at spacings:										
S=1.0H	+0.5/-0.4					+0.1/-0.2				
S=1.5H	+0.8/-0.6					+0.4/-0.5				
S=2.0H	+1.5/-1.5					+0.6/-0.7				

Calculate in accordance with CIE Pub.117. The table is revised with 4960lm ($8\log(F/F_0) = 5.6$).

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0

Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.56	0.66	0.73	0.79	0.86	0.91	0.94	0.99	1.02	
	0.30		0.48	0.58	0.66	0.71	0.79	0.85	0.89	0.95	0.98	
	0.20		0.42	0.52	0.60	0.66	0.74	0.80	0.85	0.91	0.95	
0.50	0.50	0.20	0.54	0.64	0.71	0.76	0.82	0.87	0.90	0.95	0.97	
	0.30		0.47	0.57	0.64	0.69	0.77	0.82	0.86	0.91	0.94	
	0.20		0.42	0.52	0.59	0.64	0.72	0.78	0.82	0.88	0.92	
0.30	0.50	0.20	0.52	0.62	0.68	0.73	0.79	0.83	0.87	0.91	0.93	
	0.30		0.46	0.56	0.62	0.68	0.75	0.79	0.83	0.88	0.91	
	0.20		0.41	0.51	0.58	0.63	0.71	0.76	0.80	0.85	0.88	
0.00	0.00	0.00	0.39	0.48	0.55	0.60	0.67	0.72	0.75	0.80	0.83	
Rating:37W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	1.00	0.83	0.71	0.62	0.50	0.42	0.36	0.28	0.23	
	0.30		0.83	0.71	0.62	0.55	0.45	0.38	0.33	0.26	0.22	
	0.20		0.72	0.62	0.55	0.49	0.41	0.35	0.31	0.25	0.21	
0.50	0.50	0.20	0.96	0.79	0.68	0.59	0.47	0.43	0.34	0.26	0.22	
	0.30		0.81	0.69	0.60	0.53	0.43	0.37	0.32	0.25	0.21	
	0.20		0.71	0.61	0.54	0.48	0.40	0.34	0.30	0.24	0.20	
0.30	0.50	0.20	0.93	0.76	0.65	0.57	0.45	0.38	0.32	0.25	0.21	
	0.30		0.79	0.67	0.58	0.51	0.42	0.35	0.30	0.24	0.20	
	0.20		0.69	0.60	0.53	0.47	0.39	0.33	0.29	0.23	0.19	
0.00	0.00	0.00	0.59	0.50	0.43	0.38	0.31	0.26	0.23	0.18	0.15	
Rating:37W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 1.25									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.18	0.20	0.21	0.21	0.22	0.23	0.23	0.24	0.24	
	0.30		0.11	0.13	0.14	0.15	0.17	0.18	0.19	0.20	0.21	
	0.20		0.07	0.08	0.10	0.11	0.13	0.15	0.16	0.17	0.19	
0.50	0.50	0.20	0.18	0.19	0.20	0.20	0.21	0.22	0.22	0.23	0.23	
	0.30		0.11	0.13	0.14	0.15	0.17	0.18	0.18	0.20	0.20	
	0.20		0.07	0.08	0.10	0.11	0.13	0.14	0.15	0.17	0.18	
0.30	0.50	0.20	0.17	0.18	0.19	0.20	0.20	0.21	0.21	0.22	0.22	
	0.30		0.11	0.13	0.14	0.15	0.16	0.17	0.18	0.19	0.20	
	0.20		0.07	0.08	0.09	0.11	0.12	0.14	0.15	0.16	0.18	
0.00	0.00	0.00	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	
Rating:37W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												