



OOO "FAROS"

www.farosled.ru

Tel: +7 (8422) 583-386, 583-387

E-mail: info@farosled.ru

Page 1 of 9 Pages

Report No.:

Test Time: 26.03.2020 00:24

## Luminaire Property

Luminaire Manufacturer:

Luminaire Description: FL 58 L 105LED 46W 5000K 96x55 gr

Number of Lamps: 1

Luminous Length (mm): 1500

Luminous Width (mm): 75

Luminous Height (mm): 60

Voltage: 228.9 V

Current: 0.203 A

Power: 45.28 W

Power Factor: 0.975

## Photometric Results

CIE Class: Direct

Total Rated Lamp Lumens: 6351.5 lm

Measurement Flux: 6351.5 lm

Efficiency: 100%

Downward Ratio: 99%

Upward Ratio: 1%

Field Angle(C0/C180,C90/C270,C45/C225,C135/315): 133.8, 112.9, 112.6, 113.7

Beam Angle(C0/C180,C90/C270,C45/C225,C135/315): 94.3, 53.2, 61.7, 62.5

Luminaire Efficacy Rating (LER): 140.32

Central Intensity: 4491.93 cd


Max. Intensity: 4497.11 cd

Pos of Max. Intensity: H225 V2


S/MH(C0/C180): 1.39

S/MH(C90/C270): 0.85

Picture Of Luminaire



Luminous Intensity Distribution Curve

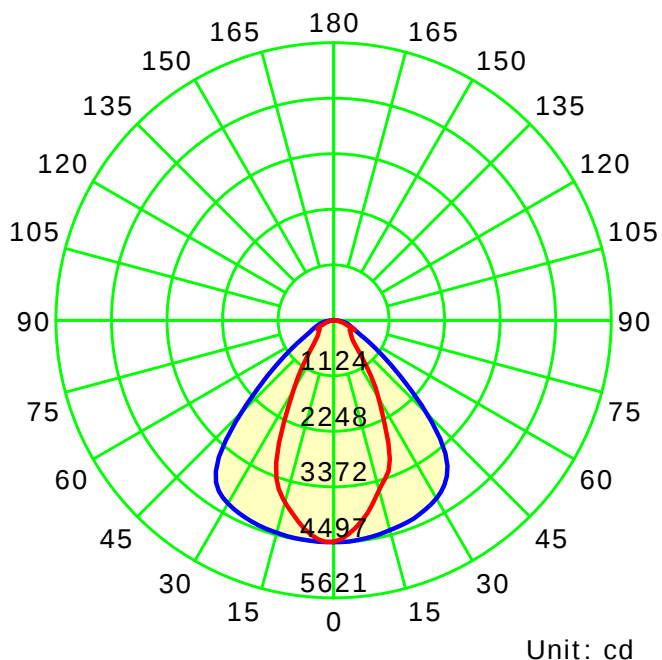

— C0-C180 — C90-C270

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0



Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

## Luminous Intensity Distribution Curve

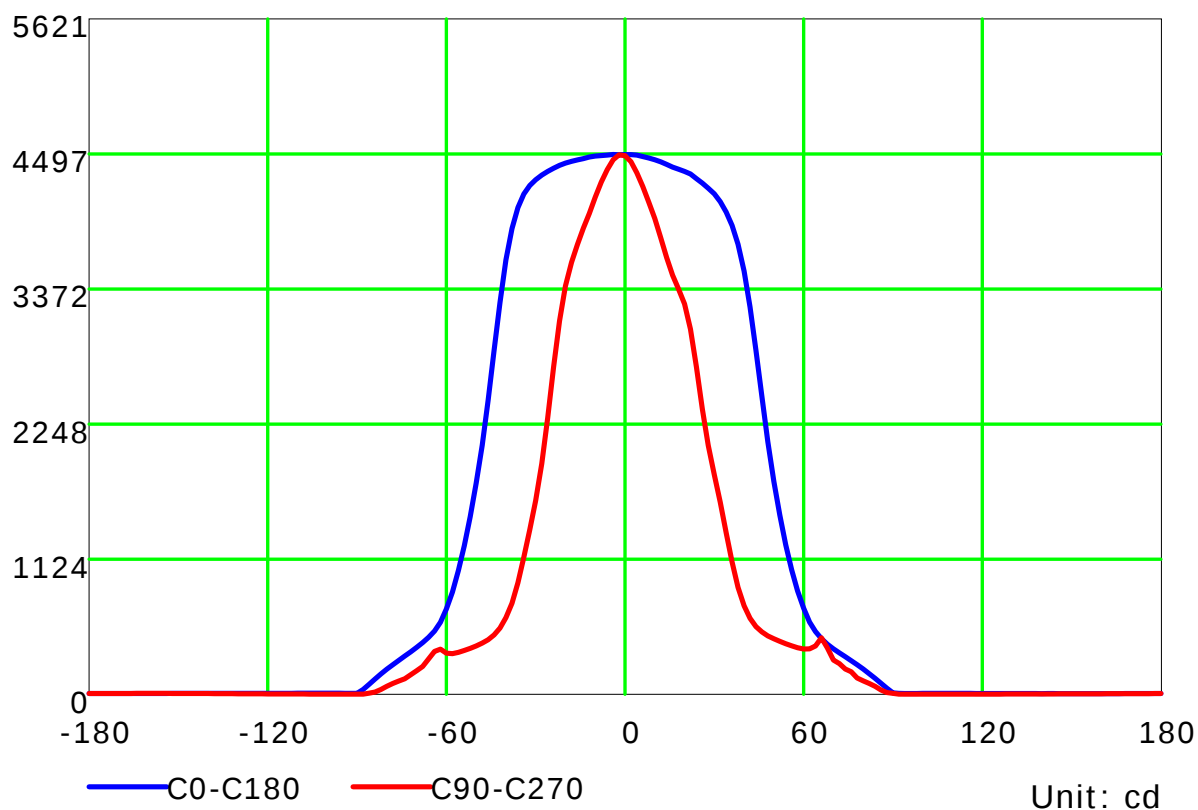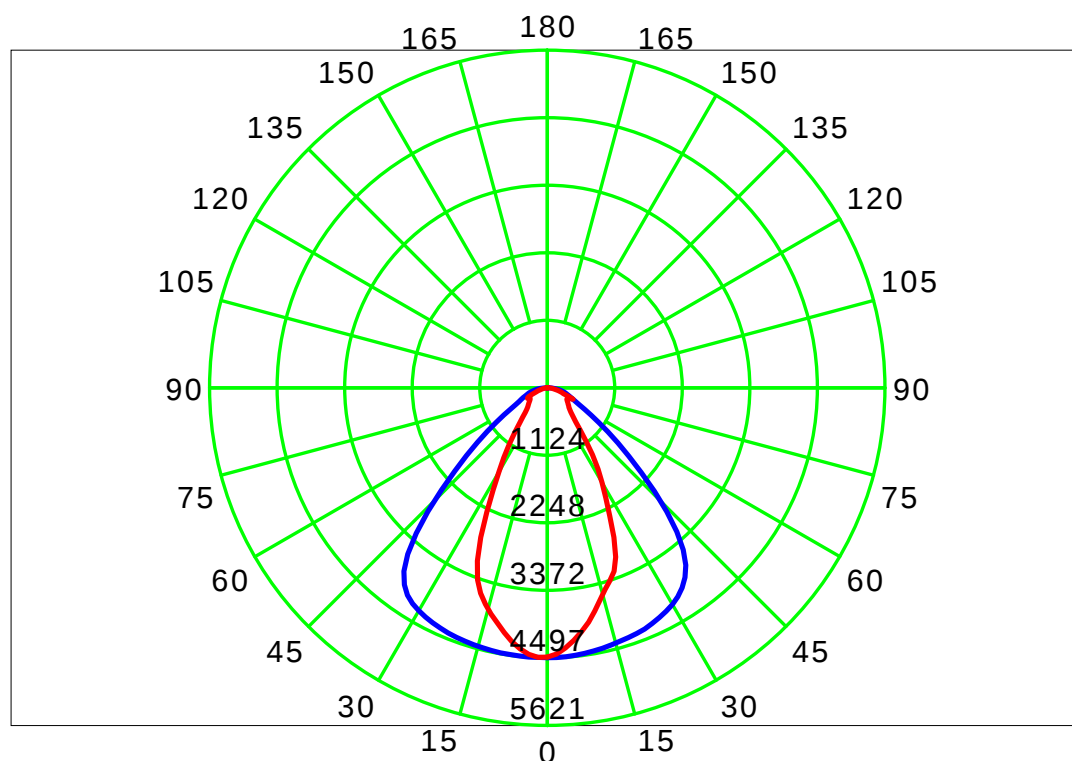

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0


Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

## Luminous Intensity Distribution Curve(cd / klm)

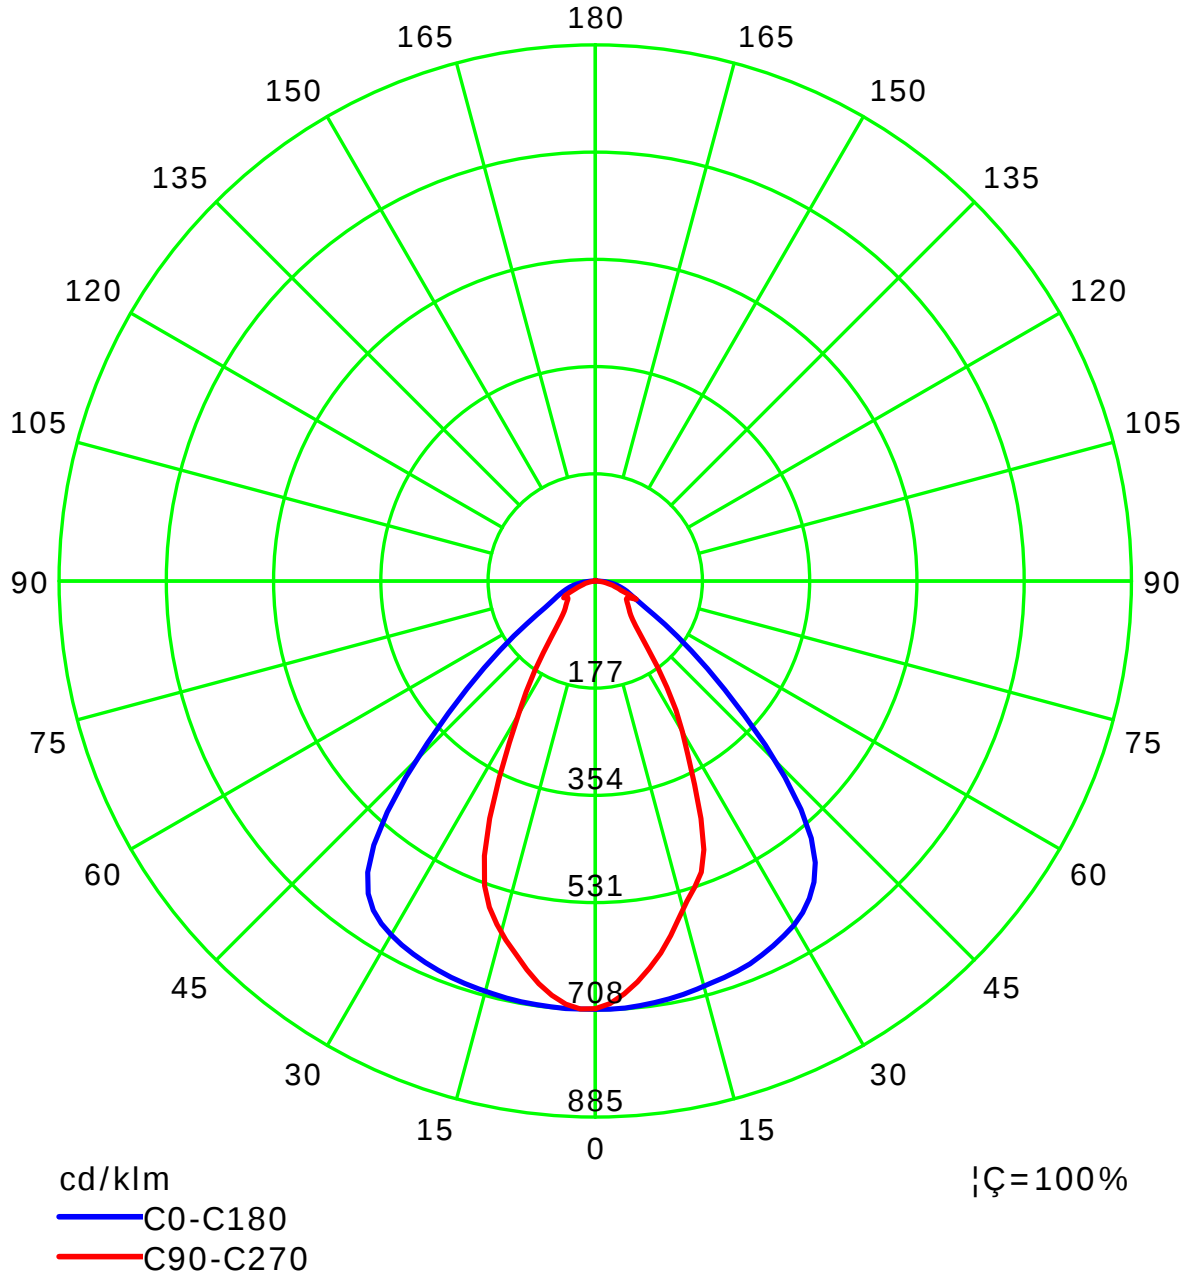

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0

Test Device: LSG-1800B

Distance: 12.677 m



Humidity:

Inspector:

## Lum Limit Curve

| Dazzle | Quality | Illuminance (lx) |      |      |       |       |       |       |       |
|--------|---------|------------------|------|------|-------|-------|-------|-------|-------|
| 1.15   | A       | 2000             | 1000 | 500  | <=300 |       |       |       |       |
| 1.50   | B       |                  | 2000 | 1000 | 500   | <=300 |       |       |       |
| 1.85   | C       |                  |      | 2000 | 1000  | 500   | <=300 |       |       |
| 2.20   | D       |                  |      |      | 2000  | 1000  | 500   | <=300 |       |
| 2.55   | E       |                  |      |      |       | 2000  | 1000  | 500   | <=300 |

a b c d e f g h

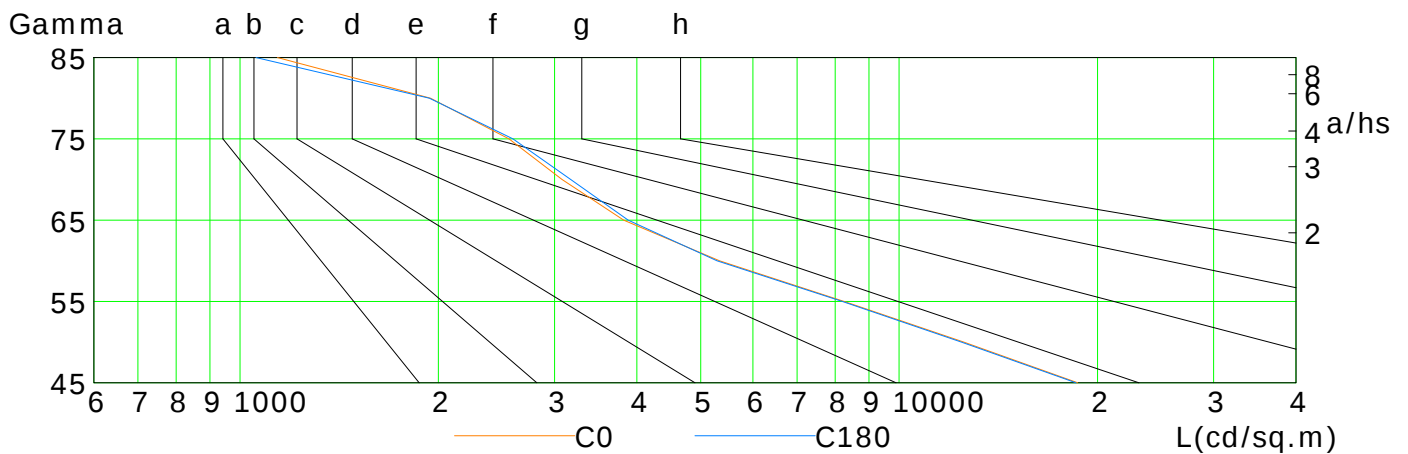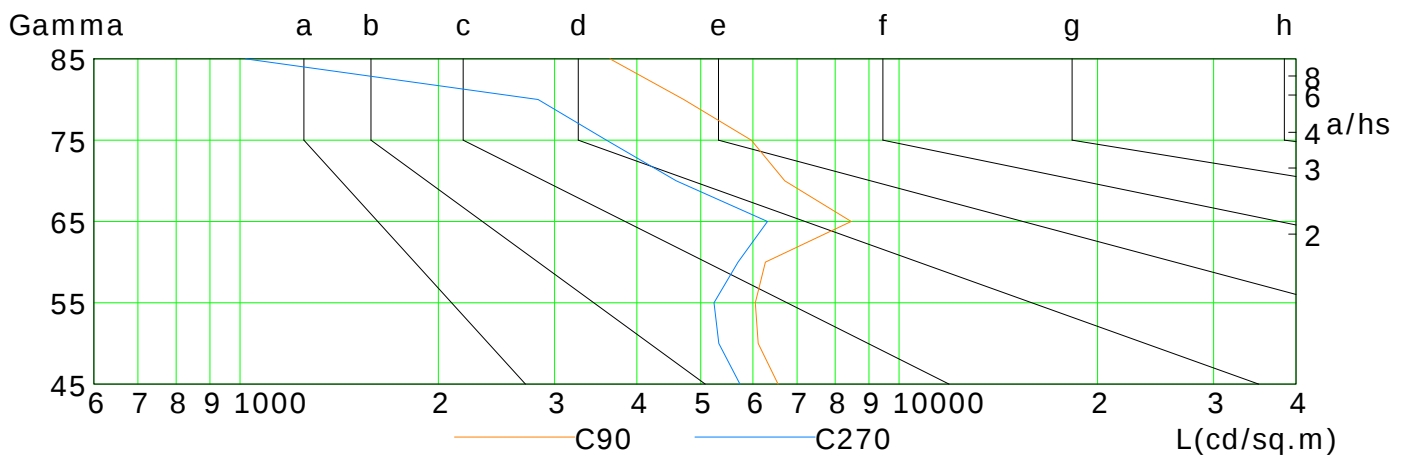

| L(cd/sq.m) | G45   | G50   | G55  | G60  | G65  | G70  | G75  | G80  | G85  |
|------------|-------|-------|------|------|------|------|------|------|------|
| C0         | 18661 | 12540 | 8253 | 5342 | 3820 | 3080 | 2559 | 1946 | 1140 |
| C90        | 6551  | 6113  | 6052 | 6268 | 8459 | 6705 | 5967 | 4712 | 3640 |
| C180       | 18543 | 12436 | 8200 | 5295 | 3880 | 3175 | 2595 | 1938 | 1057 |
| C270       | 5736  | 5326  | 5237 | 5697 | 6314 | 4590 | 3596 | 2833 | 1020 |

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0


Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

## Illuminance at a Distance

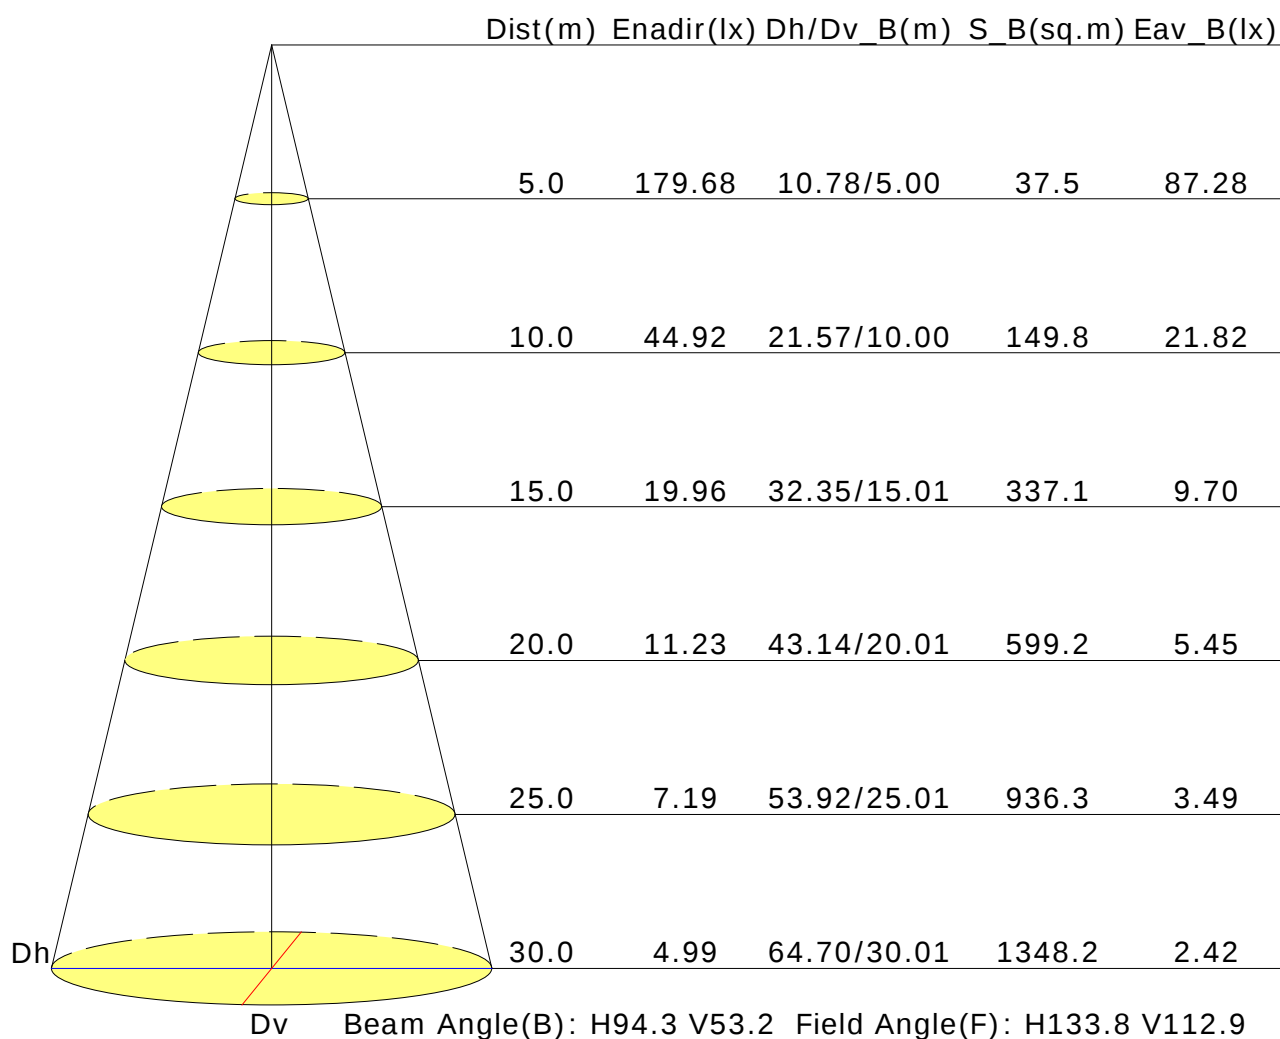

## UGR Table

|                                                    |                  |      |      |      |      |                |      |      |      |      |
|----------------------------------------------------|------------------|------|------|------|------|----------------|------|------|------|------|
| Reflectance:                                       |                  |      |      |      |      |                |      |      |      |      |
| Ceiling (cavity)                                   | 0.7              | 0.7  | 0.5  | 0.5  | 0.3  | 0.7            | 0.7  | 0.5  | 0.5  | 0.3  |
| Wall                                               | 0.5              | 0.3  | 0.5  | 0.3  | 0.3  | 0.5            | 0.3  | 0.5  | 0.3  | 0.3  |
| Reference plane                                    | 0.2              | 0.2  | 0.2  | 0.2  | 0.2  | 0.2            | 0.2  | 0.2  | 0.2  | 0.2  |
| Room dimensions                                    | Viewed crosswise |      |      |      |      | Viewed endwise |      |      |      |      |
| X=2H Y=2H                                          | 18.9             | 20.1 | 19.2 | 20.3 | 20.5 | 15.3           | 16.4 | 15.6 | 16.7 | 16.9 |
| 3H                                                 | 19.4             | 20.5 | 19.8 | 20.7 | 21.0 | 17.2           | 18.2 | 17.5 | 18.5 | 18.8 |
| 4H                                                 | 19.7             | 20.7 | 20.0 | 20.9 | 21.2 | 17.7           | 18.7 | 18.1 | 19.0 | 19.3 |
| 6H                                                 | 19.9             | 20.8 | 20.3 | 21.1 | 21.4 | 18.0           | 18.9 | 18.4 | 19.2 | 19.6 |
| 8H                                                 | 20.0             | 20.8 | 20.3 | 21.2 | 21.5 | 18.1           | 19.0 | 18.5 | 19.3 | 19.7 |
| 12H                                                | 20.0             | 20.8 | 20.4 | 21.2 | 21.5 | 18.2           | 19.0 | 18.6 | 19.3 | 19.7 |
| X=4H Y=2H                                          | 19.0             | 19.9 | 19.3 | 20.2 | 20.5 | 15.8           | 16.8 | 16.2 | 17.1 | 17.4 |
| 3H                                                 | 19.7             | 20.5 | 20.0 | 20.8 | 21.2 | 17.8           | 18.7 | 18.2 | 19.0 | 19.3 |
| 4H                                                 | 20.0             | 20.8 | 20.4 | 21.1 | 21.5 | 18.4           | 19.2 | 18.8 | 19.5 | 19.9 |
| 6H                                                 | 20.4             | 21.0 | 20.8 | 21.4 | 21.8 | 18.8           | 19.5 | 19.2 | 19.9 | 20.3 |
| 8H                                                 | 20.5             | 21.1 | 20.9 | 21.5 | 21.9 | 18.9           | 19.5 | 19.4 | 19.9 | 20.4 |
| 12H                                                | 20.5             | 21.1 | 21.0 | 21.5 | 21.9 | 19.0           | 19.5 | 19.5 | 20.0 | 20.4 |
| X=8H Y=4H                                          | 20.1             | 20.7 | 20.5 | 21.1 | 21.5 | 18.6           | 19.2 | 19.0 | 19.6 | 20.0 |
| 6H                                                 | 20.5             | 21.0 | 21.0 | 21.4 | 21.9 | 19.1           | 19.6 | 19.6 | 20.0 | 20.5 |
| 8H                                                 | 20.7             | 21.1 | 21.2 | 21.6 | 22.1 | 19.2           | 19.7 | 19.7 | 20.1 | 20.6 |
| 12H                                                | 20.8             | 21.2 | 21.3 | 21.7 | 22.2 | 19.3           | 19.7 | 19.8 | 20.2 | 20.7 |
| X=12H Y=4H                                         | 20.1             | 20.6 | 20.5 | 21.1 | 21.5 | 18.6           | 19.1 | 19.1 | 19.6 | 20.0 |
| 6H                                                 | 20.5             | 20.9 | 21.0 | 21.4 | 21.9 | 19.1           | 19.5 | 19.6 | 20.0 | 20.5 |
| 8H                                                 | 20.7             | 21.1 | 21.2 | 21.6 | 22.1 | 19.3           | 19.7 | 19.8 | 20.1 | 20.6 |
| Variations with the observer position at spacings: |                  |      |      |      |      |                |      |      |      |      |
| S=1.0H                                             | +1.1/-1.0        |      |      |      |      | +0.3/-0.4      |      |      |      |      |
| S=1.5H                                             | +2.8/-1.7        |      |      |      |      | +1.1/-0.7      |      |      |      |      |
| S=2.0H                                             | +4.3/-2.3        |      |      |      |      | +1.4/-0.7      |      |      |      |      |

Calculate in accordance with CIE Pub.117. The table is revised with 6351lm ( $8\log(F/F_0) = 6.4$ ).

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature:

Operator:

Gamma Plane (°):0.0-180.0:2.0

Test Device: LSG-1800B

Distance: 12.677 m

Humidity:

Inspector:

## Utilisation Factor Table(Floor cavity)

| Utilisation Factors UF(F)                                                                                                                                                         |      |       | SHR NOM = 1.00 |      |      |      |      |      |      |      |      |  |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------|-------|----------------|------|------|------|------|------|------|------|------|--|
| Room Reflectance                                                                                                                                                                  |      |       | Room Index(RI) |      |      |      |      |      |      |      |      |  |
| Ceiling                                                                                                                                                                           | Wall | Floor | 0.75           | 1.00 | 1.25 | 1.50 | 2.00 | 2.50 | 3.00 | 4.00 | 5.00 |  |
| 0.70                                                                                                                                                                              | 0.50 | 0.20  | 0.70           | 0.79 | 0.85 | 0.89 | 0.95 | 0.98 | 1.01 | 1.05 | 1.07 |  |
|                                                                                                                                                                                   | 0.30 |       | 0.64           | 0.73 | 0.79 | 0.83 | 0.90 | 0.94 | 0.97 | 1.01 | 1.04 |  |
|                                                                                                                                                                                   | 0.20 |       | 0.59           | 0.68 | 0.74 | 0.79 | 0.86 | 0.90 | 0.94 | 0.98 | 1.02 |  |
| 0.50                                                                                                                                                                              | 0.50 | 0.20  | 0.69           | 0.77 | 0.82 | 0.86 | 0.91 | 0.95 | 0.97 | 1.01 | 1.03 |  |
|                                                                                                                                                                                   | 0.30 |       | 0.63           | 0.72 | 0.77 | 0.81 | 0.87 | 0.91 | 0.94 | 0.98 | 1.00 |  |
|                                                                                                                                                                                   | 0.20 |       | 0.59           | 0.67 | 0.73 | 0.78 | 0.84 | 0.88 | 0.91 | 0.96 | 0.98 |  |
| 0.30                                                                                                                                                                              | 0.50 | 0.20  | 0.67           | 0.75 | 0.80 | 0.84 | 0.89 | 0.92 | 0.94 | 0.97 | 0.99 |  |
|                                                                                                                                                                                   | 0.30 |       | 0.62           | 0.70 | 0.76 | 0.80 | 0.85 | 0.89 | 0.91 | 0.95 | 0.97 |  |
|                                                                                                                                                                                   | 0.20 |       | 0.59           | 0.67 | 0.72 | 0.76 | 0.82 | 0.86 | 0.89 | 0.93 | 0.95 |  |
| 0.00                                                                                                                                                                              | 0.00 | 0.00  | 0.57           | 0.64 | 0.70 | 0.74 | 0.79 | 0.82 | 0.85 | 0.88 | 0.90 |  |
| Rating:45W Photometrically tested without ceiling board.<br>Multiply UF values by service correction factors<br>Calculate in accordance with CIBSE Technical Memorandum NO.5 1980 |      |       |                |      |      |      |      |      |      |      |      |  |

## Utilisation Factor Table(Wall)

| Utilisation Factors UF(W)                                                                                                                                                         |      |       | SHR NOM = 1.00 |      |      |      |      |      |      |      |      |  |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------|-------|----------------|------|------|------|------|------|------|------|------|--|
| Room Reflectance                                                                                                                                                                  |      |       | Room Index(RI) |      |      |      |      |      |      |      |      |  |
| Ceiling                                                                                                                                                                           | Wall | Floor | 0.75           | 1.00 | 1.25 | 1.50 | 2.00 | 2.50 | 3.00 | 4.00 | 5.00 |  |
| 0.70                                                                                                                                                                              | 0.50 | 0.20  | 0.80           | 0.65 | 0.55 | 0.48 | 0.38 | 0.32 | 0.27 | 0.21 | 0.17 |  |
|                                                                                                                                                                                   | 0.30 |       | 0.66           | 0.56 | 0.48 | 0.42 | 0.34 | 0.29 | 0.25 | 0.20 | 0.16 |  |
|                                                                                                                                                                                   | 0.20 |       | 0.57           | 0.49 | 0.43 | 0.38 | 0.31 | 0.27 | 0.23 | 0.19 | 0.15 |  |
| 0.50                                                                                                                                                                              | 0.50 | 0.20  | 0.76           | 0.62 | 0.52 | 0.45 | 0.36 | 0.33 | 0.25 | 0.20 | 0.16 |  |
|                                                                                                                                                                                   | 0.30 |       | 0.65           | 0.54 | 0.46 | 0.41 | 0.33 | 0.28 | 0.24 | 0.19 | 0.15 |  |
|                                                                                                                                                                                   | 0.20 |       | 0.56           | 0.48 | 0.42 | 0.37 | 0.30 | 0.26 | 0.22 | 0.18 | 0.15 |  |
| 0.30                                                                                                                                                                              | 0.50 | 0.20  | 0.74           | 0.59 | 0.50 | 0.43 | 0.34 | 0.28 | 0.24 | 0.18 | 0.15 |  |
|                                                                                                                                                                                   | 0.30 |       | 0.63           | 0.52 | 0.45 | 0.39 | 0.31 | 0.26 | 0.23 | 0.18 | 0.14 |  |
|                                                                                                                                                                                   | 0.20 |       | 0.55           | 0.47 | 0.40 | 0.36 | 0.29 | 0.25 | 0.21 | 0.17 | 0.14 |  |
| 0.00                                                                                                                                                                              | 0.00 | 0.00  | 0.43           | 0.35 | 0.30 | 0.26 | 0.21 | 0.17 | 0.15 | 0.12 | 0.10 |  |
| Rating:45W Photometrically tested without ceiling board.<br>Multiply UF values by service correction factors<br>Calculate in accordance with CIBSE Technical Memorandum NO.5 1980 |      |       |                |      |      |      |      |      |      |      |      |  |

## Utilisation Factor Table(Ceiling cavity)

| Utilisation Factors UF(C)                                                                                                                                                         |      |       | SHR NOM = 1.00 |      |      |      |      |      |      |      |      |  |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------|-------|----------------|------|------|------|------|------|------|------|------|--|
| Room Reflectance                                                                                                                                                                  |      |       | Room Index(RI) |      |      |      |      |      |      |      |      |  |
| Ceiling                                                                                                                                                                           | Wall | Floor | 0.75           | 1.00 | 1.25 | 1.50 | 2.00 | 2.50 | 3.00 | 4.00 | 5.00 |  |
| 0.70                                                                                                                                                                              | 0.50 | 0.20  | 0.15           | 0.17 | 0.18 | 0.18 | 0.20 | 0.20 | 0.21 | 0.21 | 0.22 |  |
|                                                                                                                                                                                   | 0.30 |       | 0.10           | 0.11 | 0.13 | 0.14 | 0.16 | 0.17 | 0.18 | 0.19 | 0.20 |  |
|                                                                                                                                                                                   | 0.20 |       | 0.06           | 0.08 | 0.09 | 0.11 | 0.13 | 0.14 | 0.15 | 0.17 | 0.18 |  |
| 0.50                                                                                                                                                                              | 0.50 | 0.20  | 0.15           | 0.16 | 0.17 | 0.18 | 0.19 | 0.19 | 0.20 | 0.21 | 0.21 |  |
|                                                                                                                                                                                   | 0.30 |       | 0.10           | 0.11 | 0.13 | 0.14 | 0.15 | 0.16 | 0.17 | 0.18 | 0.19 |  |
|                                                                                                                                                                                   | 0.20 |       | 0.06           | 0.08 | 0.09 | 0.10 | 0.12 | 0.14 | 0.15 | 0.16 | 0.17 |  |
| 0.30                                                                                                                                                                              | 0.50 | 0.20  | 0.14           | 0.15 | 0.16 | 0.17 | 0.18 | 0.19 | 0.19 | 0.20 | 0.20 |  |
|                                                                                                                                                                                   | 0.30 |       | 0.09           | 0.11 | 0.12 | 0.13 | 0.15 | 0.16 | 0.17 | 0.18 | 0.18 |  |
|                                                                                                                                                                                   | 0.20 |       | 0.06           | 0.07 | 0.09 | 0.10 | 0.12 | 0.13 | 0.14 | 0.16 | 0.17 |  |
| 0.00                                                                                                                                                                              | 0.00 | 0.00  | 0.01           | 0.01 | 0.01 | 0.01 | 0.01 | 0.01 | 0.01 | 0.01 | 0.01 |  |
| Rating:45W Photometrically tested without ceiling board.<br>Multiply UF values by service correction factors<br>Calculate in accordance with CIBSE Technical Memorandum NO.5 1980 |      |       |                |      |      |      |      |      |      |      |      |  |